



SQKN-YEE 1 BC + MiSAN-Y
EE 1 S 2.1


Clivet S.p.A.





55 °C

35 °C












+




+




+





+




+











2015

8.11/2013




SQKN-YEE 1 BC + MiSAN
-YEE 1 S 3.1


Clivet S.p.A.





55 °C

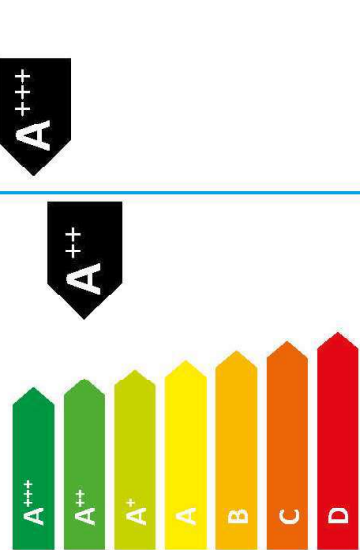35 °C











41 dB



57 dB

05
06
07
kW

06
06
08
kW



2019

8.11/2013



ENERG
енергия · ενεργεια


Y IJA
IE IA

Clivet S.p.A.



SQKN-YEE 1 BC + MISAN-Y
EE 1 S 3.1

+	+	+	+

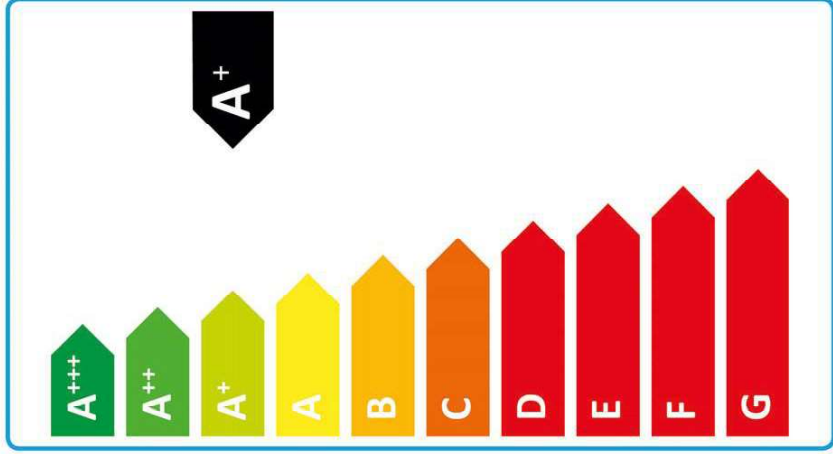

2015

811/2013