

AIR CONDITIONER

REFRIGERANT R32

Wall mounted type

SERVICE MANUAL



Fuji Furukawa Engineering & Construction Co.Ltd.

Notices:

- Product specifications and design are subject to change without notice for future improvement.
- For further details, please check with our authorized dealer.

Trademarks

"AIRSTAGE Mobile" is a trademark of FUJITSU GENERAL LIMITED.

Android and Google Play are trademarks of Google LLC.

App Store is a service mark of Apple Inc., registered in the U.S. and other countries.

IOS is a trademark or registered trademark of Cisco in the U.S. and other countries and is used under license.

CONTENTS

1. GENERAL INFORMATION

2. TECHNICAL DATA AND PARTS LIST

3. TROUBLESHOOTING

4. CONTROL AND FUNCTIONS

5. FILED WORKING



1. GENERAL INFORMATION

CONTENTS

1. GENERAL INFORMATION

1. Specifications	01-1
- 1-1. Indoor unit	01-1
1-2. Outdoor unit	01-3
2. Dimensions	01-4
2-1. Indoor unit	01-4
2-2. Outdoor unit	01-7

1. Specifications

1-1. Indoor unit

Туре						Wall mounted	
						Inverter, Heat pump	
Model name					RSH09KHCBN	RSH12KHCBN	RSH14KHCBN
Power supply intake		Voltage		V		Outdoor unit	
System power supply	v	Voltage Frequency		Hz		230 50	
bystein pewer supply	y	Available voltage	range	V		207—253	
ndoor unit power su	pply (from outdoor		0	V		230	
			Rated	kW	2.5	3.5	4.2
		Cooling		Btu/h	8,500	11,900	14,300
			Min.—Max.	kW Btu/h	0.7-4.7	0.7—5.1 2,400—17,400	0.8—5.9 2.700—20.100
Capacity				kW	3.2	4.0	5.4
		Lingting	Rated	Btu/h	10,900	13,600	18,400
		Heating	Min.—Max.	kW	0.7—7.7	0.7—8.4	0.8—9.0
				Btu/h	2,400—26,300	2,400—28,700	2,700—30,700
		Cooling	Rated Min.—Max.	4 –	0.42	0.68	0.88
			Rated	kW –	0.12—1.11 0.54	0.12—1.30 0.74	0.12—1.65
		Heating	Min.—Max.		0.11-2.15	0.12-2.40	0.13-2.58
			HIGH		25.0	27.8	33.2
nput power			MED-HIGH	1 -	21.1	22.3	28.6
		Fan	MED	w		7.5	24.3
		i an	MED—LOW			4.3	19.2
			LOW	╡ –		1.1	14.3
		Cooling	QUIET	<u> </u>	2.0	3.8	5.7
Current		Heating	Rated	A	2.0	3.1	5.0
		Cooling	1		2.0	A+++	0.0
Energy efficiency cla	ISS	Heating (Average)			A+++	
		Cooling	/		2.5	3.5	4.2
Pdesign		Heating (Average)	kW –	2.5	3.6	4.2
BEER		Cooling	,	kWh/kWh	10.9	10.6	9.9
SCOP		Heating (Average)			5.3	
Annual energy consu	umption	QCE		kWh/a	80	115	148
		QHE (Average)			658	939	1,109
ER COP		Cooling		kW/kW	5.95	5.15	4.77
Sensible capacity		Heating Cooling		kW	5.93 2.50	5.41 3.23	4.86
		Cooling			93.6	95.7	97.3
Power factor		Heating		- % -	95.0	96.0	97.6
Moisture removal		3		L/h (pints/h)	1.50 (2.6)	1.95 (3.4)	2.20 (3.9)
Aaximum operating	ourropt*1	Cooling		A	6.5	7.5	9.0
aximum operating o	current	Heating			9.5	12.5	15.5
			HIGH	4 4	800	830	890
			MED-HIGH	4 –	740	760	840
	Cooling	Cooling	MED MED—LOW			90 40	790 720
		Cooling					
				1 [5		
			LOW			80	640
	Airflow rate		QUIET HIGH	m ³ /h	3		
Fan	Airflow rate		QUIET	m ³ /h	3	80 50	640 440
-an	Airflow rate	Heating	QUIET HIGH MED—HIGH MED	m ³ /h	3 9 8 6	80 50 00 00 90	640 440 940 860 780
an	Airflow rate	Heating	QUIET HIGH MED—HIGH MED MED—LOW	m ³ /h	3 9 8 6 6 6	80 50 00 00 90 40	640 440 940 860 780 710
ian -	Airflow rate	Heating	QUIET HIGH MED—HIGH MED MED—LOW LOW	m³/h	3 9 8 6 6 6 5	80 50 00 00 90 40 80	640 440 940 860 780 710 640
an		Heating	QUIET HIGH MED—HIGH MED MED—LOW	m ³ /h	3 9 8 6 6 6 5	80 50 00 90 40 80 90	640 440 940 860 780 710
an	Type × Qty	Heating	QUIET HIGH MED—HIGH MED MED—LOW LOW		3 9 8 6 6 6 5	80 50 00 90 40 80 90 Crossflow fan × 1	640 440 940 860 780 710 640
an		Heating	QUIET HIGH MED—HIGH MED—LOW LOW QUIET	W	3 9 8 6 6 6 5	80 50 00 90 40 80 90 Crossflow fan × 1 61	640 440 940 860 780 710 640
an	Type × Qty	Heating	QUIET HIGH MED—HIGH MED MED—LOW LOW		3 9 8 6 6 5 2 2 42	80 50 00 90 40 80 90 Crossflow fan × 1	640 440 940 860 780 710 640 390
an	Type × Qty		QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED		3 9 8 6 6 5 2 2 42 42 42	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37	640 440 940 860 780 710 640 390 45 45 42 40
an	Type × Qty	Heating	QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—UOW		3 9 8 6 6 5 2 2 42 42 42	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37 35	640 440 940 860 780 710 640 390 45 42 40 38
⁻ an	Type × Qty		QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—HIGH MED LOW		3 9 8 6 6 5 5 2 2 42 42 42	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37 35 33	640 440 940 860 780 710 640 390 45 45 42 40 38 35
	Type × Qty Motor output		QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—LOW LOW QUIET		3 9 8 6 6 5 5 2 2 42 42 42 2 3 3 3 2 2 2	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37 35 33 23	640 440 940 860 780 710 640 390 45 42 42 40 38 38 35 26
	Type × Qty Motor output		QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH	W	3 9 8 6 5 2 2 42 42 42 42 42	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37 35 33 23 44	640 440 940 860 780 710 640 390 45 42 40 38 35 26 46
	Type × Qty Motor output	Cooling	QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH	W	3 9 8 6 6 5 2 2 2 42 42 42 42 42 42 42 42 42 42 42	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37 35 33 23 44 40	640 440 940 860 780 710 640 390 45 42 40 38 35 26 46 42
	Type × Qty Motor output		QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—HIGH	W	3 9 8 6 6 5 2 2 2 42 42 42 42 42 42 42 42 42 42 42	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37 35 33 23 44 40 36	640 440 940 860 780 710 640 390 45 42 40 38 35 26 46 42 39
	Type × Qty Motor output	Cooling	QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH	W	3 9 8 6 6 5 2 2 2 42 42 42 42 42 42 42 42 42 42 42	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37 35 33 23 44 40	640 440 940 860 780 710 640 390 45 42 40 38 35 26 46 42
	Type × Qty Motor output	Cooling	QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH HIGH MED—HIGH MED MED—LOW	W	3 9 8 6 5 2 2 42 42 42 42 42 42 42 42 42 42 42 42	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37 35 33 23 44 40 36 34 32 19	640 440 940 860 780 710 640 390 45 42 40 45 42 40 38 35 26 46 46 42 39 36 36 34 23
ound pressure leve	Type × Qty Motor output	Cooling Heating Cooling	QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—HIGH MED—LOW LOW QUIET	W dB (A)	3 9 8 6 6 5 2 2 2 42 42 42 42 42 42 42 42 57	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37 55 33 33 23 44 40 36 33 23 44 40 36 33 23 44 40 58	640 440 940 860 780 710 640 390 45 42 40 38 35 26 46 42 39 36 34 23 60
ound pressure leve	Type × Qty Motor output	Cooling	QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—LOW QUIET HIGH MED—HIGH MED—HIGH MED—HIGH MED—LOW LOW	W	3 9 8 6 5 2 2 42 42 42 42 42 42 42 42 42 42 42 42	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37 35 33 23 44 40 36 34 32 19 58 61 61 58 61 50 58 61 50 50 61 50 50 50 50 50 50 50 50 50 50	640 440 940 860 780 710 640 390 45 42 40 38 35 26 46 42 39 36 34 23 60
Sound pressure leve	Type × Qty Motor output	Cooling Heating Cooling Heating	QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—HIGH MED—HIGH MED—HIGH MED—LOW LOW QUIET HIGH	W dB (A)	3 9 8 6 6 5 2 2 2 42 42 42 42 42 42 42 42 57	80 50 50 60 60 90 40 80 90 Crossflow fan × 1 61 43 40 37 35 33 23 44 40 36 34 32 19 58 60 Main: 384 × 720 × 30.0	640 440 940 860 780 710 640 390 45 42 40 38 35 26 46 42 39 36 34 23 60
Sound pressure leve	Type × Qty Motor output	Cooling Heating Cooling	QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—HIGH MED—HIGH MED—HIGH MED—LOW LOW QUIET HIGH	W dB (A)	3 9 8 6 6 5 2 2 2 42 42 42 42 42 42 42 42 57	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37 35 33 23 44 40 36 34 36 34 36 34 36 36 34 36 36 36 36 36 36 36 37 36 36 36 36 37 36 36 36 37 36 36 37 36 36 37 36 36 37 36 36 37 36 36 37 36 36 37 36 36 37 36 36 36 36 36 36 36 36 36 36	640 440 940 860 780 710 640 390 45 42 40 38 35 26 46 42 39 36 34 23 60
Fan Sound pressure leve	Type × Qty Motor output	Cooling Heating Cooling Heating	QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—HIGH MED—HIGH MED—HIGH MED—LOW LOW QUIET HIGH	W dB (A)	3 9 8 6 6 5 2 2 2 42 42 42 42 42 42 42 42 57	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37 35 33 23 44 40 36 37 35 33 23 44 40 40 40 43 40 40 43 40 40 43 40 40 40 40 40 40 40 40 40 40	640 440 940 860 780 710 640 390 45 42 40 38 35 26 46 42 39 36 34 23 60
Sound pressure leve	Type × Qty Motor output	Cooling Heating Cooling Heating Dimensions (H ×	QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—HIGH MED—HIGH MED—HIGH MED—LOW LOW QUIET HIGH		3 9 8 6 6 5 2 2 2 42 42 42 42 42 42 42 42 57	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37 35 33 23 44 40 36 34 36 34 36 34 36 36 34 36 36 36 36 36 36 36 37 36 36 36 36 37 36 36 36 37 36 36 37 36 36 37 36 36 37 36 36 37 36 36 37 36 36 37 36 36 37 36 36 36 36 36 36 36 36 36 36	640 440 940 860 780 710 640 390 45 42 40 38 35 26 46 42 39 36 34 23 60
Sound pressure leve	Type × Qty Motor output	Cooling Heating Cooling Heating	QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—HIGH MED—HIGH MED—HIGH MED—LOW LOW QUIET HIGH		3 9 8 6 6 5 2 2 2 42 42 42 42 42 42 42 42 57	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37 55 33 23 44 40 36 37 35 33 23 44 40 36 37 36 37 36 37 36 37 36 37 36 37 36 37 36 37 36 37 36 37 36 37 36 37 36 37 36 37 36 36 37 36 36 37 36 36 37 36 36 37 36 36 36 36 36 36 36 36 36 36	640 440 940 860 780 710 640 390 45 42 40 38 35 26 46 42 39 36 34 23 60
Sound pressure leve	Type × Qty Motor output	Cooling Heating Cooling Heating Dimensions (H × Fin pitch	QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—HIGH MED—HIGH MED—HIGH MED—LOW LOW QUIET HIGH	dB (A)	3 9 8 6 6 5 2 2 2 42 42 42 42 42 42 42 42 57	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37 35 33 23 44 40 36 34 32 19 58 61 43 44 40 36 33 23 44 40 36 36 36 36 37 36 36 37 37 37 37 37 37 37 37 37 37	640 440 940 860 780 710 640 390 45 42 40 38 35 26 46 42 39 36 34 23 60
Sound pressure leve	Type × Qty Motor output	Cooling Heating Cooling Heating Dimensions (H ×	QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—HIGH MED—HIGH MED—HIGH MED—LOW LOW QUIET HIGH	dB (A)	3 9 8 6 6 5 2 2 2 42 42 42 42 42 42 42 42 57	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37 35 33 33 33 33 44 40 36 37 35 33 33 33 33 33 44 40 40 40 40 43 40 43 40 40 43 44 40 43 40 43 44 40 43 40 43 40 43 44 40 43 40 58 61 43 44 40 58 61 43 44 40 58 61 43 44 40 58 61 43 44 45 45 58 61 44 45 45 45 45 45 45 45 45 45	640 440 940 860 780 710 640 390 45 42 40 38 35 26 46 42 39 36 34 23 60
Sound pressure leve	Type × Qty Motor output	Cooling Heating Cooling Heating Dimensions (H × Fin pitch	QUIET HIGH MED—HIGH MED—LOW LOW QUIET HIGH MED—HIGH MED—HIGH MED—HIGH MED—HIGH MED—LOW LOW QUIET HIGH	dB (A)	3 9 8 6 6 5 2 2 2 42 42 42 42 42 42 42 42 57	80 50 00 00 90 40 80 90 Crossflow fan × 1 61 43 40 37 35 33 23 44 40 36 34 32 19 58 61 43 44 40 36 36 34 36 36 34 36 36 37 58 61 58 58 61 58 58 61 58 58 61 58 58 58 58 58 58 58 58 58 58	640 440 940 860 780 710 640 390 45 42 40 38 35 26 46 42 39 36 34 23 60

Туре			Wall mounted Inverter, Heat pump			
туре						
Model name			RSH09KHCBN	RSH12KHCBN	RSH14KHCBN	
	Material				Polystyrene	
Enclosure	Color			White Approximate color of Munsell N9.25/		
Dimensions	Net				295 × 894 × 280	
$(H \times W \times D)$	Gross		mm		360 × 990 × 370	
Moight	Net	Net		14.5		
Veight	Gross	Gross		18.0		
	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)		
Connection pipe	Size	Gas			Ø9.52 (Ø3/8)	
	Method	Method		Flare		
Drain hose	Material			Polypropylene + Linear low-density polyethylene		yethylene
Jiain nose	Tip diameter		mm	Ø	Ø13.8 (I.D.), Ø15.8 to Ø16.7 (O.D.)	
	Cooling		°C	18 to 32		
Operation range	Cooling		%RH	80 or less		
	Heating		°C	16 to 30		
Remote controller type			Wireless (Option: Wired, Mobile app* ³ [AIRSTAGE Mobile])			
NOTES:				•		

NOTES:

Specifications are based on the following conditions:

- Cooling: Indoor temperature of 27°CDB/19°CWB, and outdoor temperature of 35°CDB/24°CWB.

- Heating: Indoor temperature of 20°CDB/15°CWB, and outdoor temperature of 7°CDB/6°CWB.

- Pipe length: 5.0 m, Height difference: 0 m. (Between outdoor unit and indoor unit.)

· Protective function might work when using it outside the operation range.

• *1: Maximum operating current is the total current of the indoor unit and the outdoor unit.

• *2: Sound pressure level:

_ Measured values in manufacturer's anechoic chamber.

Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
 *³: Available on Google Play[™] store or on App Store[®].
 This data is based on EN 14511 standard.

1-2. Outdoor unit

Туре			Inverter, Heat pump				
Model name				ROH09KHCBN	ROH12KHCBN	ROH14KHCBN	
Power supply				230 V~ 50 Hz			
Power supply intake				Outdoor unit			
Available voltage rang	e			207—253 V			
Starting current			A	2.5	3.4	5.0	
•		Cooling	0	1,850	2,630	2,530	
_	Airflow rate	Heating	m ³ /h	1,690	2,140	2,070	
Fan	Type × Qty	0			Propeller fan × 1		
	Motor output		W		49		
		Cooling		44	48	51	
Sound pressure level*		Heating	dB (A)	44	4	9	
		Cooling		57	61	64	
Sound power level		Heating	dB (A)	55	59	60	
						Main 1: 672 × 873 × 18.19	
		Dimensions		Main 1: 588 × 881 × 18.19	Main 1: 672 × 881 × 18.19	Main 2: 672 × 845 × 18.19	
		$(H \times W \times D)$		Main 2: 588 × 851 × 18.19	Main 2: 672 × 851 × 18.19	Main 3: 672 × 784 × 18.19	
			mm			Main 1: 1.45	
		Fin pitch		Main 1: 1.30	Main 1: 1.30	Main 2: 1.45	
				Main 2: 1.30	Main 2: 1.30	Main 3: 1.45	
Heat exchanger type						Main 1: 1 × 32	
		Rows × Stages		Main 1: 1 × 28	Main 1: 1 × 32	Main 2: 1 × 32	
		Nows & Otages		Main 2: 1 × 28	Main 2: 1 × 32	Main 3: 1 × 32	
		Pipe type			Copper tube	Wall 5. 1 * 52	
		Type (Material)			Aluminum		
		Fin type	Fin type Surface treatment		PC fin		
		Туре			DC rotary		
Compressor		Motor output	W			1.060	
		Туре	**	925 R32 (675)		1,000	
Refrigerant		Charge				1,390	
		Туре	g	1,220	RmM68AF	1,390	
Refrigerant oil		Amount	cm ³		400		
			cm ³				
		Material		Steel sheet			
Enclosure		Color		Beige			
			1	Approximate color of Munsell 10YR 7.5/1.0			
Dimensions		Net	mm	632 × 799 × 290	716 × 82		
$(H \times W \times D)$		Gross		692 × 940 × 375	776 × 96		
Weight		Net	kg	39	42	45	
5		Gross	3	43	47	50	
	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)			
		Gas	()	Ø9.52 (Ø3/8)			
	Method			Flare			
Connection pipe	Pre-charge length				15		
	Max. length		m	20			
	Max. height difference				15		
	Max. height difference		g/m	20			
Operation range		Cooling	°C		-10 to 50		
Operation range		Heating	Ŭ	-30 to 24			

Operation range

NOTES:

Specifications are based on the following conditions:
 Cooling: Indoor temperature of 27°CDB/19°CWB, and outdoor temperature of 35°CDB/24°CWB.
 Heating: Indoor temperature of 20°CDB/15°CWB, and outdoor temperature of 7°CDB/6°CWB.
 Pipe length: 5.0 m, Height difference: 0 m. (Between outdoor unit and indoor unit.)

Protective function might work when using it outside the operation range.
 *: Sound pressure level

- Measured values in manufacturer's semi-anechoic chamber.

- Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.


2. Dimensions


GENERAL INFORMATION


2-1. Indoor unit

Models: RSH09KHCBN, RSH12KHCBN, and RSH14KHCBN

Unit: mm

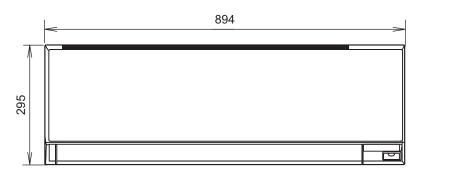



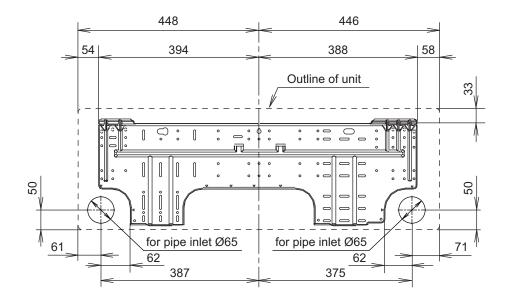


Installation space requirement

Provide sufficient installation space for product safety.

Unit: mm


IATION

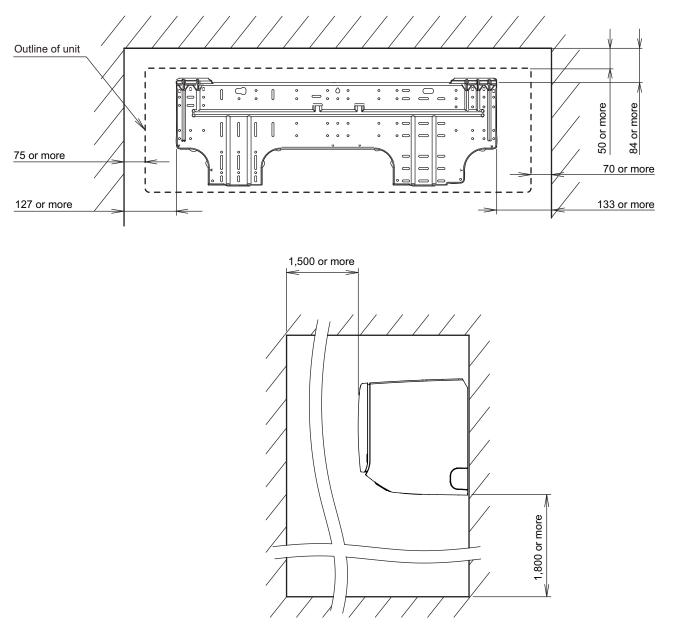

Pipe exit length from the rear

Design the system considering the length of the pipes or hose exiting from the rear of the indoor unit.

NOTE: Detailed shapes of the indoor unit and the tip of each pipe or hose may vary depending on the model.

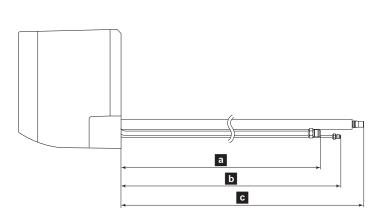

		Approximate length	
Model name	a Gas pipe	Liquid pipe	c Drain hose
RSH09–14KHCBN	615	660	420


Unit: mm

GENERAL INFORMATION


MERAL MATION

2-2. Outdoor unit Model: ROH09KHCBN

Unit: mm

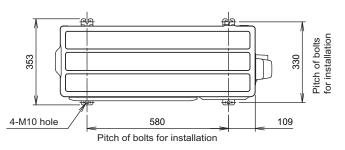

Top view

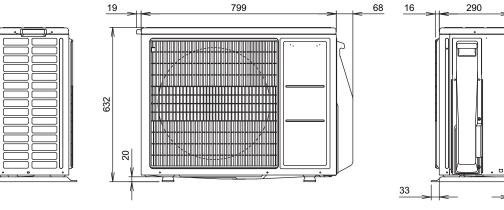


Side view


Front view



30



Bottom view




Side view (Valve part)

Models: ROH12KHCBN and ROH14KHCBN

Unit: mm

ENERAL VFORMATION

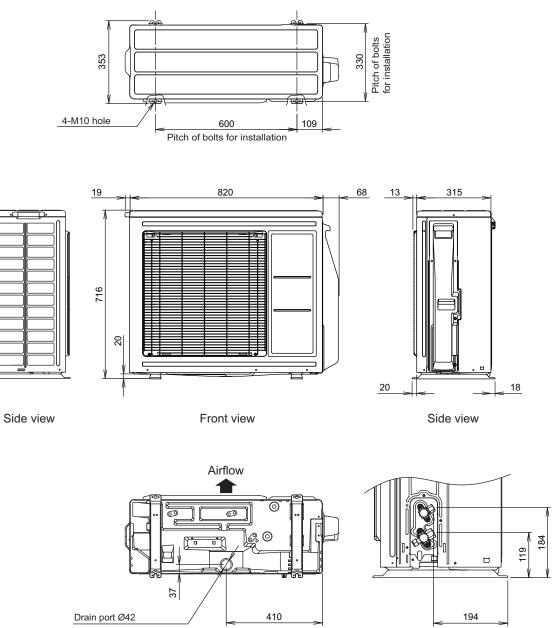

Bottom view

Side view (Valve part)



2. TECHNICAL DATA AND PARTS LIST

CONTENTS

2. TECHNICAL DATA AND PARTS LIST

1. Precautions	02-1
2. Indoor unit parts list	02-2
2-1. Models: RSH09KHCBN, RSH12KHCBN, and RSH14KHCBN	
3. Outdoor unit parts list	02-6
3-1. Model: ROH09KHCBN	
3-2. Models: ROH12KHCBN and ROH14KHCBN	
4. Accessories	02-14
4-1. Indoor unit	02-14
4-2. Outdoor unit	02-14
5. Optional parts	02-15
5-1. Indoor unit	
6. Refrigerant system diagrams	02-17
6-1. Models: ROH09KHCBN and ROH12KHCBN	
6-2. Model: ROH14KHCBN	02-18
7. Wiring diagrams	02-19
7-1. Models: RSH09KHCBN, RSH12KHCBN, and RSH14KHCBN	
7-2. Models: ROH09KHCBN, ROH12KHCBN, and ROH14KHCBN	02-20
8. PC board diagrams	02-21
8-1. Models: RSH09KHCBN, RSH12KHCBN, and RSH14KHCBN	
8-2. Models: ROH09KHCBN, ROH12KHCBN, and ROH14KHCBN	02-22


1. Precautions

When you start servicing, pay attention to the following points. For detailed precautions, refer to the installation manual of the products.

- Service personnel
 - Any person who is involved with working on or breaking into a refrigerant circuit should hold a current valid certificate from an industry-accredited assessment authority, which authorizes their competence to handle refrigerants safely in accordance with an industry recognized assessment specification.
 - Servicing shall only be performed as recommended by the equipment manufacturer. Maintenance and repair requiring the assistance of other skilled personnel shall be carried out under the supervision of the person competent in the use of flammable refrigerants.
 - Servicing shall be performed only as recommended by the manufacturer.
- Work
 - Prior to beginning work on systems containing flammable refrigerants, safety checks are necessary to ensure that the risk of ignition is minimized. When repairing the refrigerant system, refer to the precautions written in the installation manual of the products before you start servicing.
 - Work shall be undertaken under a controlled procedure so as to minimize the risk of a flammable gas or vapor being present while the work is being performed.
 - All maintenance staff and others working in the local area shall be instructed on the nature of work being carried out.
 - Work in confined spaces shall be avoided.
 - The area around the workspace shall be sectioned off.
 - Ensure that the conditions within the area have been made safe by control of flammable material.
 - Electric shock may occur. After turning off the power, always wait 5 minutes before touching electrical components.
 - Do not touch the fins of the heat exchanger. Touching the heat exchanger fins could result in damage to the fins or personal injury such as skin rupture.
 - Do not place any other electrical products or household belongings under the product.
 - Condensation dripping from the product might get them wet, and may cause damage or malfunction to the property.
- Checking for presence of refrigerant
 - The area shall be checked with an appropriate refrigerant leak detector prior to and during work, to ensure the technician is aware of potentially flammable atmospheres.
 - Ensure that the leak detector being used is suitable for use with flammable refrigerants, i.e. non-sparking, adequately sealed or intrinsically safe.
- Service parts information and design are subject to change without notice for product improvement.
- For the latest information of the service parts, refer to our Service Portal. https://fujitsu-general.force.com/portal/
- Precise figure of the service parts listed in this manual may differ from the actual service parts.

2. Indoor unit parts list

2-1. Models: RSH09KHCBN, RSH12KHCBN, and RSH14KHCBN

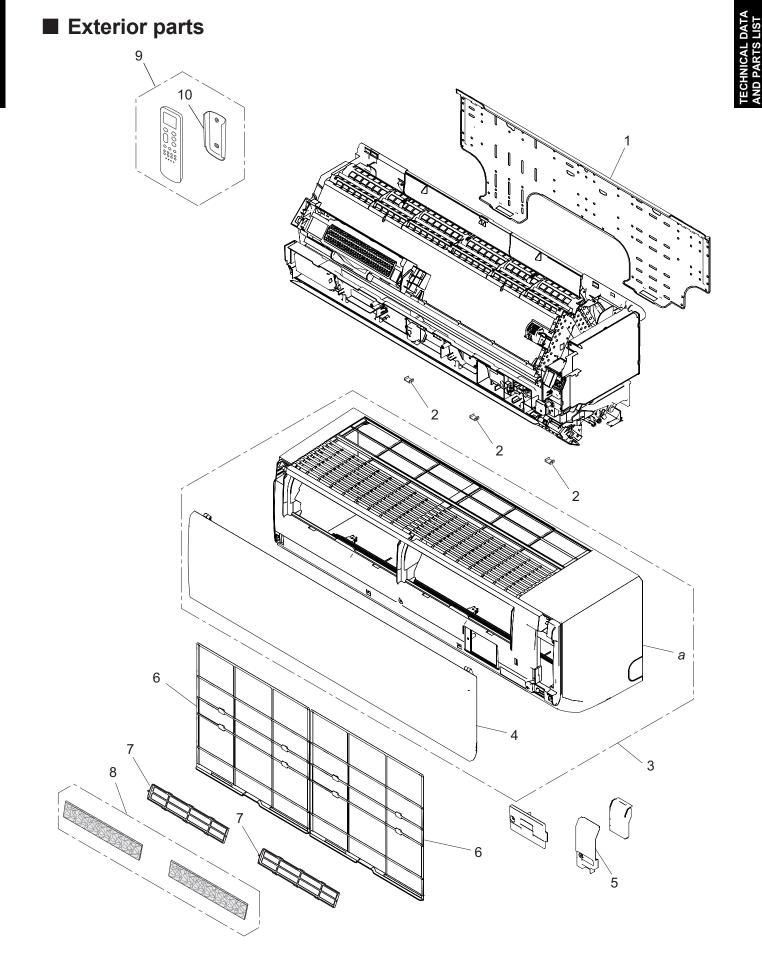


Item no.	Part no.	Part name	Service part
1	9318861020	Bracket panel	•
2	9309002074	Screw cover	•
3	9320460082	Front panel sub assy	•
4	9300454025	Intake grille assy	•
5	9318786002	Wire cover	•
6	9300394000	Air filter	•
7	9332911008	Filter holder	•
8	9300450003	Air cleaning filter assy	•
9	9359743026	Remote controller total assy	•
10	9350319008	Remote controller holder	•
а	_	Front panel	—

TECHNICAL DATA AND PARTS LIST

Chassis

TECHNICAL DATA AND PARTS LIST

I

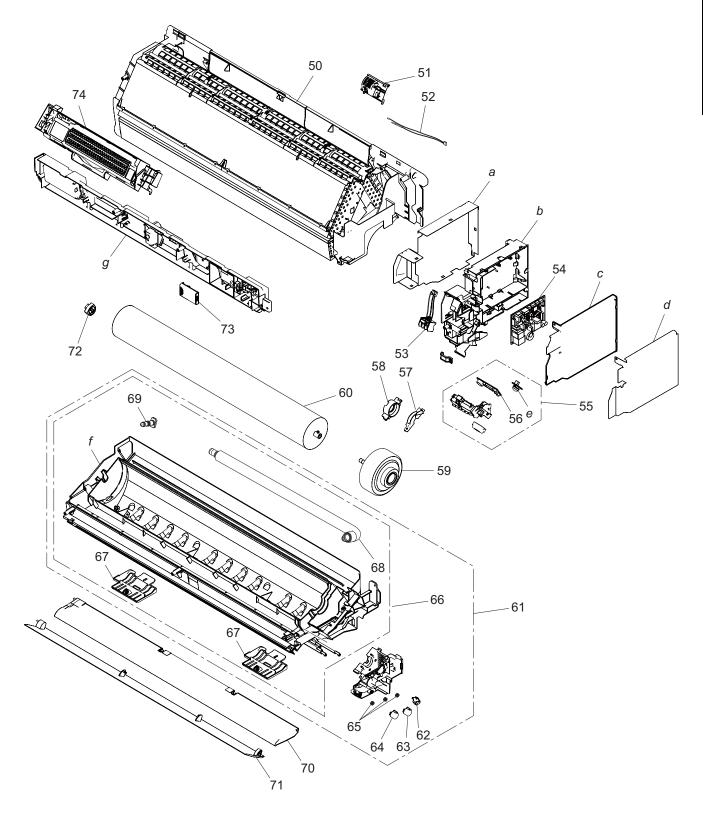


ltem no.	Part no.	Part name	Service part
50	9323532175	Evaporator total assy	•
51	9379930000	Room thermistor holder	•
52	9901160059	Thermistor assy	•
53	9900720094	Terminal 3P	•
	9712386006	Main PCB (09 model)	•
54	9712386013	Main PCB (12 model)	•
-	9712386020	Main PCB (14 model)	•
55	9712392007	Display assy	•
56	9712344006	Indicator PCB	•
57	9316601000	Motor cover	•
58	9316568006	Motor cover	•
59	9603253073	DC fan motor	•
60	9315024060	Crossflow fan assy	•
61	9319171357	Casing total assy	•
62	9900139230	Stepping motor (Left and right)	•
63	9901011122	Stepping motor (Diffuser)	•
64	9901011115	Stepping motor (Up and down)	•
65	9309994003	Gear A	•
66	9319172101	Casing assy	•
67	9318743029	Pipe bracket	•
68	9316904019	Drain hose assy	•
69	9316177017	Drain cap	•
70	9319232133	Diffuser assy	•
71	9318849011	Horizontal louver	•
72	9306628024	Bearing C assy	•
73	9300506007	Wireless LAN adapter sub assy	•
74	9321744136	Air cleaner assy	•
	9901169021	Wire with connector	•
		(CN75 on Main PCB—WLAN adapter) Box shield	
a			
b		Control box	
C		Control cover	
d		Cover shield	
e		Pyroelectric sensor	
f		Casing	
g	—	Panel case assy	

3. Outdoor unit parts list




Exterior parts and Chassis

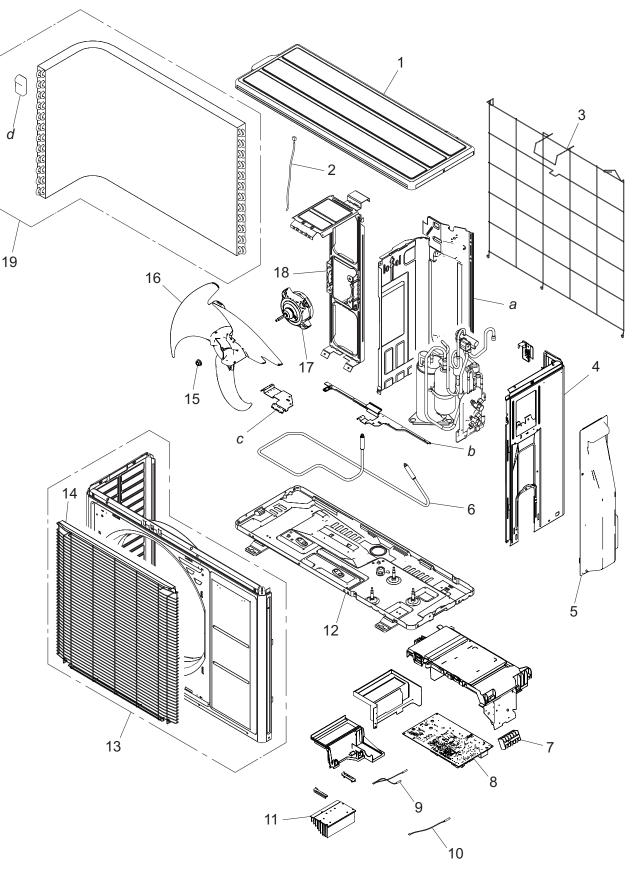

ltem no.	Part no.	Part name	Service part
1	9322556066	Top panel assy	•
2	9900565060	Thermistor (Outdoor temp.)	•
3	9377854025	Protective net	•
4	9322552099	Cabinet right assy	•
5	9322570024	Switch cover assy	•
6	9901059025	Base pan heater	•
7	9901070013	Terminal 6P	•
8	9709688953	Main PCB	•
9	9900935054	Thermistor assy	•
10	9901054037	Thermistor (Heat exchanger)	•
11	9322420053	Heat sink	•
12	9323550032	Base assy	•
13	9384851000	Front panel assy	•
14	9384273017	Fan guard	•
15	0700103070	Nut	•
16	9322150004	Propeller fan	•
17	9604091001	Fan motor	•
18	9322553331	Motor bracket assy	•
19	9323834835	Heat exchanger unit	•
а	—	Separator	—
b	—	Heater holder A	—
С	—	Heater holder B	—
d	—	Hair pin cushion	—

TECHNICAL DATA AND PARTS LIST

Compressor

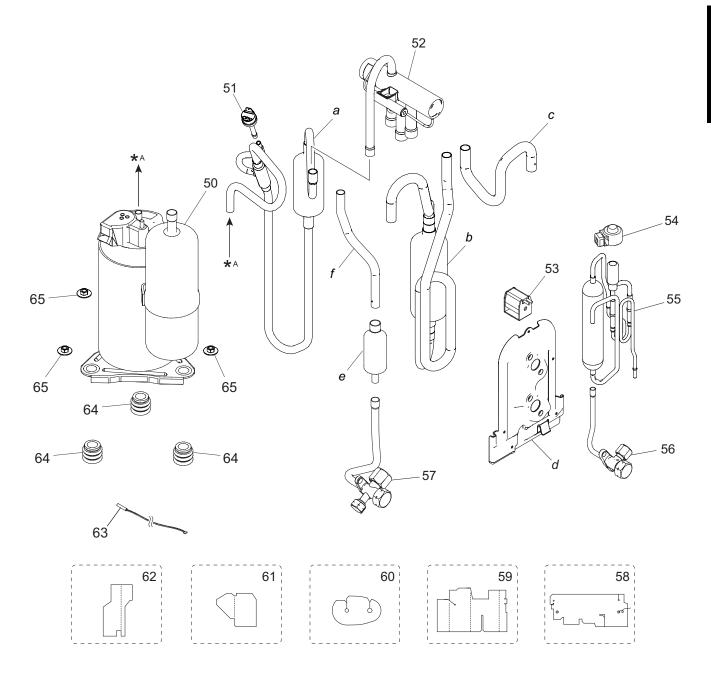


ltem no.	Part no.	Part name	Service part
50	9810523006	Compressor assy	•
51	9900186029	Pressure switch	•
52	9970210006	4-way valve	•
53	9970110160	Solenoid	•
54	9970222016	Expansion valve coil	•
55	9322462015	Pulse motor valve assy	•
56	9322474001	2-way valve assy	•
57	9322850010	3-way valve assy	•
58	9324014014	Sound insulator B	•
59	9322847003	Sound insulator F	•
60	9322501004	Sound insulator H	•
61	9323045002	Sound insulator V	•
62	9322824004	Sound insulator K	•
63	9900985011	Thermistor (Compressor temp.)	•
64	9322386007	Rubber cushion	•
65	9313437008	Special nut (M8)	•
	0000024040	Wire with connector (Fuse holder)	
_	9900934040	(P50 on Main PCB—Base pan heater)	•
а		Discharge pipe sub assy	
b	<u> </u>	Suction pipe assy	
С	<u> </u>	Joint pipe (Condenser)	
d	<u> </u>	Valve bracket	
е	<u> </u>	Muffler	
f	<u> </u>	Joint pipe (3-way valve)	

TECHNICAL DATA AND PARTS LIST

3-2. Models: ROH12KHCBN and ROH14KHCBN


Exterior parts and chassis

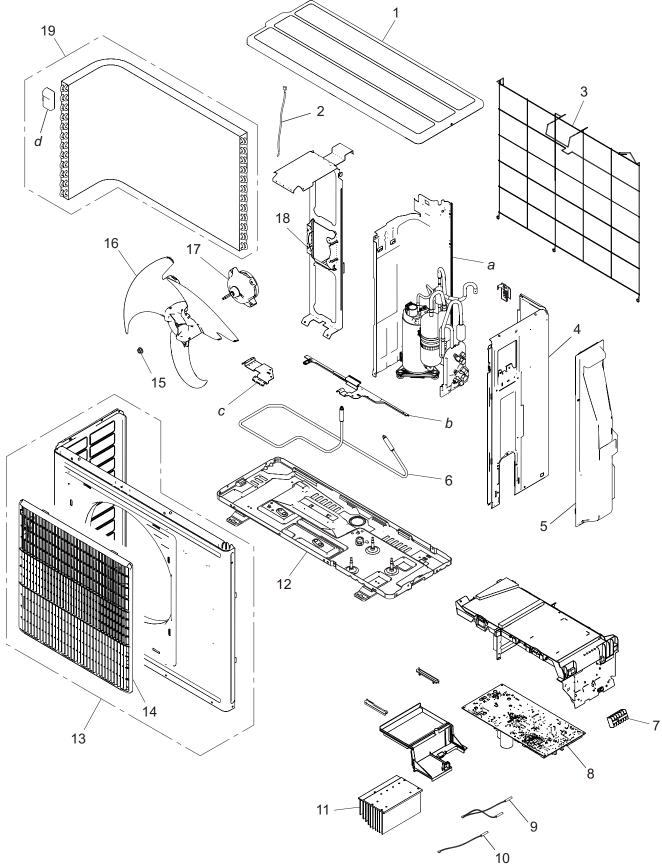

ECHNICAL DATA ND PARTS LIST

ltem no.	Part no.	Part name	Service part
1	9322556073	Top panel assy	•
2	9900565060	Thermistor (Outdoor temp.) (12 model)	•
Z	9900565138	Thermistor (Outdoor temp.) (14 model)	•
3	9334053003	Protective net assy (12 model)	•
3	9334053010	Protective net assy (14 model)	•
4	9322552334	Cabinet right assy	•
5	9322570031	Switch cover assy	•
6	9900350017	Base pan heater	•
7	9901070013	Terminal 6P	•
8	9709688960	Main PCB (12 model)	•
0	9709688977	Main PCB (14 model)	•
9	9900935061	Thermistor assy	•
10	9901054037	Thermistor (Heat exchanger)	•
11	9322421067	Heat sink	•
12	9323920002	Base assy	•
13	9322555304	Front panel assy	•
14	9384273017	Fan guard	•
15	0700103070	Nut	•
16	9322150004	Propeller fan	•
17	9604091001	DC fan motor	•
18	9322553218	Motor bracket assy (12 model)	•
18	9322553317	Motor bracket assy (14 model)	•
19	9323834842	Heat exchanger unit (12 model)	•
19	9323834859	Heat exchanger unit (14 model)	•
а	—	Separator	—
b	—	Heater holder A	—
С	—	Heater holder B	—
d	_	Hair pin cushion	—

Compressor

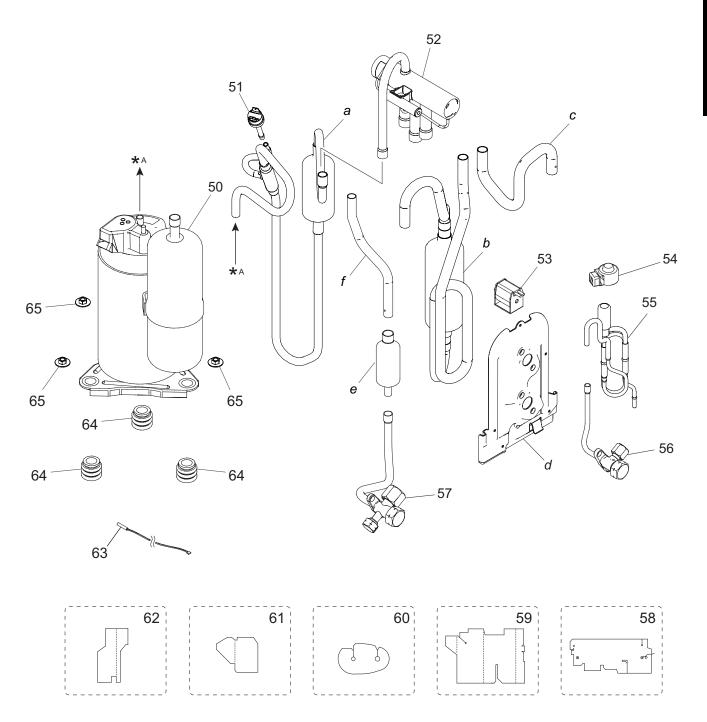

ltem no.	Part no.	Part name	Service part
50	9810523006	Compressor (12 model)	•
50	9810521002	Compressor (14 model)	•
51	9900186029	Pressure switch	•
52	9970210006	4-way valve	•
53	9970110160	Solenoid	•
54	9970222016	Expansion valve coil	•
55	9322462015	Pulse motor valve assy (09 and 12 models)	•
55	9322463029	Pulse motor valve assy (14 model)	•
56	9322474001	2-way valve assy	•
57	9322850010	3-way valve assy	•
58	9324014014	Sound insulator B	•
59	9322529008	Sound insulator F	•
60	9322501004	Sound insulator H	•
61	9323045002	Sound insulator V	•
62	9322824004	Sound insulator K	•
63	9900985011	Thermistor (Compressor temp.)	•
64	9322386007	Rubber cushion	•
65	9313437008	Special nut (M8)	•
	0000024040	Wire with connector (Fuse holder)	
—	9900934040	(P50 on Main PCB—Base pan heater)	•
_	9710542015	Wire assy (Pressure switch)	•
а	_	Discharge pipe sub assy	
b	—	Suction pipe assy	—
С	—	Joint pipe (Condenser)	—
d	—	Valve bracket	—
е	—	Muffler	—
f	_	Joint pipe (3-way valve)	—

TECHNICAL DATA AND PARTS LIST

4. Accessories

4-1. Indoor unit

ECHNICAL DATA ND PARTS LIST

Models: RSH09KHCBN, RSH12KHCBN, and RSH14KHCBN

Part name	Exterior	Qty	Part name	Exterior	Qty
Operation manual		1	Self-tapping screw (Large)	Dunnin	5
Installation manual		1	Self-tapping screw (Small)	()))))>	2
Remote controller		1	Wall hook bracket		1
Remote controller holder		1	Cloth tape	0	1
Air cleaning filter		2	Battery		2
Filter holder		2			

4-2. Outdoor unit

Models: ROH09KHCBN, ROH12KHCBN, and ROH14KHCBN

Part name	Exterior	Qty	Part name	Exterior	Qty
Installation manual		1			

5. Optional parts

5-1. Indoor unit

Controllers

TECHNICAL DATA AND PARTS LIST

Exterior	Part name	Model name	Summary
Office 01: Col 26.00 Room Terry: 28.00 Boom Terr	Wired Remote Controller	UTY-RNRXZ*	Easy finger touch operation with LCD panel. Backlit LCD enables easy operation in a dark room. Wire type: Non-polar 2-wire
	Wired Remote Controller	UTY-RLRX	High visibility and easy operation. Room temperature can be accurately controlled using the thermo sensor. Wire type: Non-polar 2-wire
	Compact Wired Remote Controller	UTY-RCRXZ1	Compact body and easy operation. Room temperature can be accurately controlled using the thermo sensor. Wire type: Non-polar 2-wire
	Simple Remote Controller	UTY-RSRX	Compact remote controller concentrates on the basic functions such as Start/Stop, fan control, temperature setting, and operation mode. Wire type: Non-polar 2-wire

NOTES:

- Available functions may differ by the remote controller. For details, refer to the operation manual.
- When using the group controlling system of the Wired Remote Controller, using WLAN Adapter is prohibited.

TECHNICAL DATA AND PARTS LIST Exterior

Model name


Summary

Part name

Air Cleaning Filter	UTR-FA16-5	Air Cleaning Filter can be mounted to the indoor unit.
External Connect Kit	UTY-XWZX	Use to connect with various peripheral devices and air conditioner PCB. Connecting point: CN46 and CN47 on Main PCB
External Connect Kit	UTY-XWZXZ5	Required when external device is connected. Connecting point: CN46 and CN47 on Main PCB
External Input and Output PCB	UTY-XCSXZ3	Use to connect with external devices and air conditioner PCB. Optional External Connect Kit is necessary for installation. Connecting point: CN65 on Main PCB
Communication Kit	UTY-TWRXZ4	Use to connect Non-polar 2-core wired remote controller.
Modbus Converter	UTY-VMSX	For connection between indoor unit with UART interface and a Modbus open network. Connecting point: CN65 on Main PCB
KNX Convertor	UTY-VKSX	For connection between indoor unit with UART interface and a KNX open network. Connecting point: CN65 on Main PCB
Network Converter	UTY-VTGX	This converter is required when connecting single split system to VRF network system. Connecting point: CN13 via Communication Kit
Network Converter (AC power supply)	UTY-VTGXV	This converter is required when connecting single split system to VRF network system. Connecting point: CN13 via Communication Kit
External Switch Controller	UTY-TERX	Air conditioner switching can be controlled by connecting other external sensor switches. Connecting point: CN13 via Communication Kit


6. Refrigerant system diagrams

6-1. Models: ROH09KHCBN and ROH12KHCBN

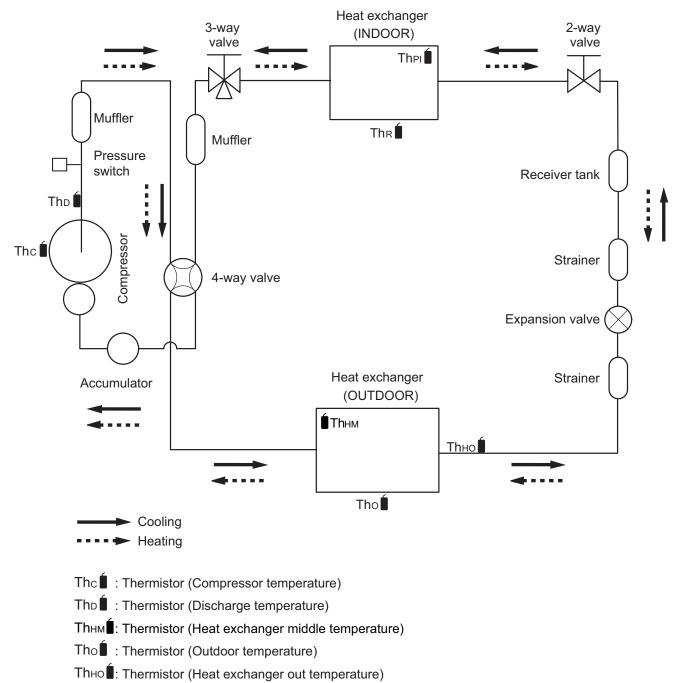

- The **i** : Thermistor (Pipe temperature)
- Thr : Thermistor (Room temperature)


6-2. Model: ROH14KHCBN

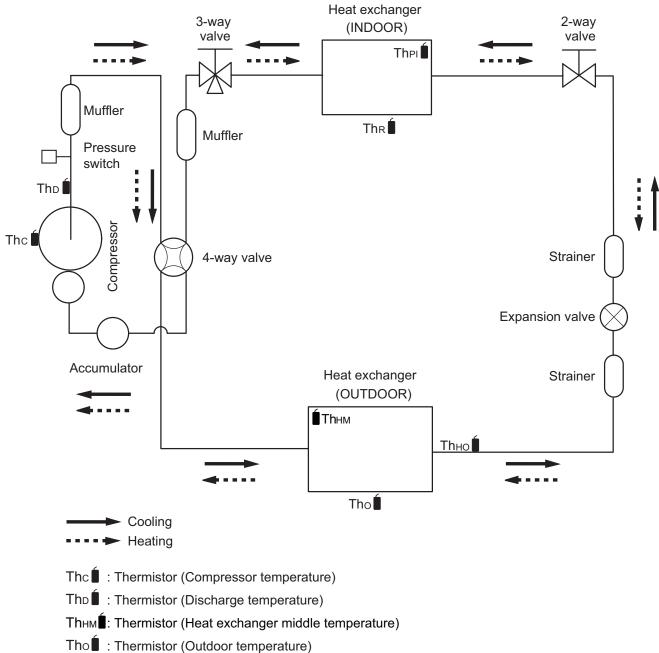


- Тhно : Thermistor (Heat exchanger out temperature)
- The **i** : Thermistor (Pipe temperature)
- Th_R : Thermistor (Room temperature)

7. Wiring diagrams

7-1. Models: RSH09KHCBN, RSH12KHCBN, and RSH14KHCBN

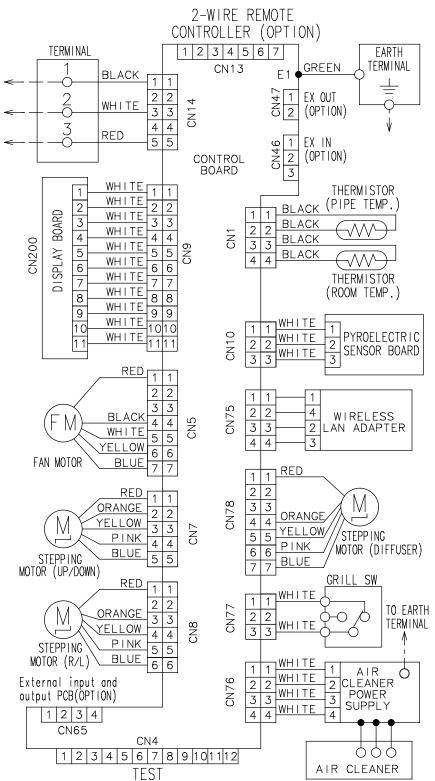

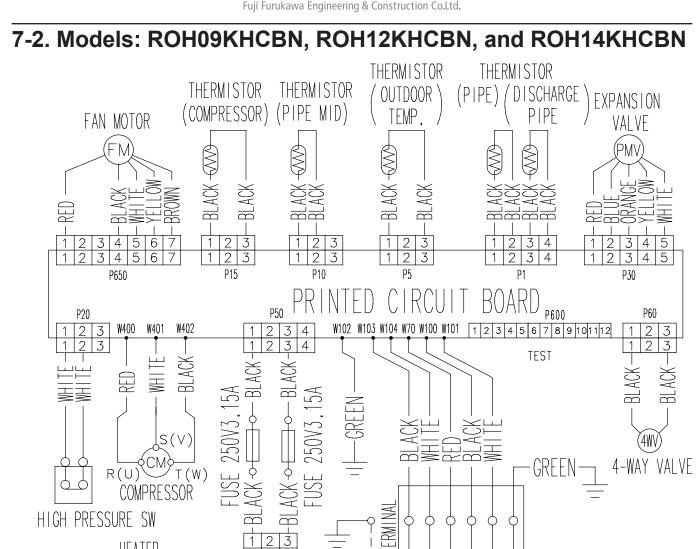

2 3

iL

i1

TO INDOOR UNIT

1

i (ίN

TO POWER SUPPLY

3 2 1

1

BLACK

HEATER


THERMOSTAT (55℃)

BLÁCK

BLACK

8. PC board diagrams

8-1. Models: RSH09KHCBN, RSH12KHCBN, and RSH14KHCBN

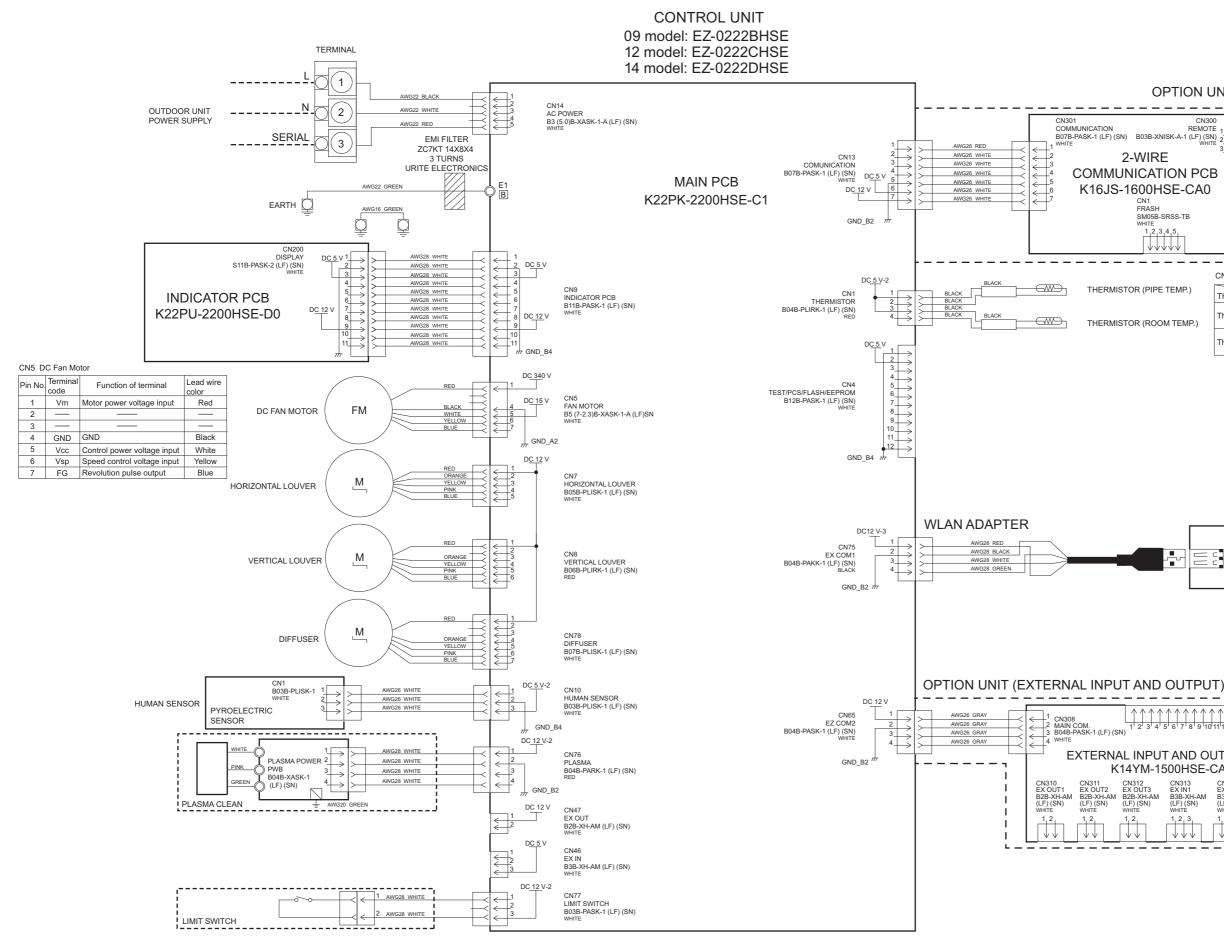

OPTION UNIT (2-WIRE REMOTE CONTROLLER) CN300 REMOTE AWG22 RED REMOTE Ø B03B-XNISK-A-1 (LF) (SN) AWG22 WHITE H CONTROLLER (2-WIRE) 2-WIRE EMI FILTER COMMUNICATION PCB ZCAT1518-0730 2 TURNS K16JS-1600HSE-CA0 CN1 FRASH SM05B-SRSS-TB WHITE 1,2,3,4,5 $\downarrow \downarrow \downarrow \downarrow \downarrow \downarrow \downarrow$ CN1 Thermistor Characteristics THERMISTOR (PIPE TEMP.) Temperature 30°C 0°C 20°C 176.03 kΩ 62.91 kΩ 39.57 kΩ hermistor (Pipe temp.) 2.79 V

		WLAN ADAPTER
J∎J	(4 BLACK) (3 GREEN) (2 WHITE) (1 RED)	J2 AP-WH3E-B WHITE

FLASH B12B-PASK-1 (LF) (SN WHITE 3 4 5 6 7 8 9 10 11 12 EXTERNAL INPUT AND OUTPUT PCB K14YM-1500HSE-CA0 CN312 EX OUT3 B2B-XH-AM (LF) (SN) WHITE CN313 EX IN1 B3B-XH-AM (LF) (SN) WHITE CN314 EX IN2 B3B-XH-AM (LF) (SN) WHITE

8 PC board diagrams

THERMISTOR (ROOM TEMP.) 1.10 V 2.21 V 33.62 kΩ 12.54 kΩ 8.04 kΩ hermistor (Room temp.) 1.15 V 2.22 V 2.77 V

FECHNICAL DATA AND PARTS LIST

8-2. Models: ROH09KHCBN, ROH12KHCBN, and ROH14KHCBN

Q

FRAME

Q

FRAME

AWG22 BLACK

AWG22 WHITE

AWG22 RED

AWG14 BLACK

AWG14 WHITE

AWG16 GREEN

BLACK

BLACK

BLACK

BI ACK

BLACK

BLACK

-75-

BLACK

đ

THERMISTOR (DISCHARGE TEMP.)

THERMISTOR (OUTDOOR TEMP.)

THERMISTOR (PIPE MID. TEMP.)

THERMISTOR (COMPRESSOR TEMP.)

HIGH PRESSURE SWITCH

W103 B

W104

В

W70 B

W100

B

W101 В

W102 B

2

⊢ = |

DC 5 V-2

RED

WHITE

P10

BLUE

DC 5 V

GND CPU


B04B-PLIRK-1 (LF) (SN)

B03B-PLISK-1 (LF) (SN)

B03B-PLIEK-1 (LF) (SN)

P15 B03B-PASK-1 (LF) (SN)

B03B-XNISK-A-1 (LF) (SN)

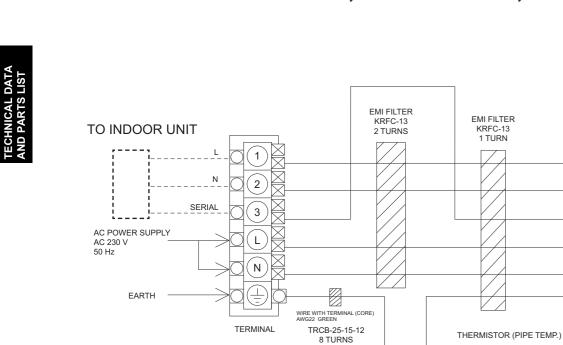



Thermistor	0°C	20°C	30°C
Thermistor (Pipe temp.)	16.05 kΩ 1.14 V	5.98 kΩ 2.21 V	3.84 kΩ 2.77 V
Thermistor (Discharge temp.)	168.60 kΩ 0.36 V	62.55 kΩ 0.86 V	40.01 kΩ 1.23 V

P5 Thermistor Characteristics.

Temperature	0°C	20°C	30°C
Thermistor (Outdoor temp.)	35.21 kΩ	12.64 kΩ	7.97 kΩ
	2.61 V	3.76 V	4.14 V


P10 Thermistor Characteristics.

Temperature	0°C	20°C	30°C
Thermistor (Pipe mid temp.)	16.05 kΩ 1.14 V	5.98 kΩ 2.21 V	3.84 kΩ 2.77 V

P15	Thermistor C	characteristics.	
		Temperature	0.00

Temperature	0°C	20°C	30°C
Thermistor (Compressor temp.)	168.60 kΩ	62.55 kΩ	40.01 kΩ
	0.36 V	0.86 V	1.23 V






Contact: Short ⇒ Open 4.2 to 4.05 MPa Contact: Open ⇒ Short 3.2±0.15 MPa




09 model: EZ-02207HUE 12 model: EZ-02208HUE

14 model: EZ-02209HUE B2P3-VH-B (LF) (SN)







P650 B5 (7-2.3) B-XASK-1-A (LF) SN

W400 В

W401 B

W402

B


DC XXX V

DC 15 V

GND-FAN


DC 12 V

-



B2P (4-2.4) -VH-B-C (LF) (SN)

3 -

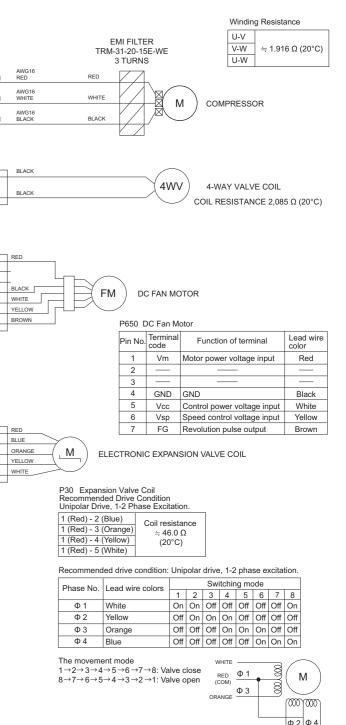





ECHNICAL DAT



CONTENTS

1. Error code	03-1
1-1. How to check the error memory	03-1
1-2. How to erase the error memory	03-1
1-3. Error code table (Indoor unit and wired remote controller)	03-2
1-4. Error code table (Wireless LAN indicator)	03-4
1-5. How to check the error code on Mobile app	
1-6. Error code table (Mobile app)	03-6
1-7. Error message for wireless LAN control (Mobile app)	03-8
1-8. Errors indicated by the Plasma air clean indicator	
2. Troubleshooting with error code	03-23
2-1. E: 11. Serial communication error (Serial reverse transfer error) (Outdoor unit)	03-23
2-2. E: 11. Serial communication error (Serial forward transfer error) (Indoor unit)	03-25
2-3. E: 12. Wired remote controller communication error (Indoor unit)	03-27
2-4. E: 18. External communication error (Indoor unit)	03-28
2-5. E: 22. Indoor unit capacity error (Indoor unit)	03-29
2-6. E: 23. Combination error (Outdoor unit)	03-30
2-7. E: 26. Address setting error in wired remote controller (Indoor unit)	03-31
2-8. E: 29. Connected unit number error (Indoor unit)	03-32
2-9. E: 32. Indoor unit main PCB error (Indoor unit)	
2-10. E: 33. Indoor unit motor electricity consumption detection error (Indoor unit)	03-34
2-11. E: 35. MANUAL AUTO button error (Indoor unit)	03-35
2-12. E: 39. Indoor unit power supply error for fan motor (Indoor unit)	03-36
2-13. E: 3A. Indoor unit communication circuit (wired remote controller) error	03-37
2-14. E: 41. Room temperature sensor error (Indoor unit)	03-38
2-15. E: 42. Indoor unit heat exchanger sensor error (Indoor unit)	03-39
2-16. E: 44. Human sensor error	03-40
2-17. E: 51. Indoor unit fan motor error (Indoor unit)	03-41
2-18. E: 54. Electric air cleaner reverse VDD error (Indoor unit)	03-42
2-19. E: 62. Outdoor unit main PCB error (Outdoor unit)	03-43
2-20. E: 63. Inverter error (Outdoor unit)	03-44
2-21. E: 64. PFC circuit error (Outdoor unit)	03-45
2-22. E: 65. IPM error (Outdoor unit)	03-46
2-23. E: 71. Discharge thermistor error (Outdoor unit)	03-48
2-24. E: 72. Compressor thermistor error (Outdoor unit)	03-49
2-25. E: 73. Outdoor unit heat exchanger thermistor error (Outdoor unit)	03-50
2-26. E: 74. Outdoor temperature thermistor error (Outdoor unit)	03-51
2-27. E: 84. Current sensor error (Outdoor unit)	03-52
2-28. E: 86. High pressure switch error (Outdoor unit)	03-53
2-29. E: 94. Trip detection (Outdoor unit)	03-54
2-30. E: 95. Compressor motor control error (Outdoor unit)	03-55
2-31. E: 97. Outdoor unit fan motor error (Outdoor unit)	03-56
2-32. E: 99. 4-way valve error (Outdoor unit)	03-57

CONTENTS (continued)

2-33. E: A1. Discharge temperature error (Outdoor unit)	
2-34. E: A3. Compressor temperature error (Outdoor unit)	03-61
3. Troubleshooting without error code	03-63
3-1. Indoor unit—No power	03-63
3-2. Outdoor unit—No power	03-64
3-3. No operation (Power is on)	03-65
3-4. No cooling/No heating	03-66
3-5. Abnormal noise	03-68
3-6. Water leaking	03-69
3-7. Air cleaner assy does not work properly	03-70
3-8. Intake grille closing failure	03-71
4. Troubleshooting with error code (For wireless LAN adapter	r)03-72
4-1. E: 18. External communication error between indoor unit and wireless L	AN adapter03-72
4-2. Network communication error between wireless LAN router and wireles	
	03-73
4-3. E: 18. Communication error	03-75
4-3. E: 18. Communication error 4-4. E: 18. Wireless LAN adapter non-energized	03-75 03-77
4-3. E: 18. Communication error	03-75 03-77
4-3. E: 18. Communication error 4-4. E: 18. Wireless LAN adapter non-energized	03-75 03-77 03-78
4-3. E: 18. Communication error4-4. E: 18. Wireless LAN adapter non-energized4-5. Mobile app setting method	03-75 03-77 03-78 03-80
 4-3. E: 18. Communication error	03-75 03-77 03-78 03-80 03-80
 4-3. E: 18. Communication error	
 4-3. E: 18. Communication error	
 4-3. E: 18. Communication error	
 4-3. E: 18. Communication error. 4-4. E: 18. Wireless LAN adapter non-energized. 4-5. Mobile app setting method. 5. Service parts information 5-1. Compressor. 5-2. Inverter compressor. 5-3. Outdoor unit Electronic Expansion Valve (EEV). 5-4. Indoor unit fan motor 	
 4-3. E: 18. Communication error	
 4-3. E: 18. Communication error. 4-4. E: 18. Wireless LAN adapter non-energized. 4-5. Mobile app setting method. 5. Service parts information 5-1. Compressor. 5-2. Inverter compressor. 5-3. Outdoor unit Electronic Expansion Valve (EEV) 5-4. Indoor unit fan motor 5-5. Outdoor unit fan motor 5-6. Pressure switch 	
 4-3. E: 18. Communication error. 4-4. E: 18. Wireless LAN adapter non-energized. 4-5. Mobile app setting method. 5. Service parts information 5-1. Compressor. 5-2. Inverter compressor. 5-3. Outdoor unit Electronic Expansion Valve (EEV) 5-4. Indoor unit fan motor 5-5. Outdoor unit fan motor 5-6. Pressure switch 5-7. 4-way valve coil (solenoid coil)/4-way valve 	

1. Error code

FROUBLESHOOTING

When a problem occurs in the system or the connected device, the error content is notified by displaying the code.

NOTE: This function is only available in a system with indoor or IR receiver units equipped with indicator lamps to show the error content.


Errors, once displayed, will be automatically stored in the PC board of the indoor unit. Even if the power is disconnected, the memory containing the error history will not be erased.

If another error occurs later, the stored error memory will be updated automatically and replaced with the new one. (Previous error will be erased.)

1-1. How to check the error memory

When an error occurs, the operation lamp (Green) and the timer lamp (Orange) indicate the error content by blinking. To check the error memory, follow the procedures below.

- 1. Stop the operation of the air conditioner, and then disconnect the power supply.
- 2. Reconnect the power supply.
- 3. In one of the following two methods, the memorized error is only displayed during the "3 minutes ST"* state period.
 - Start the operation and then press the TEST RUN button on the remote controller.
 - Press the MANUAL AUTO button on the indoor unit for 10 seconds or more.

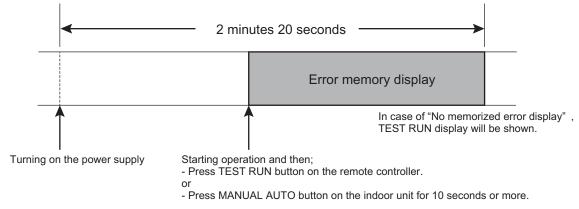

*: The "3 minutes ST" period lasts 2 minutes and 20 seconds after turning on the power supply.

1-2. How to erase the error memory

The error memory can be erased in one of the following two methods.

- Manual erase: Pressing the MANUAL AUTO button on the indoor unit while the "Error memory display" is being shown. (Short beep emits for about 3 seconds.)
- Automatic erase: After continuing the normal operation of the air conditioner without error for 2 hours or longer after displaying the error memory as described in How to check the error memory. (Except FAN operation mode.)

1-3. Error code table (Indoor unit and wired remote controller)


The operation, timer, and economy indicators operate according to the error contents. For confirmation of the error contents, refer the flashing pattern as follows.

	Indoor unit display			Wired
Error contents	Operation [I] (Green)	Timer [^년] (Orange)	Economy [쏩] (Green)	remote controller display
E: 11. Serial communication error (Serial reverse transfer error) (Outdoor unit)	1 times	1 times	Continuous	11
E: 11. Serial communication error (Serial forward transfer error) (Indoor unit)	1 times	1 times	Continuous	11
E: 12. Wired remote controller communication error (Indoor unit)	1 times	2 times	Continuous	12
E: 18. External communication error (Indoor unit)	1 times	8 times	Continuous	18
E: 22. Indoor unit capacity error (Indoor unit)	2 times	2 times	Continuous	22
E: 23. Combination error (Outdoor unit)	2 times	3 times	Continuous	23
E: 26. Address setting error in wired remote controller (Indoor unit)	2 times	6 times	Continuous	26
E: 29. Connected unit number error (Indoor unit)	2 times	9 times	Continuous	29
E: 32. Indoor unit main PCB error (Indoor unit)	3 times	2 times	Continuous	32
E: 33. Indoor unit motor electricity consumption detection error (Indoor unit)	3 times	3 times	Continuous	33
E: 35. MANUAL AUTO button error (Indoor unit)	3 times	5 times	Continuous	35
E: 39. Indoor unit power supply error for fan motor (Indoor unit)	3 times	9 times	Continuous	39
E: 3A. Indoor unit communication circuit (wired remote controller) error	3 times	10 times	Continuous	3A
E: 41. Room temperature sensor error (Indoor unit)	4 times	1 times	Continuous	41
E: 42. Indoor unit heat exchanger sensor error (Indoor unit)	4 times	2 times	Continuous	42
E: 44. Human sensor error	4 times	4 times	Continuous	44
E: 51. Indoor unit fan motor error (Indoor unit)	5 times	1 times	Continuous	51
E: 54. Electric air cleaner reverse VDD error (Indoor unit)	5 times	4 times	Continuous	54
E: 62. Outdoor unit main PCB error (Outdoor unit)	6 times	2 times	Continuous	62
E: 63. Inverter error (Outdoor unit)	6 times	3 times	Continuous	63
E: 64. PFC circuit error (Outdoor unit)	6 times	4 times	Continuous	64
E: 65. IPM error (Outdoor unit)	6 times	5 times	Continuous	65
E: 71. Discharge thermistor error (Outdoor unit)	7 times	1 times	Continuous	71
E: 72. Compressor thermistor error (Outdoor unit)	7 times	2 times	Continuous	72
E: 73. Outdoor unit heat exchanger thermistor error (Outdoor unit)	7 times	3 times	Continuous	73
E: 74. Outdoor temperature thermistor error (Outdoor unit)	7 times	4 times	Continuous	74
E: 84. Current sensor error (Outdoor unit)	8 times	4 times	Continuous	84
E: 86. High pressure switch error (Outdoor unit)	8 times	6 times	Continuous	86
E: 94. Trip detection (Outdoor unit)	9 times	4 times	Continuous	94

	I	Wired		
Error contents	Operation [I] (Green)	Timer [^싄] (Orange)	Economy [^쓰] (Green)	remote controller display
E: 95. Compressor motor control error (Outdoor unit)	9 times	5 times	Continuous	95
E: 97. Outdoor unit fan motor error (Outdoor unit)	9 times	7 times	Continuous	97
E: 99. 4-way valve error (Outdoor unit)	9 times	9 times	Continuous	99
E: A1. Discharge temperature error (Outdoor unit)	10 times	1 times	Continuous	A1
E: A3. Compressor temperature error (Outdoor unit)	10 times	3 times	Continuous	A3

1-4. Error code table (Wireless LAN indicator)

Wireless LAN control system diagram example

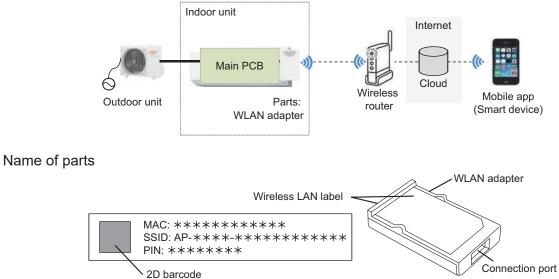

• Wireless LAN indicator lamps

TROUBLESHOOTING

•

For confirmation of the error contents, refer to the following flashing patterns. Wireless LAN indicator lamp (orange) on the indoor unit operate according to the error contents.


Error contents	Wireless LAN indicator lamp (orange)	Error code
E: 18. External communication error between indoor unit and wireless LAN adapter	Flashing slowly	18
Network communication error between wireless LAN router and wireless LAN adapter	Flashing slowly	No error
E: 18. Communication error	Flashing slowly	18
E: 18. Wireless LAN adapter non- energized	Off	18

Flashing slowly: Repeating 7 seconds on/2 seconds off


1-5. How to check the error code on Mobile app

If there is an abnormality on the air conditioning, refer to \mathbf{A} as follows.

When the 🔺 (error button) on the home screen is tapped, error code and error name is displayed.

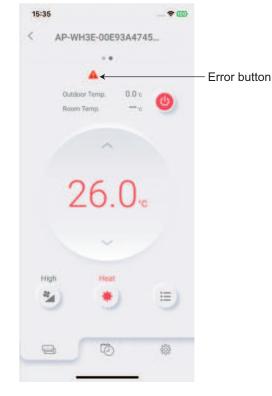



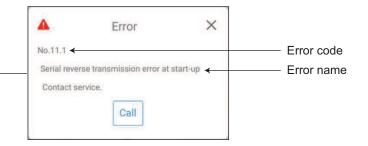

1-6. Error code table (Mobile app)

Error message	Error contents	Error code
Serial reverse transmission error at start-up	E: 11. Serial communication error (Serial	11.1
Serial reverse transmission error during operation	reverse transfer error) (Outdoor unit)	11.2
Serial forward transmission error at start-up	F: 11 Seriel communication error (Seriel	11.3
Serial forward transmission error during operation	E: 11. Serial communication error (Serial forward transfer error) (Indoor unit)	11.4
Wired remote controller communication error	E: 12. Wired remote controller communication error (Indoor unit)	12.1
External communication 1 error	E: 18. External communication error (Indoor unit)	18.1
Indoor unit capacity error	E: 22. Indoor unit capacity error (Indoor unit)	22.1
Connection forbidden (series error)	E: 23. Combination error (Outdoor unit)	23.1
Unit combination error		23.2
Address duplication in wired remote controller system	E: 26. Address setting error in wired remote	26.4
Address setting error in wired remote controller system	controller (Indoor unit)	26.5
Connection unit number error (indoor unit in wired remote controller system)	E: 29. Connected unit number error (Indoor unit)	29.1
Indoor unit PCB model information error	E: 32. Indoor unit main PCB error (Indoor	32.1
Constant correction control error	unit)	32.6
Indoor unit motor electricity consumption detection microcomputers error	E: 33. Indoor unit motor electricity consumption detection error (Indoor unit)	33.2
Indoor unit manual auto switch error	E: 35. MANUAL AUTO button error (Indoor unit)	35.1
Indoor unit power supply error for fan motor 1	E: 39. Indoor unit power supply error for fan motor (Indoor unit)	39.1
Indoor unit communication circuit (wired remote controller) microcomputers communication error	E: 3A. Indoor unit communication circuit (wired remote controller) error	3A.1
Indoor unit suction air temp. thermistor error	E: 41. Room temperature sensor error (Indoor unit)	41.1
Indoor unit heat ex. middle temp. thermistor error	E: 42. Indoor unit heat exchanger sensor error (Indoor unit)	42.2
Human detection sensor error	E: 44. Human sensor error	44.1
Indoor unit fan motor 1 lock error	E: 51. Indoor unit fan motor error (Indoor	51.1
Indoor unit fan motor 1 rotation speed error	unit)	51.2
Electric air cleaner reverse Vdd error	E: 54. Electric air cleaner reverse VDD error (Indoor unit)	54.2
Outdoor unit PCB model information error	E. 62. Outdoor unit main DCB error (Outdoor	62.1
Outdoor unit PCB microcomputer communication error	E: 62. Outdoor unit main PCB error (Outdoor - unit)	62.2
Outdoor unit inverter error	E: 63. Inverter error (Outdoor unit)	63.1
Outdoor unit abnormal voltage error (permanent stop)		64.1
Outdoor unit abnormal voltage error (automatic restore)	E: 64. PFC circuit error (Outdoor unit)	64.3
Outdoor unit over current error (permanent stop)	``´´	64.4
Outdoor unit PFC hardware error	1	64.8
Outdoor unit trip terminal L error	E: 65. IPM error (Outdoor unit)	65.3
Outdoor unit discharge temp. thermistor 1 error	E: 71. Discharge thermistor error (Outdoor unit)	71.1
Outdoor unit compressor temp. thermistor 1 error	E: 72. Compressor thermistor error (Outdoor unit)	72.1


Error message	Error contents	Error code
Outdoor unit heat ex. liquid temp. thermistor error	E: 73. Outdoor unit heat exchanger thermistor error (Outdoor unit)	73.3
Outside air temp. thermistor error	E: 74. Outdoor temperature thermistor error (Outdoor unit)	74.1
Outdoor unit current sensor 1 error (permanent stop)	E: 84. Current sensor error (Outdoor unit)	84.1
Outdoor unit high pressure switch 1 error	E: 86. High pressure switch error (Outdoor unit)	86.4
Outdoor unit trip detection	E: 94. Trip detection (Outdoor unit)	94.1
Outdoor unit compressor rotor position detection error (permanent stop)	E: 95. Compressor motor control error (Outdoor unit)	95.1
Outdoor unit fan motor 1 power source duty error	E: 97. Outdoor unit fan motor error (Outdoor unit)	97.3
Outdoor unit 4-way valve error	E: 99. 4-way valve error (Outdoor unit)	99.1
Outdoor unit discharge temperature 1 error (permanent stop)	E: A1. Discharge temperature error (Outdoor unit)	A1.1
Outdoor unit compressor 1 temperature error	E: A3. Compressor temperature error (Outdoor unit)	A3.1

1-7. Error message for wireless LAN control (Mobile app)

Error display

TROUBLESHOOTING

If there is an abnormality on the wireless control system, refer to error messages as follows.

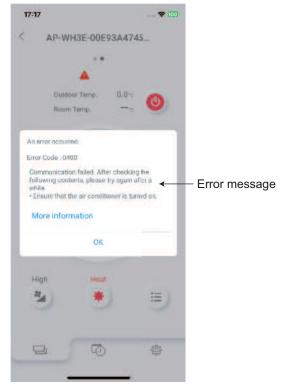

Error message list

Registration error

Error	Error message	Cause
code	Entri message	Solution
2400	Communication failed. After checking the following contents, please try again after a while. • Ensure that the air conditioner is turned on.	 Communication with the air conditioner failed. Check the following contents depending on the status of indoor unit wireless LAN indicator lamp or WLAN Adapter LED 2 and operate again. When not lighting Check that the Electrical panel (Switch breaker) to the air conditioner is turned on. Check that the power plug of the air conditioner main unit is plugged in. When lighting Check that the scale that the wireless router to which the air conditioner is connected is connected to the Internet. If the smartphone cannot connect to the Internet, reboot the wireless router. When rebooting the wireless router does not solve the problem, contact the manufacturer of the wireless router. When blinking Wait for a while until the indicator lamp lights and then operate again. If the indicator lamp is still blinking after waiting for a while, check that the wireless router is turned on.
2930	Cannot connect to your air conditioner. Check if the WiFi setting of the mobile device is turned on. When problems are not resolved, there may be other causes. Tap the link below to check other solutions.	 Failed because the smartphone could not connect to the air conditioner. Check the following contents depending on the status of indoor unit wireless LAN indicator lamp or WLAN Adapter LED 2 and operate again. When not lighting Check that the 2D barcode is for the air conditioner to be registered. Check that the Electrical panel (Switch breaker) to the air conditioner is turned on. Check that the power plug of the air conditioner main unit is plugged in. Retry the connection step procedure for the air conditioner registration displayed in the application to set the lamp to the blinking state. When lighting or blinking Check that the 2D barcode is for the air conditioner to be registered.

Error	Error message	Cause
code	Entri message	Solution
2931	WLAN adapter password is wrong. Enter it again. When problems are not resolved, there may be other causes. Tap the link below to check other solutions.	 Failed because the smartphone could not connect to the air conditioner. Check the following contents depending on the status of indoor unit wireless LAN indicator lamp or WLAN Adapter LED 2 and operate again. When not lighting Check that the Electrical panel (Switch breaker) to the air conditioner is turned on. Check that the power plug of the air conditioner main unit is plugged in. Retry the connection step procedure for the air conditioner registration displayed in the application to set the lamp to the blinking state. When lighting or blinking Check that the entered SSID and PIN numbers of WLAN Adapter are correct. Check that the wireless LAN setting of smartphone is set to ON.
2932 2933	Failed to connect to wireless router. Check if the WiFi setting of the mobile device is turned on. When problems are not resolved, there may be other causes. Tap the link below to check other solutions.	 Registration failed because the smartphone cannot connect to the network. Connection to the WLAN Adapter was disconnected during processing. 1. Check that the wireless LAN setting of smartphone is set to ON. 2. Check that the smartphone is connected to the Internet.
2934	Wi-Fi router password is wrong. Tap "From the beginning" to enter it again. When problems are not resolved, there may be other causes. Tap the link below to check other solutions.	 The wireless router password is not correct. The air conditioner is not connected to the same wireless router as the smartphone. Check the following contents and operate again. Check that the wireless router password is correct. Check that the smartphone and the air conditioner are connected to the same wireless router. The wireless router encryption method WPA3 is not supported. Check if SSID other than WPA3 is selected. Check that the local network setting of the smartphone is "Enabled". (Only for smartphones with iOS14 or later)
2935 2937 2939 2941	Failed to register the air conditioner. Make sure the wireless router is connected to the Internet, and then tap "Re-register" to perform the registration process again. When problems are not resolved, there may be other causes. Tap the link below to check other solutions.	 Registration failed because the air conditioner cannot connect to the Internet. Check the following contents and operate again. 1. Use a smartphone to check that the wireless router to which the air conditioner is connected is connected to the Internet. 2. If the smartphone cannot connect to the Internet, reboot the wireless router. When rebooting the wireless router does not solve the problem, contact the manufacturer of the wireless router. 3. Check that the MAC address filter and privacy separator settings are not "enabled" on the wireless router.

Error	F	Cause
code	Error message	Solution
2936 2940	Air conditioner registration failed. Tap "Re-register" and conduct the registration processing again. If not successful after multiple attempts, tap "From the beginning" and then initialize the WLAN and start over from the beginning.	 The air conditioner you are trying to register is already registered to another account. Registration failed because the air conditioner cannot connect to the Internet. Immediately after turning on the power of the air conditioner, wait for about 5 minutes before registering it. Check the following contents and operate again. Tap "Re-register" and conduct the registration processing again. Delete from another account or initialize the WLAN Adapter. Check that the wireless router is turned on. Check that the wireless router is connected to the Internet. If not connected, reboot the wireless router. When rebooting does not solve the problem, contact the manufacturer of the wireless router. Check that the MAC address filter and privacy separator settings are not "enabled" on the wireless router.
2938	Registration failed because the air conditioner could not connect to the Internet. Perform the WPS connection procedure again and confirm that the WLAN lamp on the indoor unit or LED2 on the WLAN adapter is lit before registering. When problems are not resolved, there may be other causes. Tap the link below to check other solutions.	 Registration failed because the air conditioner cannot connect to the Internet. Registration failed because the air conditioner is not connected to the same wireless router as the smartphone. Check the following contents depending on the status of indoor unit wireless LAN indicator lamp or WLAN Adapter LED 2 and operate again. When not lighting Check that the Electrical panel (Switch breaker) to the air conditioner is turned on. Check that the power plug of the air conditioner main unit is plugged in. Check that the wireless router is turned on. Retry the connection step procedure for the air conditioner registration displayed in the application and complete WPS connection with wireless router to set the lamp to the blinking state. When lighting Check that the air conditioner and the smartphone are connected to the same wireless router. Check that the local network setting of the smartphone is "Enabled". (Only for smartphones with iOS14 or later)
2942	 Your mobile device is not connected to WiFi. Connect to the target wireless router through the OS WiFI setting and restart the procedure. 1. Open the Wi-Fi setting screen of your device. 2. Connect your mobile device to the {ssid}. 3. Return to the application screen and tap "Re- register". When problems are not resolved, there may be other causes. Tap the link below to check other solutions. 	 Registration failed because the air conditioner cannot connect to the Internet. Check the following contents and operate again. 1. Check that the wireless LAN setting of smartphone is set to ON. 2. Check that the smartphone is connected to the Internet. 3. Set the connection setting with the wireless router to Auto Connection in the smartphone settings. 4. Check that the wireless router is turned on.

Error	Error mossago	Cause
code	Error message	Solution
2944	Communication failed.	Registration may have failed because a problem occurred in communication with the server (cloud). Wait for a while and then operate again.
2946	The connected air conditioner cannot use the Direct control.	Your air conditioner does not support Direct Control. Operate the air conditioner with Cloud Control.
	Already reached the max number of air conditioners per user.	The number of air conditioners that can be registered on AIRSTAGE Mobile has reached the maximum limit. Check the number of air conditioners registered on AIRSTAGE
2947		Mobile. (Maximum number of registered units: 50 units for Cloud Control, 50 units for Direct Control)
		Delete the unused air conditioners on the "Air conditioner editing" screen before registration.
	The number of air conditioners registered by the entered user has reached the upper limit, so registration is not possible.	The number of sub users that can be registered has reached the maximum limit.
2949		Check the number of registered sub users. (Maximum number of registered sub users: 4 sub users)
		Delete the unused sub users on the "Sub User Registration" screen.
	The specified air conditioner is already registered.	The specified air conditioner was already registered.
2953	To Reregister, delete the air conditioner information on the air conditioner edit screen and initialize the wireless LAN adapter with the remote control.	Check that the specified air conditioner is displayed on the air conditioner list screen.
		To register again, delete the air conditioner on the air conditioner editing screen.
	The wireless router to which the mobile device and the	The air conditioner and the smartphone are not connected to the same wireless router network.
	wireless LAN adapter are connected must be the same. Follow the steps below.	
	1. Please open the Wi-Fi setting screen of the	Check the following contents and operate again. 1. Check that the wireless LAN setting of smartphone is set to
2954	mobile device. 2. Connect your mobile	ON.2. Check that the smartphone is connected to the Internet.
	device to the wireless router that you pressed the automatic connection	 Check that the wireless router is turned on. Check that the air conditioner and the smartphone are connected to the same wireless router.
	button.3. Return to the app screen and tap "OK".	

Sign in error

Error	Error moccore	Cause
code	Error message	Solution
4010	Communication failed. After checking the following	Various settings could not be completed because communication with the server (cloud) failed.
4410	contents, please try again after	Check the following contents and operate again.
4610	a while.	1. Check that the wireless LAN setting of smartphone is set to
4810	Ensure that your mobile	ON.
4910	device is connected to the internet.	 Check that the smartphone is connected to the Internet. Check that the wireless router is turned on.
4100	The account you are currently signed in to may have been deleted.	Token has been disabled because the signed-in account has been deleted or certain amount of time has elapsed.
4100	If necessary, please create the account again.	Restart the application and check that you can sign in.If you cannot sign in, create the account again.
4101	The session has expired. Please sign in again to	Token has been disabled because the signed-in account has been deleted or certain amount of time has elapsed.
4101	continue.	Restart the application and check that you can sign in. If you cannot sign in, create the account again.
	Your session has expired.	Token has been disabled because the signed-in account has
	Please sign in again.	been deleted or certain amount of time has elapsed.
4102	*If you cannot sign in, your account may have been deleted. If necessary, please	Restart the application and check that you can sign in. If you cannot sign in, create the account again.
	create an account again.	
		Communication with the server (cloud) failed at sign in.
	Failed to connect to the server.	 Registration process of Account registration procedure verification email has not been completed. Check the following contents and sign in again.
4110	Some functions can be used with Direct Control. Do you want to switch to direct control?	 Check that the wireless LAN setting of smartphone is set to ON.
		 Check that the smartphone is connected to the Internet. Check that the wireless router is turned on.
		4. Tap the link of Account registration procedure verification email and check that registration process has completed.
	Failed to read the device.	Air conditioner information could not be obtained because communication with the server (cloud) failed after sign in.
4111	Since some functions are available in Direct control,	Check the following contents and sign in again.1. Check that the wireless LAN setting of smartphone is set to
	switch to Direct control.	ON.2. Check that the smartphone is connected to the Internet.3. Check that the wireless router is turned on.
		Communication with the server (cloud) failed at sign in.
		Registration process of Account registration procedure verification email has not been completed.
		Check the following contents and sign in again.
4112	Failed to connect to the server. Some functions are limited.	1. Check that the wireless LAN setting of smartphone is set to ON.
		2. Check that the smartphone is connected to the Internet.
		3. Check that the wireless router is turned on.
		4. Tap the link of Account registration procedure verification email and check that registration process has completed.
	Failed to connect to the server.	Air conditioner information could not be obtained because communication with the server (cloud) failed after sign in.
	Would you like to sign in	Check the following contents and sign in again.
4113	again? Yes: Sign in again	1. Check that the wireless LAN setting of smartphone is set to
	No: Return to the sign-in screen	ON.2. Check that the smartphone is connected to the Internet.3. Check that the wireless router is turned on.

Error	Error message	Cause
code	Entri message	Solution
	Loading of user information failed. Check the following	User information or temperature unit information could not be obtained because communication with the server (cloud) failed.
4420	contents.	Check the following contents and operate again.
4420	Check that your mobile device is connected to the	1. Check that the wireless LAN setting of smartphone is set to ON.
	internet.	 Check that the smartphone is connected to the Internet. Check that the wireless router is turned on.
4530 Please check if	Password update failed. Please check if the entered	Password update failed because the entered password was not correct.
	current password is correct.	Check that the entered "Current password" is correct and operate again.
4920	Loading of time zone failed.	Time zone information could not be obtained because communication with server (cloud) failed.
	Check the following contents.	Check the following contents and operate again.
	Check that your mobile device is connected to the	1. Check that the wireless LAN setting of smartphone is set to ON.
	internet.	 Check that the smartphone is connected to the Internet. Check that the wireless router is turned on.

General error

Ş
E
8
ЯH
Щ
В
DO
R.

Error	Error message	Cause
code	Lifer message	Solution
0100		Communication with the air conditioner failed.
0200		
0300		
0400		Check the following contents depending on the status of indoor
0500		unit wireless LAN indicator lamp or WLAN Adapter LED 2 and
0501		operate again.
0600	Communication failed. After	When not lighting Check that the Electrical panel (Switch breaker) to the
0601 0800	checking the following	 Check that the Electrical panel (Switch breaker) to the air conditioner is turned on.
0800	contents, please try again after	 Check that the power plug of the air conditioner main
1000	a while.	unit is plugged in.
1200	Ensure that the air conditioner is turned on.	When lighting
1400		Use a smartphone to check that the wireless router to
1500		which the air conditioner is connected is connected to the Internet. If the smartphone cannot connect to the Internet,
3200		reboot the wireless router. When rebooting the wireless
5500		router does not solve the problem, contact the
5700		manufacturer of the wireless router.
5900		
6200		
0810		Various settings could not be completed because communication with the conver (cloud) failed
0811		communication with the server (cloud) failed.Air conditioner information could not be obtained because
0812 1510		communication with server (cloud) failed.
1510		
1512		
3010	Communication failed. After	
5510	checking the following	
5520	contents, please try again after a while.	Objects the fellowing contents and connects and
5530	Ensure that your mobile	Check the following contents and operate again.
6001	device is connected to the	1. Check that the wireless LAN setting of smartphone is set to ON.
6002	internet.	2. Check that the smartphone is connected to the Internet.
6003		3. Check that the wireless router is turned on.
6010		
6011		
6012		
6013 6310		
0310		

Error	Error mooogo	Cause
code	Error message	Solution
0820	Loading of outdoor low noise timer failed. Check the following contents. • Ensure that your mobile device is connected to the internet.	 The outdoor unit low noise timer information could not be obtained because communication with the server (cloud) failed. Check the following contents depending on the status of indoor unit wireless LAN indicator lamp or WLAN Adapter LED 2 and operate again. When not lighting Check that the Electrical panel (Switch breaker) to the air conditioner is turned on. Check that the power plug of the air conditioner main unit is plugged in. When lighting Check that the power plug of the air conditioner main unit is plugged in. When lighting When lighting Use a smartphone to check that the wireless router to which the air conditioner is connected is connected to the Internet. If the smartphone cannot connect to the Internet, reboot the wireless router. When rebooting the wireless router does not solve the problem, contact the manufacturer of the wireless router. When blinking Wait for a while until the indicator lamp lights and then operate again. If the indicator lamp is still blinking after waiting for a while, check that the wireless router is turned on.
1520	Loading of weekly timer failed. Check the following contents. • Ensure that your mobile device is connected to the internet.	 The weekly timer setting information could not be obtained because communication with the server (cloud) failed. Check the following contents depending on the status of indoor unit wireless LAN indicator lamp or WLAN Adapter LED 2 and operate again. When not lighting Check that the Electrical panel (Switch breaker) to the air conditioner is turned on. Check that the power plug of the air conditioner main unit is plugged in. When lighting When lighting Use a smartphone to check that the wireless router to which the air conditioner is connected is connected to the Internet. If the smartphone cannot connect to the Internet, reboot the wireless router. When rebooting the wireless router does not solve the problem, contact the manufacturer of the wireless router. When blinking Wait for a while until the lamp lights and then operate again. If the lamp is still blinking after waiting for a while, check that the wireless router is turned on.

Error	Error mossago	Cause
code	Error message	Solution
Check the follow 1720 • Ensure that	Loading of error history failed. Check the following contents.	 The error history information could not be obtained because communication with the server (cloud) failed. Check the following contents depending on the status of indoor unit wireless LAN indicator lamp or WLAN Adapter LED 2 and operate again. When not lighting Check that the Electrical panel (Switch breaker) to the air conditioner is turned on. Or check that the power plug of the air conditioner main unit is plugged in. When lighting Use a smartphone to check that the wireless router to
		 which the air conditioner is connected is connected to the Internet. If the smartphone cannot connect to the Internet, reboot the wireless router. When rebooting the wireless router does not solve the problem, contact the manufacturer of the wireless router. When blinking Wait for a while until the indicator lamp lights and then operate again. If the indicator lamp is still blinking after waiting for a while, check that the wireless router is turned on.
	-	Air conditioner group setting has not been completed because communication with air conditioner failed.
		Check the following contents depending on the status of indoor unit wireless LAN indicator lamp or WLAN Adapter LED 2 and operate again.
		When not lighting
		 Check that the Electrical panel (Switch breaker) to the air conditioner is turned on.
		 Check that the power plug of the air conditioner main unit is plugged in.
3110		 When lighting Use a smartphone to check that the wireless router to which the air conditioner is connected is connected to the Internet. If the smartphone cannot connect to the Internet, reboot the wireless router. When rebooting the wireless router does not solve the problem, contact the manufacturer of the wireless router. When blinking Wait for a while until the indicator lamp lights and then operate again. If the indicator lamp is still blinking after waiting for a while, check that the wireless router is turned

N.
от
P
ES
BL
Ы
TR

Error moccore		Cause		
code	Error message	Solution		
3111	Communication failure prevented the group creation processing from being conducted. After checking the following contents, please try again after a while. • Ensure that your mobile device is connected to the internet.	 Air conditioner group setting has not been completed because communication with air conditioner failed. Check the following contents depending on the status of indoor unit wireless LAN indicator lamp or WLAN Adapter LED 2 and operate again. When not lighting Check that the Electrical panel (Switch breaker) to the air conditioner is turned on. Check that the power plug of the air conditioner main unit is plugged in. When lighting When lighting Use a smartphone to check that the wireless router to which the air conditioner is connected is connected to the Internet. If the smartphone cannot connect to the Internet, reboot the wireless router. When rebooting the wireless router of the wireless router. 		
		 When blinking Wait for a while until the indicator lamp lights and then operate again. If the indicator lamp is still blinking after waiting for a while, check that the wireless router is turned on. Air conditioner group setting has not been completed because communication with air conditioner failed. 		
3112	Communication failure prevented the group name change processing from being conducted. After checking the following contents, please try again after a while. • Ensure that your mobile device is connected to the internet.	 Check the following contents depending on the status of indoor unit wireless LAN indicator lamp or WLAN Adapter LED 2 and operate again. When not lighting Check that the Electrical panel (Switch breaker) to the air conditioner is turned on. Check that the power plug of the air conditioner main unit is plugged in. When lighting Use a smartphone to check that the wireless router to which the air conditioner is connected is connected to the Internet. If the smartphone cannot connect to the Internet, reboot the wireless router. When rebooting the wireless router does not solve the problem, contact the manufacturer of the wireless router. When blinking Wait for a while until the indicator lamp lights and then operate again. If the indicator lamp is still blinking after waiting for a while, check that the wireless router is turned on. 		

	3	
	ž	
	Ö	
	0	
	Ŧ	
	й	
	-	
	ರ	
	ř	
	F	

Error	Error mossago	Cause		
code	Error message	Solution		
3113	Communication failure prevented the group deletion processing from being conducted. After checking the following contents, please try again after a while. • Ensure that your mobile device is connected to the internet.	 Air conditioner group setting has not been completed because communication with air conditioner failed. Check the following contents depending on the status of indoor unit wireless LAN indicator lamp or WLAN Adapter LED 2 and operate again. When not lighting Check that the Electrical panel (Switch breaker) to the air conditioner is turned on. Check that the power plug of the air conditioner main unit is plugged in. When lighting When lighting Use a smartphone to check that the wireless router to which the air conditioner is connected is connected to the Internet. If the smartphone cannot connect to the Internet, reboot the wireless router. When rebooting the wireless router of the wireless router. 		
		When blinking Wait for a while until the indicator lamp lights and then operate again. If the indicator lamp is still blinking after waiting for a while, check that the wireless router is turned on.		
		Air conditioner group setting has not been completed because communication with air conditioner failed. Check the following contents depending on the status of indoor		
		unit wireless LAN indicator lamp or WLAN Adapter LED 2 and operate again.When not lighting		
3114	 The room temperature display indoor unit setting could not be made due to a communication failure. After checking the following contents, please try again after a while. Ensure that your mobile device is connected to the internet. 	 Check that the Electrical panel (Switch breaker) to the air conditioner is turned on. Check that the power plug of the air conditioner main unit is plugged in. When lighting Use a smartphone to check that the wireless router to which the air conditioner is connected is connected to the Internet. If the smartphone cannot connect to the Internet, reboot the wireless router. When rebooting the wireless router does not solve the problem, contact the manufacturer of the wireless router. 		
		 When blinking Wait for a while until the indicator lamp lights and then operate again. If the indicator lamp is still blinking after waiting for a while, check that the wireless router is turned on. 		

1-7. Error message for wireless LAN control (Mobile app)

Error	Error message	Cause		
code	Enormosouge	Solution		
3115	Some device group move processing could not be conducted due to communication failure. After checking the following contents, please try again after a while. • Ensure that your mobile device is connected to the internet.	 Air conditioner group setting has not been completed because communication with air conditioner failed. Check the following contents depending on the status of indoor unit wireless LAN indicator lamp or WLAN Adapter LED 2 and operate again. When not lighting Check that the Electrical panel (Switch breaker) to the air conditioner is turned on. Check that the power plug of the air conditioner main unit is plugged in. When lighting When lighting Use a smartphone to check that the wireless router to which the air conditioner is connected is connected to the Internet. If the smartphone cannot connect to the Internet, reboot the wireless router. When rebooting the wireless router does not solve the problem, contact the manufacturer of the wireless router. When blinking Wait for a while until the indicator lamp lights and then operate again. If the indicator lamp is still blinking after waiting for a while, check that the wireless router is turned 		
5320	 Loading of air conditioner information failed. Check the following contents. Ensure that your mobile device is connected to the internet. 	on. Air conditioner information could not be obtained because communication with server (cloud) failed. 1. Check that the wireless LAN setting of smartphone is set to ON.		
5531 5540	New firmware update failed.	 Firmware update failed. Check the following contents and operate again. 1. Check that the wireless LAN setting of smartphone is set to ON. 2. Check that the smartphone is connected to the Internet. 3. Check that the wireless router is turned on. 4. Refer to the operation manual of air conditioner and check the indicator lamp state of air conditioner indoor unit. 		
5601	Failed to get the air conditioner information.	Failed to obtain air conditioner information by Direct Control. Sign in again.		
5602	Failed to add the air conditioner.	 Failed to add air conditioner by Direct Control. Check the following contents and operate again. 1. When 2D barcode label is used, scan 2D barcode label again. 2. When 2D barcode label is not used, check that the entered SSID or PIN code is correct. 		
5630	 Device disconnection failed.After checking the following contents, please try again after a while. Ensure that your mobile device is connected to the internet. 	 Failed to disconnect the connection with air conditioner by Direct Control. Check the following contents and operate again. 1. Check that the smartphone is connected with the air conditioner. 2. Check that the Electrical panel (Switch breaker) to the air conditioner is turned on. 3. Check that the power plug of the air conditioner main unit is plugged in. 		

Error	Error mossage	Cause		
code	Error message	Solution		
6201	 Failed to update the screen. After checking the following contents, please try again after a while. Ensure that your mobile device is connected to the internet. 	1. Check that the wireless LAN setting of smartphone is set t ON.		
7610	 Communication failed. Check the following contents. Ensure that your mobile device is connected to the internet. 	 Various settings could not be completed because communication with the server (cloud) failed. Check the following contents and operate again. 1. Check that the wireless LAN setting of smartphone is set to ON. 2. Check that the smartphone is connected to the Internet. 3. Check that the wireless router is turned on. 		

1-8. Errors indicated by the Plasma air clean indicator

Plasma air clean indicator lamp (Green) on the indoor unit operates according to the error.

Error	Plasma air clean [⟩] (Green)
Air cleaner assy does not work properly	Blinks fast
Intake grille closing failure	Blinks slowly

• Blinks fast: Repeating 0.1 seconds on and 0.1 seconds off

• Blinks slowly: Repeating 0.8 seconds on and 0.8 seconds off

2. Troubleshooting with error code

2-1. E: 11. Serial communication error (Serial reverse transfer error) (Outdoor unit)

	Indoor unit	Operation indicator	1 time flash
Indicator		Timer indicator	1 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 11
	Outdoor unit	Main PCB	When the indoor unit cannot receive the serial signal
Detective actuator			from outdoor unit more than 2 minutes after power on,
			or the indoor unit cannot receive the serial signal more
			than 15 seconds during normal operation.
			Connection failure
Forecast of cause			External cause
			Main PCB failure
			Outdoor unit fan motor failure

Check point 1. Reset the power and operate

Does error indication show again?

ROUBLESHOOTING

 \rightarrow If no, go to "Check point 1-2".

Check point 2. Check connection

Check any loose or removed connection line of indoor unit and outdoor unit.

 \downarrow

Check connection condition is control unit. (If there is loose connector, open cable or mis-wiring.) \rightarrow If there is an abnormal condition, correct it by referring to the installation manual or the "DESIGN & TECHNICAL MANUAL".

 \downarrow

Check point 3. Check the voltage of power supply

Check the voltage of power supply Check if AC 207 V (AC 230 V -10%) to AC 253 V (AC 230 V +10%) appears at outdoor unit terminal L—N.

Ţ



Check point 4. Check serial signal (Reverse transfer signal) Check serial signal (Reverse transfer signal) 3 RFD 2 _0 WHITE BLACK 01 Check if indicated value swings between AC 90 V and AC 270 V at the outdoor unit terminal 1 • —3. If it is abnormal, check the parts below. • Outdoor unit fan motor _ If outdoor fan motor is abnormal, replace outdoor unit fan motor and main PCB.

If the checked parts are normal, replace the main PCB.

TROUBLESHOOTING

End

↓

Check point 1-2. Check external cause such as noise

- Check the complete insulation of the grounding.
- Check if there is any equipment that causes harmonic wave near the power cable (Neon light bulb or any electronic equipment which causes harmonic wave).

End

2-2. E: 11. Serial communication error (Serial forward transfer error) (Indoor unit)

	Indoor unit	Operation indicator	1 time flash	
Indicator		Timer indicator	1 time flash	
Indicator		Economy indicator	Continuous flash	
		Error code	E: 11	
	Indoor unit	Main PCB	When the outdoor unit cannot receive the serial signal from indoor unit more than 10 seconds.	
Detective actuator		Fan motor		
	Outdoor unit	Main PCB		
			Connection failure	
			External cause	
Forecast of cause			Main PCB failure	
			Indoor unit fan motor failure	
			Outdoor unit Main PCB	

Check point 1. Reset the power and operate

Does error indication show again?

 \rightarrow If no, go to "Check point 1-2".

Check point 2. Check connection

Check any loose or removed connection line of indoor unit and outdoor unit.

 \downarrow

↓


Check connection condition is control unit. (If there is loose connector, open cable or mis-wiring.) \rightarrow If there is an abnormal condition, correct it by referring to the installation manual or the "DESIGN & TECHNICAL MANUAL".

Check point 3. Check the voltage of power supply

Check the voltage of power supply Check if AC 207 V (AC 230 V -10%) to AC 253 V (AC 230 V +10%) appears at outdoor unit terminal L—N.



 \downarrow

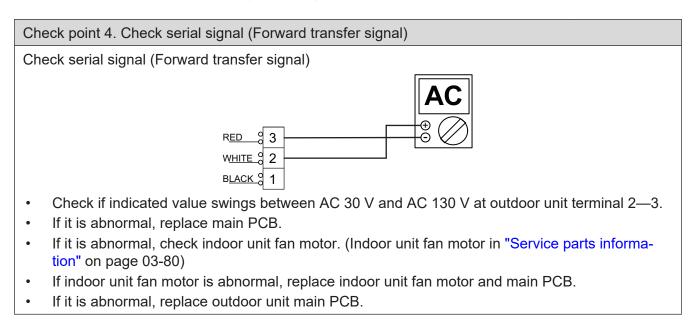

↓ End

Check point 1-2. Check external cause such as noise

- Check the complete insulation of the grounding.
- Check if there is any equipment that causes harmonic wave near the power cable (Neon light bulb or any electronic equipment which causes harmonic wave).

 \downarrow

2-3. E: 12. Wired remote controller communication error (Indoor unit)

	Indoor unit	Operation indicator	1 time flash
Indicator		Timer indicator	2 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 12
	Indoor unit	Main PCB	When the indoor unit cannot receive the signal from
Detective actuator	Wired remote control		Wired remote controller more than 1 minute during
			normal operation.
			Terminal connection abnormal
Forecast of cause			Wired remote control failure
			Main PCB failure

Check point 1. Check the connection of terminal

After turning off the power, check & correct the followings.

• Check the connection of terminal between remote controller and indoor unit, and check if there is a disconnection of the cable.

↓

Check point 2. Check connection Check voltage at CN2 (terminal 1—3) of Communication Kit. (Power supply to the remote controller)

Upon correcting the removed connec-

tor or mis-wiring, reset the power.

DC

•

•

- If it is DC 5 V, remote controller is failure. (Main PCB is normal)
 - Replace Remote Control
- If it is DC 0 V, main PCB is failure. (Check remote controller once again)
 - Replace main PCB

↓

2-4. E: 18. External communication error (Indoor unit)

	Indoor unit	Operation indicator	1 time flash
Indicator		Timer indicator	8 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 18
		External	After receiving a signal from the external input and
Detective actuator	Indoor unit	communication	output PCB, the same signal has not been received for
		error	15 seconds.
			Connection failure
Forecast of cause			WLAN Adapter failure
			Main PCB

Check point 1. Check the connection

- Check any loose or removed connection between the main PCB to the WLAN Adapter.
 -> If there is an abnormal condition, correct it by refer to the installation manual or the "DESIGN & TECHNICAL MANUAL".
- Check the connection condition on the WLAN Adapter and the main PCB (If there is loose connector, open cable or mis-wiring.)

Check point 2. Replace the WLAN Adapter

If check point 1 do not improve the symptom, change WLAN Adapter.

 \downarrow

↓

Check point 3. Replace the main PCB

If check point 2 do not improve the symptom, replace the main PCB.

 \downarrow

2-5. E: 22. Indoor unit capacity error (Indoor unit)

	Indoor unit	Operation indicator	2 time flash
Indicator		Timer indicator	2 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 22
Detective actuator			When the total capacity of the indoor units does not match outdoor unit capacity while 3 minutes after power
			ON.
Forecast of cause			Indoor unit selection is incorrect.
			Main PCB failure

Check point 1. Check the total capacity of indoor units

Check the total capacity of the indoor units.

 \rightarrow If abnormal condition is found, correct it referring to the installation manual or DESIGN & TECHNICAL MANUAL.

 \downarrow

Check point 2. Replace the main PCB

If check point 1 does not improve the symptom, replace the main PCB.

 \downarrow

End

2-6. E: 23. Combination error (Outdoor unit)

	Indoor unit	Operation indicator	2 time flash
Indicator		Timer indicator	3 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 23
Detective actuator	Indoor unit		The outdoor unit receives the serial signal of applied
			refrigerant information from indoor unit.
Forecast of cause			Incorrect indoor unit is selected.

Check point 1. Check the type of indoor unit

- Check the type of the connected indoor unit.
 S If there is an observed condition correct it by refer to the instal
 - -> If there is an abnormal condition, correct it by refer to the installation manual or the "DESIGN & TECHNICAL MANAL".

Check point 2. Replace the main PCB

TROUBLESHOOTING

If check point 1 do not improve the symptom, replace the main PCB of the outdoor unit.

 \downarrow

 \downarrow

2-7. E: 26. Address setting error in wired remote controller (Indoor unit)

	Indoor unit	Operation indicator	2 time flash
Indicator		Timer indicator	6 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 26
	Wired remote controller (2		When the address number set by auto setting and
Detective actuator	Indoor unit controller PCB		manual setting are mixed in one remote controller groupWhen the duplicated address number exists in one remote controller group
	•		Wrong wiring of remote controller group
Forecast of cause			Wrong remote controller address setting
			Indoor unit main PCB failure
			Remote controller failure

Check point 1. Wire installation

- Check the wire connection in the remote controller group (For installation method, refer to installation manual)
 - -> If there is an abnormal condition, correct it by refer to the installation manual or the "DESIGN & TECHNICAL MANUAL".

 \downarrow

Check point 2. Wrong remote controller group setting

- The given address number by auto setting (00) and the manual set number (except 00) are not existing in one remote controller group.
- The remote controller address setting by UI is not existing same address.
- The duplicate address number is not existing in one remote controller group.

 \downarrow

Check point 3. Check indoor unit main PCB

- Check if main PCB is damaged.
- Change main PCB and check the error after setting remote controller address.

 \downarrow

2-8. E: 29. Connected unit number error (Indoor unit)

Indicator	Indoor unit	Operation indicator	2 time flash
		Timer indicator	9 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 29
Detective actuator	Detective actuator Wired remote of		When the number of the connected indoor unit exceeds
	Indoor unit main PCB		the limitation.
			Wrong wiring of indoor unit or remote controller
Forecast of cause			Number of indoor unit or remote controller in remote
			controller group
			Indoor unit main PCB failure

Check point 1. Wire installation

- Wrong number of connected indoor unit
 - -> If there is an abnormal condition, correct it by refer to the installation manual or the "DESIGN & TECHNICAL MANUAL".

 \downarrow

Check point 2. Check indoor unit main PCB

- Check if main PCB is damaged.
- Change main PCB and check the error after setting remote controller address.

 \downarrow

2-9. E: 32. Indoor unit main PCB error (Indoor unit)

	Indoor unit	Operation indicator	3 time flash
Indicator		Timer indicator	2 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 32
	Indoor unit	Main PCB	When power is on and there is some below case.
Detective actuator			1. When model information of EEPROM is incorrect.
			2. When the access to EEPROM failed.
			External cause
Forecast of cause			Defective connection of electrical components
			Main PCB failure

Check point 1. Reset power supply and operate

Does error indication show again?

 \rightarrow If no, go to "Check point 1-2".

 \downarrow

Check point 2. Check Indoor unit electrical components

- Check all connectors. (loose connector or incorrect wiring)
- Check any shortage or corrosion on PCB.

 \downarrow

Check point 3. Replace the main PCB

Replace the main PCB.

 \downarrow

End

Check point 1-2. Check external cause such as noise

- Check if the ground connection is proper.
- Check if there is any equipment that causes harmonic wave near the power cable (Neon light bulb or any electronic equipment which causes harmonic wave).

↓ End

NOTE: EEPROM

EEPROM (Electronically Erasable and Programmable Read Only Memory) is a non-volatile memory which keeps memorized information even if the power is turned off. It can change the contents electronically. To change the contents, it uses higher voltage than normal, and it cannot change a partial contents. (Rewriting shall be done upon erasing the all contents.) There is a limit in a number of rewriting.

ROUBLESHOOTING

2-10. E: 33. Indoor unit motor electricity consumption detection error (Indoor unit)

Indicator	Indoor unit	Operation indicator	3 time flash
		Timer indicator	3 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 33
Detective actuator	Indoor unit motor electricity		When the voltage value or the current value of the motor
	consumption detection		go beyond the limits
Forecast of cause			Fan motor failure
l orecasi or cause			Main PCB failure

Check point 1. Check the rotation of fan

TROUBLESHOOTING

Rotate the fan by hand when the operation is off. (Check if fan is caught, drop off or locked motor) \rightarrow If fan or bearing is abnormal, replace it.

Check point 2. Check ambient temperature around the motor

Check excessively high temperature around the motor. (If there is any surrounding equipment that causes heat.)

 \rightarrow Upon the temperature coming down, restart operation.

↓

Check point 3. Check indoor unit fan motor

Check indoor unit fan motor. (Refer to indoor unit fan motor in "Service parts information" on page 03-80.)

 \rightarrow If indoor unit fan motor is abnormal, replace it.

Ţ

 \downarrow

Check point 4. Replace the main PCB

If check point 1-3 does not improve the symptom, replace the main PCB.

 \downarrow

2-11. E: 35. MANUAL AUTO button error (Indoor unit)

Indicator	Indoor unit	Operation indicator	3 time flash
		Timer indicator	5 time flash
mulcator		Economy indicator	Continuous flash
		Error code	E: 35
	Indoor unit con	troller PCB	When the MANUAL AUTO button becomes on for
Detective actuator	Indicator PCB		consecutive 60 or more seconds.
	Manual auto switch		
Forecast of cause			MANUAL AUTO button failure
			Controller PCB and indicator PCB failure

- Check if MANUAL AUTO button is Ω kept pressed.
 - 00
- Check ON/OFF switching opera-

If MANUAL AUTO button is disabled (ON/OFF switching), replace it.

ROUBLESHOOTING

tion by using a meter.

↓

Check point 2. Replace the main PCB and indicator PCB

If Check Point 1 does not improve the symptom, replace the main PCB and indicator PCB.

 \downarrow

2-12. E: 39. Indoor unit power supply error for fan motor (Indoor unit)

	Indoor unit	Operation indicator	3 time flash
Indicator		Timer indicator	9 time flash
muicator		Economy indicator	Continuous flash
		Error code	E: 39
Detective actuator	Indoor unit mai		When a momentary power cut off
Detective actuator indoor un		IIFOD	When do not start fan motor
	•		External cause
Forecast of cause			Connector connection failure
			Main PCB failure

Check point 1. Check external cause at indoor and outdoor (Voltage drop or Noise)

- Instant drop: Check if there is a large load electric apparatus in the same circuit.
- Momentary power failure: Check if there is a defective contact or leak current in the power supply circuit.
- Noise: Check if there is any equipment causing harmonic wave near electric line. (Neon bulb or electric equipment that may cause harmonic wave) Check the complete insulation of grounding.

 \downarrow

Check point 2. Check connection of Connector

- Check if connector is removed.
- Check erroneous connection.
- Check if cable is open.

TROUBLESHOOTING

 \rightarrow Upon correcting the removed connector or mis-wiring, reset the power.

Check point 3. Replace the main PCB

If check point 1 to 2 do not improve the symptom, replace the main PCB.

 \downarrow

↓

2-13. E: 3A. Indoor unit communication circuit (wired remote controller) error

Indicator	Indoor unit	Operation indicator	3 time flash
		Timer indicator	10 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 3A
Detective actuator	Wired remote controller (2-wire)		Detect the communication error of microcomputer and
	Indoor unit controller PCB circuit		communication PCB.
Forecast of cause			Communication PCB defective
			Indoor unit main PCB defective

Check point 1. Check the connection of terminal

 After turning off the power supply, check and correct the followings Indoor unit - Check the connection the communication PCB and the main PCB

Check Point 2 : Replace the communication PCB

 \downarrow

If the Check point 1 is ok, replace the communication PCB

 \downarrow

Check Point 3 : Replace the main PCB

If condition is doesn't change, replace the main PCB

 \downarrow

2-14. E: 41. Room temperature sensor error (Indoor unit)

Indicator	Indoor unit	Operation indicator	4 time flash
		Timer indicator	1 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 41
Detective actuator	Indoor unit main PCB		Room temperature thermistor is open or short is
	Room temperature thermistor		detected always.
Forecast of cause			Connector failure
			Thermistor failure
			Main PCB failure

Check point 1. Check connection of connector

- Check if connector is loose or removed.
- Check erroneous connection.

TROUBLESHOOTING

- Check if thermistor cable is open
- -> Reset power when reinstalling due to removed connector or incorrect wiring.

Check point 2. Remove connector and check thermistor resistance value

• For the room thermistor resistance value, refer to "Thermistor resistance values" on page 03-87.

Ţ

- If thermistor is either open or shorted, replace it and reset the power.
- Check point 3. Check voltage of main PCB

Make sure circuit diagram of each indoor unit and check terminal voltage at thermistor (DC 5.0 V).

↓

NOTE: For details of thermistor connector, refer to "Wiring diagrams" in Chapter 2. TECHNICAL DATA AND PARTS LIST on page 02-19.

If the voltage does not appear, replace main PCB.

 \downarrow



2-15. E: 42. Indoor unit heat exchanger sensor error (Indoor unit)

Indicator	Indoor unit	Operation indicator	4 time flash
		Timer indicator	2 time flash
muicator		Economy indicator	Continuous flash
		Error code	E: 42
	Indoor unit main PCB		When heat exchanger temperature thermistor open or short circuit is detected.
Detective actuator	Heat exchanger temperature thermistor		
			Connector connection failure
Forecast of cause			Thermistor failure
			Main PCB failure

Check point 1. Check connection of connector

- Check if connector is loose or removed.
- Check erroneous connection.

TROUBLESHOOTING

Check if thermistor cable is open

-> Reset power when reinstalling due to removed connector or incorrect wiring.

Check point 2. Remove connector and check thermistor resistance value

• For the heat exchanger thermistor resistance value, refer to "Thermistor resistance values" on page 03-87.

Ţ

• If thermistor is either open or shorted, replace it and reset the power.

Check point 3. Check voltage of main PCB

Make sure circuit diagram of each indoor unit and check terminal voltage at thermistor (DC 5.0 V).

Ţ

NOTE: For details of thermistor connector, refer to "Wiring diagrams" in Chapter 2. TECHNICAL DATA AND PARTS LIST on page 02-19.

If the voltage does not appear, replace main PCB.

 \downarrow

2-16. E: 44. Human sensor error

	Indoor unit	Operation indicator	4 time flash
Indicator		Timer indicator	4 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 44
			1. Detect the open condition of the sensor.
Detective actuator	Indoor unit mai	n PCB	2. When signal from sensor is "L" (0 V) for more than
			20 min.
			Connector connection failure
Forecast of cause			Sensor failure
			Main PCB failure

Check point 1. Check the connector connection and cable open

- Check if connector is loose or removed.
- Check erroneous connection.

TROUBLESHOOTING

- Check if sensor cable is open
 - \rightarrow Reset power when reinstalling due to removed connector or incorrect wiring.

 \downarrow

Check point 2. Check the conduction or voltage

- Conduction check (sensor connections error) Disconnect the sensor and check the 2-3 pin on sensor connector.
 - \rightarrow With conduction: Sensor failure
 - \rightarrow Without conduction: Main PCB failure

Voltage check (sensor signal error)

Disconnect the sensor and check the voltage of 3 pin of the CN10 on the main PCB.

- \rightarrow 5 V: Sensor failure
- \rightarrow Other than 5 V: Main PCB failure

 \downarrow

2-17. E: 51. Indoor unit fan motor error (Indoor unit)

	Indoor unit	Operation indicator	5 time flash
Indicator		Timer indicator	1 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 51
	Indoor unit	Main PCB	When the actual rotation number of the indoor unit fan
Detective actuator		Fan motor	motor is below 1/3 of the target rotation number
			continuously for more than 56 seconds.
			Fan rotation failure
			Fan motor winding open
Forecast of cause			Motor protection by surrounding temperature rise
			Control PCB failure
			Indoor unit fan motor failure

Check point 1. Check rotation of fan

Rotate the fan by hand when operation is off. (Check if fan is caught, dropped off or locked motor) \rightarrow If fan or bearing is abnormal, replace it.

 \downarrow

Check point 2. Check ambient temperature around motor

Check excessively high temperature around the motor. (If there is any surrounding equipment that causes heat)

 \rightarrow Upon the temperature coming down, restart operation.

 \downarrow

Check point 3. Check indoor unit fan motor

Check Indoor unit fan motor. (Refer to indoor unit fan motor in "Service parts information" on page 03-80.)

 \rightarrow If Indoor unit fan motor is abnormal, replace Indoor unit fan motor.

↓

Check point 4. Replace the main PCB

If Check Point 1 to 3 do not improve the symptom, replace the main PCB.

↓

End

ROUBLESHOOTING

2-18. E: 54. Electric air cleaner reverse VDD error (Indoor unit)

Indicator		Operation indicator	5 time flash
	Indoor unit	Timer indicator 4 time flash	4 time flash
mulcalui		Economy indicator	Continuous flash
	Err	Error code	E: 54
Detective actuator	Indoor unit	Plasma air clean unit Main PCB	When the plasma clean operation is off, and the Vmon voltage remains above 2.4 V for 1 minute.
Forecast of cause			Air cleaner assy failure
l olecasi ol cause			Indoor unit main PCB failure

Check point 1. Replace the main PCB

Replace the main PCB.

Check point 2. Replace the air cleaner assy

If Check Point 1 does not improve the symptom, replace the air cleaner assy.

 \downarrow

TROUBLESHOOTING

2-19. E: 62. Outdoor unit main PCB error (Outdoor unit)

Indicator		Operation indicator	6 time flash
	Indoor unit	Timer indicator	2 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 62
Detective actuator	Outdoor unit	Main PCB	Access to EEPROM failed due to some cause after
Delective actuator			outdoor unit started.
Forecast of cause			External cause (Noise, temporary open, voltage drop)
Forecast of cause			Main PCB failure

Check point 1. Reset power supply and operate

 \downarrow

↓

Does error indication show again?

If no, go to "Check point 1-2".

Check point 2. Replace the main PCB

Replace the main PCB.

TROUBLESHOOTING

End

Check point 1-2. Check external cause

- Check if temporary voltage drop was not generated.
- Check if momentary open was not generated.
- Check if ground is connection correctly or there are no related cables near the power line.

 \downarrow

2-20. E: 63. Inverter error (Outdoor unit)

		Operation indicator 6 time flash	6 time flash
Indicator	Indoor unit	Timer indicator	3 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 63
Detective actuator	Outdoor unit	Inverter PCB	Error information received from inverter PCB
Forecast of cause			External cause
			Power supply to inverter PCB wiring disconnection or
			open
			Inverter PCB failure

Check point 1. Turn the power on again?

If no, go to "Check point 1-2".

Error displayed again?

Check point 2. Check the wiring (power supply to inverter PCB)

Connector and wiring connection state check •

↓

 \downarrow

Cable open check

Check point 3. Replace inverter PCB

Replace inverter PCB

↓

End

Check point 1-2. Check external cause

- Check if temporary voltage drop was not generated. •
- Check if momentary open was not generated. •
- Check if ground is connection correctly or there are no related cables near the power line.

 \downarrow

2-21. E: 64. PFC circuit error (Outdoor unit)

		Operation indicator 6 time flash	6 time flash
Indicator	Indoor unit	Timer indicator	4 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 64
Detective actuator	Outdoor unit	Main PCB	 When inverter input DC voltage is higher than 415 V for over 3 seconds, the compressor stops. If the same operation is repeated 5 times, the compressor stops permanently.
Forecast of cause			External cause Connector connection failure
Forecast of cause			Main PCB failure

Check point 1. Check external cause at indoor and outdoor (Voltage drop or Noise)

- Instant drop: Check if there is a large load electric apparatus in the same circuit.
- Momentary power failure: Check if there is a defective contact or leak current in the power supply circuit.
- Noise: Check if there is any equipment causing harmonic wave near electric line. (Neon bulb or electric equipment that may cause harmonic wave) Check the complete insulation of grounding.

 \downarrow

Check point 2. Check connection of Connector

- Check if connector is removed.
- Check erroneous connection.
- Check if cable is open.
- \rightarrow Upon correcting the removed connector or mis-wiring, reset the power.

 \downarrow

Check point 3. Replace the main PCB

If check point 1 to 2 do not improve the symptom, replace the main PCB.

 \downarrow

2-22. E: 65. IPM error (Outdoor unit)

		Operation indicator	6 time flash
Indicator	Indoor unit	Timer indicator	5 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 65
		Main PCB	1. When more than normal operating current to IPM in
Detective actuator	Outdoor unit	Compressor	 main PCB flows, the compressor stops. After the compressor restarts, if the same operation is repeated within 40 seconds, the compressor stops again. If 1. and 2. repeats 5 times, the compressor stops permanently.
Forecast of cause			Defective connection of electrical components
			Outdoor fan operation failure
			Outdoor heat exchanger clogged
			Compressor failure
			Main PCB failure

Check point 1. Check connections of outdoor unit electrical components

- Check if the terminal connection is loose.
- Check if connector is removed.
- Check erroneous connection.
- Check if cable is open.
- \rightarrow Upon correcting the removed connector or mis-wiring, reset the power.

 \downarrow

Check point 2. Check outdoor fan and heat exchanger

- Is there anything obstructing the air distribution circuit?
- Is there any clogging of outdoor heat exchanger?
- Is the fan rotating by hand when operation is off?
- \rightarrow If the fan motor is locked, replace it.

 \downarrow

Check point 3. Check outdoor fan

Check outdoor fan motor. (Refer to "E: 97. Outdoor unit fan motor error (Outdoor unit)" on page 03-56.)

 \rightarrow If the fan motor is failure, replace it.

ROUBLESHOOTING

Check point 4. Check compressor

Check compressor. (Refer to inverter compressor in "Service parts information".)

 \downarrow

Check point 5. Replace main PCB

If Check point 1 to 4 do not improve the symptom, change main PCB.

 \downarrow

2-23. E: 71. Discharge thermistor error (Outdoor unit)

Indicator	Indoor unit	Operation indicator	7 time flash
		Timer indicator	1 time flash
mulcalui		Economy indicator	Continuous flash
		Error code	E: 71
	Outdoor unit main PCB		When discharge pipe temperature thermistor open or
Detective actuator	Discharge pipe temperature		short circuit is detected at power on or while running the
the	thermistor		compressor
			Connector failure
Forecast of cause			Thermistor failure
			Main PCB failure

Check point 1. Check connection of connector

- Check if connector is loose or removed.
- Check erroneous connection.

TROUBLESHOOTING

- Check if thermistor cable is open
- → Reset power when reinstalling due to removed connector or incorrect wiring.

 \downarrow

Check point 2. Remove connector and check thermistor resistance value

- For the discharge temperature thermistor resistance value, refer to "Thermistor resistance values" on page 03-87.
- If thermistor is either open or shorted, replace it and reset the power.

Check point 3. Check voltage of main PCB

Make sure circuit diagram of outdoor unit and check terminal voltage at thermistor (DC 5.0 V).

NOTE: For details of thermistor connector, refer to "Wiring diagrams" in Chapter 2. TECHNICAL DATA AND PARTS LIST on page 02-19.

↓

(09-14 models: P1)

If the voltage does not appear, replace main PCB.

 \downarrow

2-24. E: 72. Compressor thermistor error (Outdoor unit)

Indicator	Indoor unit	Operation indicator	7 time flash
		Timer indicator	2 time flash
mulcalor		Economy indicator	Continuous flash
		Error code	E: 72
Detective actuator	Outdoor unit main PCB		When compressor temperature thermistor open or short
	Compressor temperature thermistor		circuit is detected at power on or while running the compressor
			Connector failure
Forecast of cause			Thermistor failure
			Main PCB failure

Check point 1. Check connection of connector

- Check if connector is loose or removed.
- Check erroneous connection.
- Check if thermistor cable is open
- → Reset power when reinstalling due to removed connector or incorrect wiring.

Check point 2. Remove connector and check thermistor resistance value

• For the compressor thermistor resistance value, refer to "Thermistor resistance values" on page 03-87.

↓

• If thermistor is either open or shorted, replace it and reset the power.

Check point 3. Check voltage of main PCB

Make sure circuit diagram of outdoor unit and check terminal voltage at thermistor (DC 5.0 V).

NOTE: For details of thermistor connector, refer to "Wiring diagrams" in Chapter 2. TECHNICAL DATA AND PARTS LIST on page 02-19.

↓

(09-14 models: P15)

If the voltage does not appear, replace main PCB.

 \downarrow

End

SOUBLESHOOTING

2-25. E: 73. Outdoor unit heat exchanger thermistor error (Outdoor unit)

Indicator	Indoor unit	Operation indicator	7 time flash
		Timer indicator	3 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 73
	Outdoor unit main PCB		When heat exchanger temperature thermistor open or
Detective actuator	Heat exchanger temperature		short circuit is detected at power on or while running the
f	thermistor		compressor
			Connector failure
Forecast of cause			Thermistor failure
			Main PCB failure

Check point 1. Check connection of connector

- Check if connector is loose or removed. •
- Check erroneous connection. •

TROUBLESHOOTING

- Check if thermistor cable is open •
- \rightarrow Reset power when reinstalling due to removed connector or incorrect wiring.

Check point 2. Remove connector and check thermistor resistance value

For the outdoor unit heat exchanger thermistor resistance value, refer to "Ther-• mistor resistance values" on page 03-87.

Ţ

If thermistor is either open or shorted, replace it and reset the power. •

Check point 3. Check voltage of main PCB

Make sure circuit diagram of outdoor unit and check terminal voltage at thermistor (DC 5.0 V).

Ţ

NOTE: For details of thermistor connector, refer to "Wiring diagrams" in Chapter 2. TECHNICAL DATA AND PARTS LIST on page 02-19. If the voltage does not appear, replace main PCB.

↓

2-26. E: 74. Outdoor temperature thermistor error (Outdoor unit)

Indicator	Indoor unit	Operation indicator	7 time flash
		Timer indicator	4 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 74
	Outdoor unit main PCB		When outdoor temperature thermistor open or short
Detective actuator	Outdoor temperature thermistor		circuit is detected at power on or while running the
			compressor
Forecast of cause			Connector failure
			Thermistor failure
			Main PCB failure

Check point 1. Check connection of connector

- Check if connector is loose or removed.
- Check erroneous connection.
- Check if thermistor cable is open
- -> Reset power when reinstalling due to removed connector or incorrect wiring.

Check point 2. Remove connector and check thermistor resistance value

• For the outdoor temperature thermistor resistance value, refer to "Thermistor resistance values" on page 03-87.

↓

Ţ

• If thermistor is either open or shorted, replace it and reset the power.

Check point 3. Check voltage of main PCB

Make sure circuit diagram of outdoor unit and check terminal voltage at thermistor (DC 5.0 V).

NOTE: For details of thermistor connector, refer to "Wiring diagrams" in Chapter 2. TECHNICAL DATA AND PARTS LIST on page 02-19.

(09-14 models: P5)

If the voltage does not appear, replace main PCB.

 \downarrow

End

ROUBLESHOOTIN

2-27. E: 84. Current sensor error (Outdoor unit)

	(Operation indicator	8 time flash
Indicator	Indoor unit	Timer indicator	4 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 84
Detective actuator	Outdoor unit	Main PCB	When input current sensor has detected 0 A, while inverter compressor is operating at higher than 56 rps, after 1 minute upon starting the compressor. (Except during the defrost operation)
			Defective connection of electrical components External cause
Forecast of cause			Main PCB failure

Check point 1. Reset power supply and operate	If no, go to "Check point 1-2".
Does error indication show again?	
↓	1

Check point 2. Check connections of outdoor unit electrical components
Check if the terminal connection is loose.
Check if connector is removed.
Check erroneous connection.
Check if cable is open.

 \downarrow

Check point 3. Replace the main PCB

If Check point 1, 2 do not improve the symptom, replace the main PCB.

↓ End

Check point 1-2. Check external cause at Indoor and Outdoor (Voltage drop or Noise)

- Instant drop: Check if there is a large load electric apparatus in the same circuit.
- Momentary power failure: Check if there is a defective contact or leak current in the power supply circuit.
- Noise: Check if there is any equipment causing harmonic wave near electric line. (Neon bulb or electric equipment that may cause harmonic wave) Check the complete insulation of grounding.

 \downarrow

End

SOUBLESHOOTING

2-28. E: 86. High pressure switch error (Outdoor unit)

Indicator	Indoor unit	Operation indicator	8 time flash
		Timer indicator	6 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 86
Detective actuator	Outdoor unit main PCB		When pressure switch open is detected in 10 seconds
High pressur	High pressure s	switch	after the power is turned on.
			High pressure switch connector disconnection or open
Forecast of cause			High pressure switch characteristics failure
			Main PCB failure

Check point 1. Check the high pressure switch connection state

- Check connector and wiring connection state.
- Check if cable is open
- -> Reset power when reinstalling due to removed connector or incorrect wiring.

Check point 2. Check the high pressure switch characteristics

• Check switch characteristics. For the characteristics of the high pressure switch, refer to below.

 \downarrow

Ţ


Check point 3. Replace main PCB

Change main PCB and check operation again.

 \downarrow

End

• Type of contact



· Characteristics of pressure switch

Pressure switch 1		
Contact: Short \rightarrow Open	4.20 to 4.05 MPa	
Contact: Open \rightarrow Short	3.2 ±0.15 MPa	

09-14 models: P20

2-29. E: 94. Trip detection (Outdoor unit)

Indicator Indoor unit	Operation indicator	9 time flash	
	Indoor unit	Timer indicator	4 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 94
			Protection stop by over-current generation after inverter
Detective actuator Outdoor unit	Outdoor unit	0	compressor start processing completed generated consecutively 10 times.
	Compressor	NOTE: The number of generations is reset when the compressor starts up.	
		•	Outdoor unit fan operation defective, foreign matter on
Forecast of cause			heat-exchanger, excessive rise of ambient temperature
			Main PCB failure
			Inverter compressor failure (lock, winding short)

Check point 1. Check the outdoor unit fan operation, heat-exchanger, ambient temperature

- No obstructions in air passages?
- Heat exchange fins clogged
- Outdoor unit fan motor check
- Ambient temperature not raised by the effect of other heat sources?
- Discharged air not sucked in?

 \downarrow

Check point 2. Replace the main PCB

If Check point 1 do not improve the symptom, replace the main PCB.

 \downarrow

Check point 3. Replace compressor

If Check point 2 do not improve the symptom, change compressor.

 \downarrow

End

ROUBLESHOOTING

2-30. E: 95. Compressor motor control error (Outdoor unit)

Indicator	Indoor unit	Operation indicator	9 time flash
		Timer indicator	5 time flash
mulcalui		Economy indicator	Continuous flash
		Error code	E: 95
		Main PCB	1. When running the compressor, if the detected rotor
Detective actuator	Outdoor unit	Compressor	 location is out of phase with actual rotor location more than 90°, the compressor stops. 2. After the compressor restarts, if the same operation is repeated within 40 seconds, the compressor stops again. 3. If 1. and 2. repeats 5 times, the compressor stops permanently.
Forecast of cause			Defective connection of electrical components Main PCB failure
			Compressor failure

TROUBLESHOOTING

Check point 1. Check Noise from Compressor
Turn on Power and check operation noise. \rightarrow If an abnormal noise show, replace compres-
sor.

 \downarrow

Check point 2. Check connection of around the compressor components

For compressor terminal, main PCB

- Check if connector is removed.
- Check erroneous connection.
- Check if cable is open. (Refer to inverter compressor in "Service parts information" on page 03-80.)

 \rightarrow Upon correcting the removed connector or mis-wiring, reset the power.

 \downarrow

Check point 3. Replace the main PCB

If Check point 1, 2 do not improve the symptom, replace the main PCB.

 \downarrow

Check point 4. Replace compressor

If Check point 3 do not improve the symptom, change compressor.

 \downarrow

End

ROUBLESHOOTING

2-31. E: 97. Outdoor unit fan motor error (Outdoor unit)

la dia stan	Indoor unit	Operation indicator	9 time flash
		Timer indicator	7 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: 97
		Main PCB	1. When outdoor fan rotation speed is less than 100
Detective actuator	Outdoor unit	Fan motor	 rpm in 20 seconds after fan motor starts, fan motor stops. 2. After fan motor restarts, if the same operation within 60 seconds is repeated 3 times in a row, compressor and fan motor stops. 3. If 1. and 2. repeats 5 times in a row, compressor and fan motor stops permanently.
Forecast of cause			Fan rotation failure Motor protection by surrounding temperature rise Main PCB failure Outdoor unit fan motor

Check point 1. Check rotation of fan

Rotate the fan by hand when operation is off. (Check if fan is caught, dropped off or locked motor) \rightarrow If fan or bearing is abnormal, replace it.

\downarrow

Check point 2. Check ambient temperature around motor

Check excessively high temperature around the motor. (If there is any surrounding equipment that causes heat)

 \rightarrow Upon the temperature coming down, restart operation.

Check point 3. Check outdoor unit fan motor

↓

Check outdoor unit fan motor. (Refer to outdoor unit fan motor in "Service parts information" on page 03-80.)

 \rightarrow If outdoor unit fan motor is abnormal, replace outdoor unit fan motor and main PCB.

 \downarrow

Check point 4. Check output voltage of main PCB

Check outdoor unit circuit diagram and the voltage. (Measure at main PCB side connector)

NOTE: For details of wiring diagram, refer to "Wiring diagrams" in Chapter 2. TECHNICAL DATA AND PARTS LIST on page 02-19.

	DC	
$\left \right\rangle$	\bigotimes	

Read wire	DC voltage
Red—Black	306—374 V
White—Black	15 ±1.5 V

-> If the voltage is not correct, replace Main PCB.

 \downarrow

2-32. E: 99. 4-way valve error (Outdoor unit)

Indicator	Indoor unit	Operation indicator	9 time flash
		Timer indicator	9 time flash
muicator		Economy indicator	Continuous flash
		Error code	E: 99
	Indoor unit	main PCB	When the indoor heat exchanger temperature is
	Heat exchanger temperature		compared with the room temperature, and either
	thermistor		following condition is detected continuously two times,
	Room temperature thermistor		the compressor stops.
Detective actuator	4-way valve		Indoor heat exchanger temp Room temp. > 10°C (Cooling or Dry operation)
			Indoor heat exchanger temp Room temp. < -10°C (Heating operation)
			If the same operation is repeated 5 times, the
			compressor stops permanently.
Forecast of cause			Connector connection failure
			Thermistor failure
			Coil failure
			4-way valve failure
			Main PCB failure

Check point 1. Check connection of connector

- Check if connector is removed.
- Check erroneous connection.
- Check if thermistor cable is open.
- \rightarrow Upon correcting the removed connector or mis-wiring, reset the power.

 \downarrow

Check point 2. Check each thermistor

- Isn't it fallen off the holder?
- Is there a cable pinched?

Check characteristics of room thermistor and indoor unit heat exchanger thermistor. For the thermistor resistance value, refer to "Thermistor resistance values" on page 03-87. \rightarrow If defective, replace the thermistor.

 \downarrow

ROUBLESHOOTING

Check point 3. Check the solenoid coil and 4-way valve

NOTE: Refer solenoid coil and 4-way valve in "Service parts information" on page 03-80.

Solenoid coil

Remove P60 from PCB and check the resistance value of coil. Resistance value is 2.085 k Ω (at 20°C).

 \rightarrow If it is open or abnormal resistance value, replace solenoid coil.

• 4-way valve

Check each piping temperature, and the location of the valve by the temperature difference. If the value location is not proper, replace 4-way valve.

Check point 4. Replace main PCB

If Check Point 1 to 3 do not improve the symptom, replace main PCB.

↓ End

 \downarrow

2-33. E: A1. Discharge temperature error (Outdoor unit)

	Indoor unit	Operation indicator	10 time flash
Indicator		Timer indicator	1 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: A1
	Outdoor unit main PCB Discharge temperature thermistor		Protection stop by discharge temperature ≥ 110°C
Detective actuator			during compressor operation generated 2 times within 24 hours.
			3-way valve not opened
			EEV or capillary tube defective, strainer clogged
			Outdoor unit operation failure, foreign matter on heat
Forecast of cause			exchanger
			Discharge temperature thermistor failure
			Insufficient refrigerant
			Main PCB failure

Check point 1. Check if 3-way valve is open

If the 3-way valve is closed, open the 3-way valve and check operation.

- NOTE: For cooling operation, check gas side of the 3-way valve.
 - For heating operation, check liquid side of the 3-way valve.

 \downarrow

Check point 2. Check any of the electronic expansion valve (EEV), capillary tube, or strainer, or all

- Check if EEV open or there is a capillary tube defect. Refer to outdoor unit Electronic Expansion Valve (EEV) or Capillary tube in "Service parts information" on page 03-80.
- Check the strainer clogging.

 \downarrow

Check point 3. Check the outdoor unit fan and heat exchanger

- Check for foreign object at heat exchanger
- Check if fan can be rotated by hand.
- Check the motor. (Refer to outdoor unit fan motor in "Service parts information" on page 03-80.)

 \downarrow

Check point 4. Check the discharge thermistor

The discharge temperature thermistor characteristics check. (Check by disconnecting thermistor from PCB.)

NOTE: For the characteristics of the thermistor, refer to "Thermistor resistance values" on page 03-87.

Check point 5. Check the refrigerant amount

Check the refrigerant leakage.

 \downarrow

Check point 6. Replace the main PCB

If check point 1 to 5 do not improve the symptom, replace the main PCB.

 \downarrow

2-34. E: A3. Compressor temperature error (Outdoor unit)

	Indoor unit	Operation indicator	10 time flash
Indicator		Timer indicator	3 time flash
Indicator		Economy indicator	Continuous flash
		Error code	E: A3
	Outdoor unit main PCB		Protection stop by compressor temperature ≥ 108°C
Detective actuator	Compressor temperature thermistor		during compressor operation generated 2 times within 24 hours.
			3-way valve not opened
			EEV defective, strainer clogged
			Outdoor unit operation failure, foreign matter on heat
Forecast of cause			exchanger
			Compressor temperature thermistor failure
			Insufficient refrigerant
			Main PCB failure

Check point 1. Check if 3-way valve is open

If the 3-way valve is closed, open the 3-way valve and check operation.

- NOTE: For cooling operation, check gas side of the 3-way valve.
 - For heating operation, check liquid side of the 3-way valve.

 \downarrow

Check point 2. Check the electronic expansion valve (EEV) and strainer

- Check if EEV open.
 Refer to outdoor unit Electronic Expansion Valve (EEV) in "Service parts information" on page 03-80.
- Check the strainer clogging.

 \downarrow

Check point 3. Check the outdoor unit fan and heat exchanger

- Check for foreign object at heat exchanger
- Check if fan can be rotated by hand.
- Check the motor. (Refer to outdoor unit fan motor in "Service parts information" on page 03-80.)

 \downarrow

Check point 4. Check the compressor thermistor

The compressor temperature thermistor characteristics check. (Check by disconnecting thermistor from PCB.)

NOTE: For the characteristics of the thermistor, refer to "Thermistor resistance values" on page 03-87.

Check point 5. Check the refrigerant amount

Check the refrigerant leakage.

 \downarrow

Check point 6. Replace the main PCB

If check point 1 to 5 do not improve the symptom, replace the main PCB.

 \downarrow

3. Troubleshooting without error code

3-1. Indoor unit—No power

	Power supply failure
Forecast of cause	External cause
	Electrical components defective

Check point 1. Check installation condition

- Isn't the breaker down?
- Check loose or removed connection cable.

-> If abnormal condition is found, correct it by referring to the installation manual or the "DESIGN & TECHNICAL MANUAL".

Check point 2. Check external cause at indoor and outdoor (voltage drop or noise)

↓

- Instant drop: Check if there is a large load electric apparatus in the same circuit.
- Momentary power failure: Check if there is a defective contact or leak current in the power supply circuit.
- Noise: Check if there is any equipment causing harmonic wave near electric line. (Neon bulb or electric equipment that may cause harmonic wave) Check the complete insulation of grounding.

 \downarrow

Check point 3. Check electrical components

Check the voltage of power supply.

Check if AC 207 to 253 V appears at outdoor unit terminal L—N. -> If no, go to "Check point 1" and "Check point 2".



ROUBLESHOOTIN

 \downarrow

- Check fuse in filter PCB.
 If fuse is open, check if the wiring between terminal and filter PCB is loose, and replace fuse.
 Check varistor in filter PCB.
- If varistor is defective, there is a possibility of an abnormal power supply. Check the correct power supply and replace varistor. Upon checking the normal power supply, replace varistor.

 \downarrow

3-2. Outdoor unit—No power

	Power supply failure
Forecast of cause	External cause
	Electrical components defective

Check point 1. Check installation condition

Is the circuit breaker on or off?

TROUBLESHOOTING

Check loose or removed connection cable.

→ If abnormal condition is found, correct it by referring to the installation manual or the "DESIGN & TECHNICAL MANUAL".

Check point 2. Check external cause at indoor and outdoor (voltage drop or noise)

Instant drop: Check if there is a large load electric apparatus in the same circuit. •

↓

- Momentary power failure: Check if there is a defective contact or leak current in the power sup-• ply circuit.
- Noise: Check if there is any equipment causing harmonic wave near electric line. (Neon bulb or electric equipment that may cause harmonic wave) Check the complete insulation of grounding.

↓

Check point 3. Check electrical components

Check the voltage of power supply.

Check if AC 207 to 253 V appears at outdoor unit terminal L-N

 \rightarrow If no, go to "Check point 1" and "Check point 2".

- Check fuse in main PCB. If fuse is open, check if the wiring between terminal and main PCB is loose, and replace fuse.
- Check varistor in main PCB. If varistor is defective, there is a possibility of an abnormal power supply. Check the correct power supply and replace varistor.

 \rightarrow Upon checking the normal power supply, replace varistor.

Check point 4. Replace the main PCB

If check point 1 to 3 do not improve the symptom, replace the main PCB.

End



 \downarrow

Ţ

↓

3-3. No operation (Power is on)

Forecast of cause	Setting/ Connection failure
	External cause
	Electrical components defective

Check point 1. Check indoor and outdoor installation condition

- Indoor unit:
 - Check incorrect wiring between indoor unit and remote controller.
 - Check if there is an open cable connection.
- Are these indoor unit, outdoor unit, and remote controller suitable model names to connect?

-> If there is some abnormal condition, correct it by referring to the installation manual and "DESIGN & TECHNICAL MANUAL".

Turn off the power and check correct followings.

• Is there loose or removed communication line of indoor unit and outdoor unit?

↓

Check point 2. Check external cause at indoor and outdoor (Voltage drop or Noise)

↓

- Instant drop: Check if there is a large load electric apparatus in the same circuit.
- Momentary power failure: Check if there is a defective contact or leak current in the power supply circuit.
- Noise: Check if there is any equipment causing harmonic wave near electric line. (Neon bulb or electric equipment that may cause harmonic wave) Check the complete insulation of grounding.

 \downarrow

Check point 3. Check wired remote controller and controller PCB

Check voltage at CN2 (terminal 1—3) of Communication Kit.

(Power supply to remote controller)

- If it is DC 5 V, remote controller is failure. (The controller PCB is normal)
 -> Replace remote controller.
- If it is DC 0 V, controller PCB is failure. (Check the remote controller once again)
 - -> Replace controller PCB.

 \downarrow

Check point 4. Replace main PCB

If check point 1 to 3 do not improve the symptom, change main PCB.

↓

End

3-3. No operation (Power is on)

TROUBLESHOOTING

3-4. No cooling/No heating

Forecast of cause	Indoor unit error
	Outdoor unit error
	Effect by surrounding environment
	Connection pipe/Connection wire failure
	Refrigeration cycle failure

- Does Indoor unit fan run in the HIGH mode? •
- Is air filter dirty? •

ROUBLESHOOTING

- Is heat exchanger clogged? •
- Check if energy save function is operated.

↓

↓

Ţ

Check point 2. Check outdoor unit operation

- Check if outdoor unit is operating. •
- Check any objects that obstruct the air flow route. •
- Check if heat exchanger is clogged. •
- Is the valve open?

Check point 3. Check site condition

- Is capacity of Indoor unit fitted to the room size?
- Any windows open or direct sunlight?

Check point 4. Check indoor/outdoor installation condition

- Check connection pipe (specified pipe length and pipe diameter?)
- Check any loose or removed communication line.

 \rightarrow If there is an abnormal condition, correct it by referring to the installation manual or the "DESIGN & TECHNICAL MANUAL".

Check point 5. Check Refrigeration cycle

- Check if strainer is clogged (Refer to the figure below).
- Measure gas pressure, and if there is a leakage, correct it. •
- Check if EEV open or there is a capillary tube defect. Refer to outdoor unit Electronic Expansion Valve (EEV) or Capillary tube in "Service parts information" on page 03-80.

Check compressor. • Refer to compressor in "Service parts information" on page 03-80. Refer to inverter compressor in "Service parts information" on page 03-80.

NOTE: When recharging the refrigerant, make sure to perform vacuuming, and recharge the specified amount.

End

3. Troubleshooting without error code

(MPa

MPa)


↓




NOTES:

TROUBLESHOOTING

• Strainer normally does not have temperature difference between inlet and outlet as shown below.

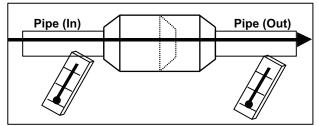

• If there is a difference like shown below, there is a possibility of inside clogged. In this case, replace the strainer.

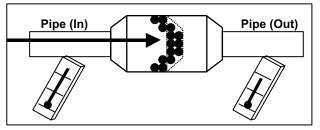

3-5. Abnormal noise

Forecast of cause	Abnormal installation (indoor unit/outdoor unit) Fan failure (indoor unit/outdoor unit) Compressor failure (outdoor)	
Diagnosis method wher	abnormal noise is occurred	
Abnormal noise is coming from Indoor unit. (Check and correct followings)	Abnormal noise is coming from Outdoor unit. (Check and correct followings)	
\downarrow	\downarrow	
 Is main unit installed in stable condition? Is the installation of air suction grille and front panel normal? 	 Is main unit installed in stable condition? Is fan guard installed normally? 	
↓	↓	
 Is fan broken or deformed? Is the screw of fan loose? Is there any object which obstruct the fan rotation? 	 Is fan broken or deformed? Is the screw of fan loose? Is there any object which obstruct the fan rotation? 	
↓ End	↓ Check if vibration noise by loose bolt or contact noise of piping is happening.	
	↓	
	 Is compressor locked? Check Compressor Refer to compressor and inverter com- pressor in "Service parts information" on page 03-80. 	
	\downarrow	

End

TROUBLESHOOTING

3-6. Water leaking

Forecast of cause	Erroneous installation
	Drain hose failure
Diagnosis method when water leak occurs	Diagnosis method when water is spitting out
 Is main unit installed in stable condition? Is main unit broken or deformed at the time of transportation or maintenance? 	Is the filter clogged?
\downarrow	\downarrow
 Is drain hose connection loose? Is there a trap in drain hose? Is drain hose clogged? 	Check gas pressure and cor- rect it if there was a gas leak.
\downarrow	\downarrow
Is fan rotating?	End
↓	
End	

3-7. Air cleaner assy does not work properly

Forecast of cause	Air cleaner assy is wet or dirty
	Air cleaner assy failure

Check point 1. Check the state of the Air cleaner assy.

• If the Air cleaner assy is dirty, clean it.

• If the Air cleaner assy is wet, dry it.

 \downarrow

Check point 2. Replace the Air cleaner assy.

If Check point 1 does not improve the symptom, replace the Air cleaner assy.

 \downarrow

End

3-8. Intake grille closing failure

Forecast of cause	Intake grille is not tightly closed
	Intake grille assy failure

Check point 1. Check the Intake grille is closed securely.

- If the Intake grille is not tightly closed, close it.
- After closing, restart the operation and check for errors.

 \downarrow

Check point 2. Check the condition of the Intake grille.

Check if the projection on the back of the Intake grille, which presses the limit switch, is not broken. If the projection is broken, replace the Intake grille assy.

NOTE: If the projection is not broken and the limit switch is pressed correctly, you will hear a slight click when closing the grille.

End

4. Troubleshooting with error code (For wireless LAN adapter)

4-1. E: 18. External communication error between indoor unit and wireless LAN adapter

	Operation indicator	1 time flash	
	Timer indicator	8 time flash	
Indoor unit	Economy indicator	Continuous flash	
Indicator	Wireless LAN indicator	Flashing slowly	
	Error code	E: 18	
Mobile app		E: 18.1	
Wireless LAN adapter PCB		After receiving a signal from the wireless LAN adapter,	
r Controller PCB		the same signal has not been received for 15 seconds.	
		Outdoor unit Parts: WIRELESS LAN WIRELESS CLOUD Mobile App MODIFER Router Router (Mobile device)	
Forecast of cause		Connection between indoor unit and wireless LAN adapter failure	
		Wireless LAN adapter PCB failure Controller PCB failure	
	Wireless LAN a	ndoor unit Mobile app Mireless LAN adapter PCB	

Check point 1. Check the connection

TROUBLESHOOTING

- Check any loose or removed connection of between the wireless LAN adapter PCB and controller PCB.
 - -> If there is abnormal condition, correct it.
- Check the connection condition on the controller PCB.
 -> If there is loose connector, open cable or mis-wiring, correct it.

 \downarrow

Check point 2. Replace wireless LAN adapter.

If check point 1 do not improve the symptom, replace the wireless LAN adapter and cancel the registration of air conditioner on the Mobile app.

After replacing the adapter, perform the pairing on the Mobile app.

For the method of the Mobile app, refer to "Mobile app setting method" on page 03-78.

 \downarrow

Check point 3. Replace controller PCB

If check point 1 to 2 do not improve the symptom, replace the controller PCB.

 \downarrow

End

4-2. Network communication error between wireless LAN router and wireless LAN adapter

		Operation indicator	No indication	
	Timer indicator No indication			
	Indoor unit	Economy indicator	No indication	
Indicator		Wireless LAN indicator	Flashing slowly	
		Error code	—	
	Mobile app		No indication	
	Wireless LAN	router	When the not connection between wireless LAN adapter	
			and wireless LAN router.	
			NG NG	
Detective actuator			Outdoor unit PCB PCB PCB PCB PCB PCB Parts: WIRELESS LAN ADAPTER Router COULD Server (Mobile App (Mobile device)	
Forecast of cause			Connection cable failure of wireless LAN router	
			Connection between wireless LAN adapter and wireless	
			LAN router failure	
			Wireless LAN router failure	
			Wireless LAN adapter PCB failure	

Check point 1. Check the connection cable

TROUBLESHOOTING

Check the connection cable on the wireless LAN router.

-> If there is loose connector, open cable or mis-wiring, correct it.

Check point 2. Check the connection status.

Check the connection status to the Internet and wireless LAN router.

-> If the wireless LAN router is not connected to the Internet, check the transmission between wireless LAN products (ex. PC or game console, etc.) other than air conditioner and wireless LAN router.

↓

If no, go to "Check point 2-2".

 \downarrow

Check point 3. Turn on the power again of air conditioner.

If check point 1 to 2 do not improve the symptom, turn on the power of the air conditioner again and wait for 60 seconds.

 \downarrow

Check point 4. Replace wireless LAN adapter.

If check point 3 do not improve the symptom, replace the wireless LAN adapter and cancel the registration of air conditioner on the Mobile app.

↓

End

After replacing the adapter, perform the pairing on the Mobile app.

For the method of the Mobile app, refer to "Mobile app setting method" on page 03-78.

TROUBLESHOOTING

Check point 2-2. Check the transmission state

Check the wireless transmission state pf the wireless LAN router (indicator lamp status). -> If the wireless transmission from the wireless LAN router has not been outgoing, inquire to the wireless LAN router maker.

Ļ

End

4-3. E: 18. Communication error

		Operation indicator	1 time flash	
		Timer indicator	8 time flash	
	Indoor unit	Economy indicator	Continuous flash	
Indicator		Wireless LAN indicator	Flashing slowly	
		Error code	E: 18	
	Mobile app		E: 18.1	
	Wireless LAN r	outer	When the external communication error between indoor	
	Wireless LAN a	adapter PCB	unit and wireless LAN adapter and network	
			communication error between wireless LAN router and wireless LAN adapter has occurred simultaneously.	
Detective actuator	Indoor unit controller PCB		NG NG NG Indoor unit Controller PCB Outdoor unit Parts: WIRELESS LAN ADAPTER NG NG Internet WIRELESS LAN Router (Mobile App (Mobile device)	
			Connection cable failure of wireless LAN router	
			Wireless LAN router failure	
			Connection between indoor unit and wireless LAN adapter failure	
Forecast of cause			Connection between wireless LAN adapter and wireless	
			LAN router failure	
			Wireless LAN adapter PCB failure	
			Controller PCB failure	

Check point 1. Check the connection

- Check any loose or removed connection of between the wireless LAN adapter PCB and controller PCB.
 - -> If there is abnormal condition, correct it.
- Check the connection condition on the controller PCB.
 -> If there is loose connector, open cable or mis-wiring, correct it.

↓

Check point 2. Replace wireless LAN adapter.

If check point 1 do not improve the symptom, replace the wireless LAN adapter and cancel the registration of air conditioner on the Mobile app.

After replacing the adapter, perform the pairing on the Mobile app.

For the method of the Mobile app, refer to "Mobile app setting method" on page 03-78.

 \downarrow

Check point 3. Replace controller PCB

If check point 1 to 2 do not improve the symptom, replace the controller PCB.

 \downarrow

Check point 4. Check the connection cable

Check the connection cable on the wireless LAN router. -> If there is loose connector, open cable or mis-wiring, correct it.

↓

Check point 5. Check the connection status.

Check the connection status to the Internet and wireless LAN router. -> If the wireless LAN router is not connected to the Internet, check the transmission between wireless LAN products (ex. PC or game console, etc.) other than air conditioner and wireless LAN router.

If no, go to "Check point 5-2".

Check point 6. Turn on the power again of air conditioner.

If check point 1 to 2 do not improve the symptom, turn on the power of the air conditioner again and wait for 60 seconds.

↓

Ţ

Check point 7. Replace wireless LAN adapter.

If check point 3 do not improve the symptom, replace the wireless LAN adapter and cancel the registration of air conditioner on the Mobile app.

Ţ

End

After replacing the adapter, perform the pairing on the Mobile app.

For the method of the Mobile app, refer to "Mobile app setting method" on page 03-78.

Check point 5-2. Check the transmission state

Check the wireless transmission state pf the wireless LAN router (indicator lamp status). -> If the wireless transmission from the wireless LAN router has not been outgoing, inquire to the wireless LAN router maker.

End

4-4. E: 18. Wireless LAN adapter non-energized

			1 time flash	
	Timer indicator	8 time flash		
	Indoor unit	Economy indicator	Continuous flash	
Indicator		Wireless LAN	No indication	
		indicator		
		Error code	E: 18	
	Mobile app		No indication	
Detective actuator	Indoor unit controller PCB		When the voltage (DC 12 V) does not output from the	
	Wireless LAN adapter PCB		controller PCB.	
Forecast of cause			Indoor unit controller PCB failure	
			Wireless LAN adapter PCB failure	
			Wiring connection failure	

Check point 1. Check the connection.

- Check any loose or removed connection of between the wireless LAN adapter PCB and controller PCB.
 - -> If there is abnormal condition, correct it.
- Check the connection condition on the controller PCB.
 -> If there is loose connector, open cable or mis-wiring, correct it.

 \downarrow

Check point 2. Check the wireless LAN adapter PCB and the controller PCB
Check voltage at CN13 (terminal 1—3) of main PCB. (Power supply to remote controller)
If it is DC 0 V, controller PCB is failure. -> Replace controller PCB.
If it is DC 12 V, wireless LAN adapter PCB is failure. -> Replace the wireless LAN adapter and cancel the registration of air conditioner on the Mobile app. After replacing the adapter, perform the pairing on the Mobile app.
For the method of the Mobile app, refer to "Mobile app setting method" on page 03-78.

 \downarrow

End

4-5. Mobile app setting method

When the wireless LAN adapter is replaced, delete of all air conditioner is necessary on the mobile app.

1. Launch the mobile app.


TROUBLESHOOTING




2. Tap the icon to display the Setting screen.



3. Tap the "Air conditioner editing".

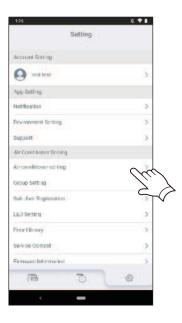


4. Tap the air conditioner to be deleted.

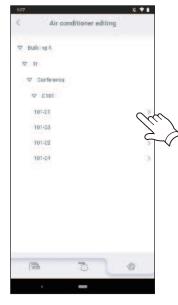

5. Tap the Delete button.

TROUBLESHOOTING

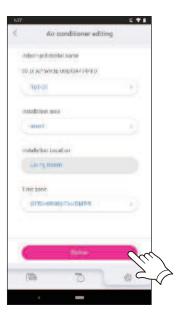


6. Tap the OK button.




7. Deletion of the air conditioner registered in the mobile app is completed.

5. Service parts information

5-1. Compressor

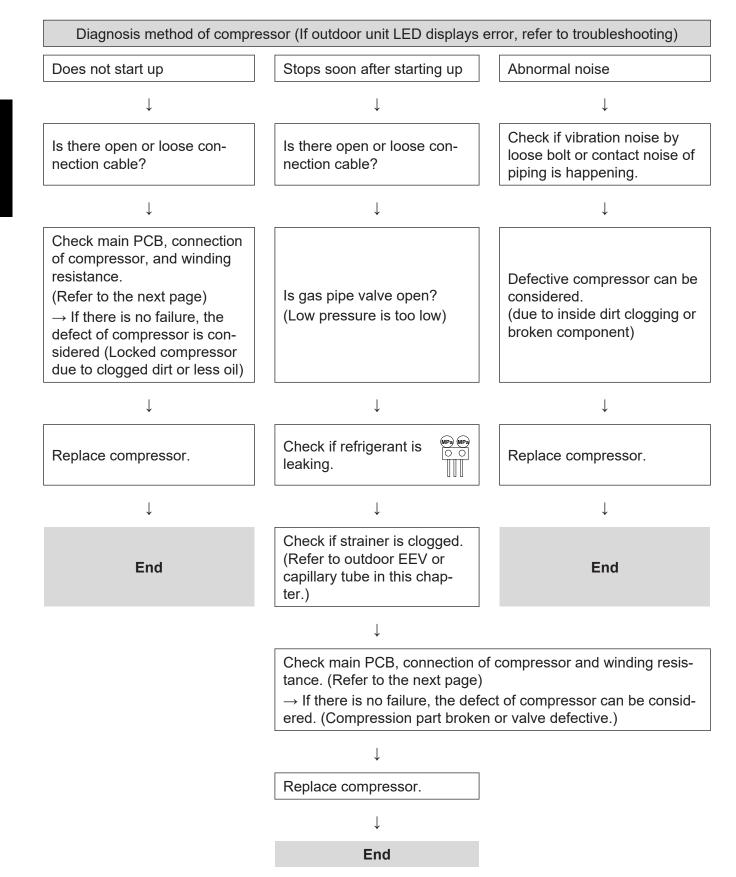

5-2. Inverter compressor

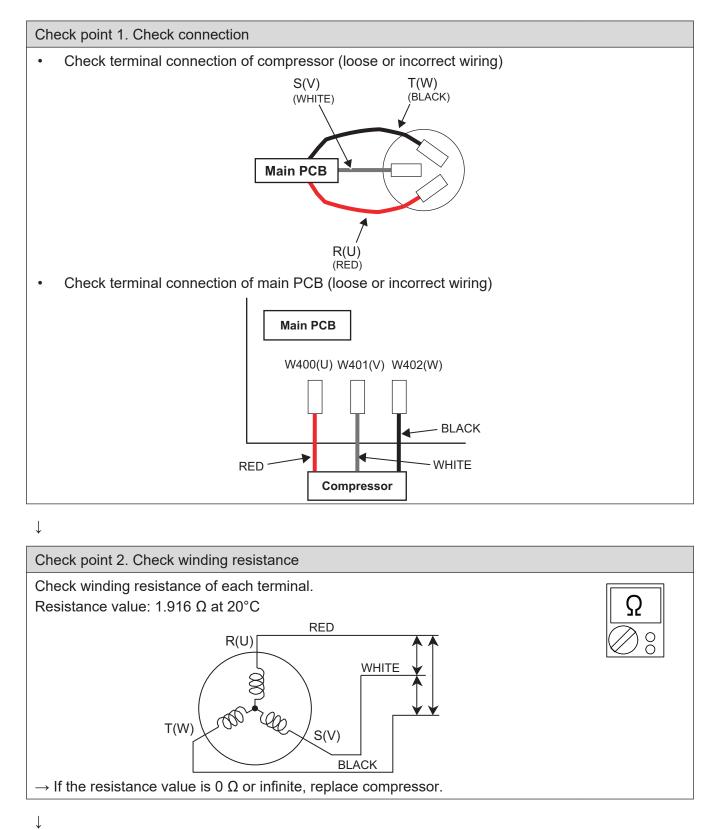

Check point 3. Replace inverter PCB

If check point 1 to 2 do not improve the symptom, replace main PCB.

SOUBLESHOOTING

5-3. Outdoor unit Electronic Expansion Valve (EEV)

Check point 1. Check connections

Check connection of connector. (Loose connector or open cable)

NOTE: For details of wiring diagram, refer to "Wiring diagrams" in Chapter 2. TECHNICAL DATA AND PARTS LIST on page 02-19.

Check point 2. Check coil of EEV

Remove connector, check each winding resistance of coil.

Read wire	Resistan	ce value
1 (Red)—2 (Blue)		
1 (Red)—3 (Orange)	46 Ω	Ω
1 (Red)—4 (Yellow)	at 20°C	$\bigcirc \circ$
1 (Red)—5 (White)		\bigvee 0

 \rightarrow If Resistance value is abnormal, replace EEV.


Check point 3. Check Voltage from main PCB

Remove connector and check voltage (DC 12 V) \rightarrow If it does not appear, replace main PCB.

Check point 4. Check noise at start up


Turn on the power and check the operation noise.

 \rightarrow If an abnormal noise does not show, replace main PCB.

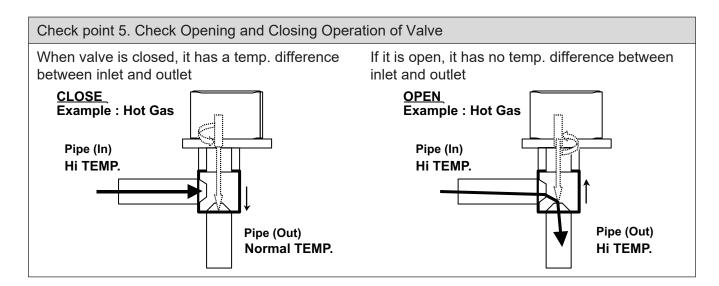


Check point 6. Check strainer

• Strainer normally does not have temperature difference between inlet and outlet as shown below.

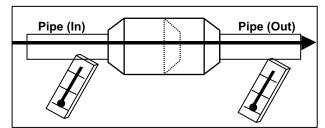

• If there is a difference like shown below, there is a possibility of inside clogged. In this case, replace the strainer.

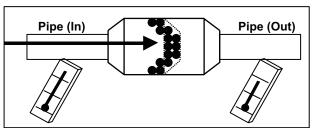

5-4. Indoor unit fan motor

Check point 1. Check rotation of fan

TROUBLESHOOTING


Rotate the fan by hand when operation is off. (Check if fan is caught, dropped off or locked motor) \rightarrow If fan or bearing is abnormal, replace it.

Check point 2. Check resistance of indoor fan motor

Refer to below. Circuit-test "Vm" and "GND" terminal **NOTE:** Vm: DC voltage, GND: Earth terminal

 \rightarrow If they are short-circuited (below 300 k Ω), replace indoor fan motor and controller PCB.

Pin number (wire color)	Terminal function (symbol)
1 (Red)	DC voltage (Vm)
2	No function
3	No function
4 (Black)	Earth terminal (GND)
5 (White)	Control voltage (Vcc)
6 (Yellow)	Speed command (Vsp)
7 (Blue)	Feed back (FG)
•	•

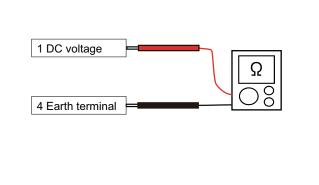

5-5. Outdoor unit fan motor

Check point 1. Check rotation of fan

Rotate the fan by hand when operation is off. (Check if fan is caught, dropped off or locked motor) \rightarrow If fan or bearing is abnormal, replace it.

Check point 2. Check resistance of outdoor fan motor

Refer to below. Circuit-test "Vm" and "GND" terminal **NOTE:** Vm: DC voltage, GND: Earth terminal


 \rightarrow If they are short-circuited (below 300 k Ω), replace outdoor fan motor and controller PCB.

Pin number (wire color)	Terminal function (symbol)
1 (Red)	DC voltage (Vm)
2	No function
3	No function
4 (Black)	Ground terminal (GND)
5 (White)	Control voltage (Vcc)
6 (Yellow)	Speed command (Vsp)
7 (Blue)	Feed back (FG)

5-6. Pressure switch

• Type of contact

TROUBLESHOOTING




· Characteristics of pressure switch

Pressure switch 1			
Contact: Short \rightarrow Open 4.2 — 4.05 MPa			
Contact: Open \rightarrow Short	3.2 ± 0.15 MPa		

09-14 models: P20

5-7. 4-way valve coil (solenoid coil)/4-way valve

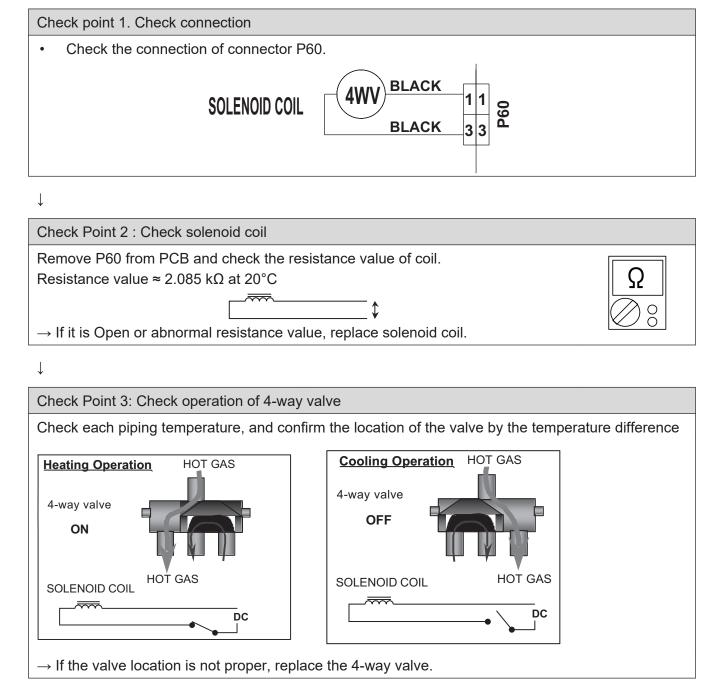

Check Point 4: Replace Main PCB If none of Checks 1 to 3 apply, replace the Main PCB.

SOUBLESHOOTING

6. Thermistor resistance values

6-1. Indoor unit

TROUBLESHOOTING

Room temperature thermistor

Temperature (°C)	Resistance (kΩ)	Voltage (V)		
-10.0	58.2 0.73			
-5.0	44.0	0.93		
0.0	33.6	1.15		
5.0	25.9	1.39		
10.0	20.2	1.66		
15.0	15.8	1.94		
20.0	12.5	2.22		
25.0	10.00	2.50		
30.0	8.0	2.77		
35.0	6.5	3.03		
40.0	5.3	3.27		
45.0	4.4 3.49			

Heat exchanger temperature thermistor

Temperature (°C)	Resistance (kΩ)	Voltage (V)
-30.0	1,131.9	0.21
-25.0	804.5	0.29
-20.0	579.6	0.40
-15.0	422.9	0.53
-10.0	312.3	0.69
-5.0	233.2	0.88
0.0	176.0	1.10
5.0	134.2	1.36
10.0	103.3	1.63
15.0	80.3	1.92
20.0	62.9	2.21
25.0	49.7	2.51
30.0	39.6	2.79
35.0	31.7	3.06
40.0	25.6	3.30
45.0	20.8	3.53
50.0	17.1	3.73
55.0	14.1	3.90
60.0	11.6	4.05
63.0	10.4	4.14

6-2. Outdoor unit

TROUBLESHOOTING

Discharge temperature thermistor

-30.0 $1,013.11$ 0.06 -25.0 729.09 0.09 -20.0 531.56 0.12 -15.0 392.31 0.16 -10.0 292.91 0.21 -5.0 221.09 0.28 0.0 168.60 0.36 5.0 129.84 0.46 10.0 100.91 0.57 15.0 79.12 0.71 20.0 62.55 0.86 25.0 49.84 1.03 30.0 40.01 1.23 35.0 32.35 1.43 40.0 26.34 1.65 45.0 21.58 1.88 50.0 17.79 2.11 55.0 14.75 2.34 60.0 12.30 2.57 65.0 10.32 2.79 70.0 8.69 3.00 75.0 7.36 3.19 80.0 6.27 3.37 85.0 5.36 3.69 90.0 4.60 3.69 95.0 3.96 3.83	Temperature (°C)		
$\begin{array}{c c c c c c c c c c c c c c c c c c c $	-30.0		0.06
-15.0 392.31 0.16 -10.0 292.91 0.21 -5.0 221.09 0.28 0.0 168.60 0.36 5.0 129.84 0.46 10.0 100.91 0.57 15.0 79.12 0.71 20.0 62.55 0.86 25.0 49.84 1.03 30.0 40.01 1.23 35.0 32.35 1.43 40.0 26.34 1.65 45.0 21.58 1.88 50.0 17.79 2.11 55.0 14.75 2.34 60.0 12.30 2.57 65.0 10.32 2.79 70.0 8.69 3.00 75.0 7.36 3.19 80.0 6.27 3.37 85.0 5.36 3.54 90.0 4.60 3.69 95.0 3.96 3.83	-25.0	729.09	0.09
-10.0 292.91 0.21 -5.0 221.09 0.28 0.0 168.60 0.36 5.0 129.84 0.46 10.0 100.91 0.57 15.0 79.12 0.71 20.0 62.55 0.86 25.0 49.84 1.03 30.0 40.01 1.23 35.0 32.35 1.43 40.0 26.34 1.65 45.0 21.58 1.88 50.0 17.79 2.11 55.0 14.75 2.34 60.0 12.30 2.57 65.0 10.32 2.79 70.0 8.69 3.00 75.0 7.36 3.19 80.0 6.27 3.37 85.0 5.36 3.54 90.0 4.60 3.69	-20.0	531.56	0.12
-5.0 221.09 0.28 0.0 168.60 0.36 5.0 129.84 0.46 10.0 100.91 0.57 15.0 79.12 0.71 20.0 62.55 0.86 25.0 49.84 1.03 30.0 40.01 1.23 35.0 32.35 1.43 40.0 26.34 1.65 45.0 21.58 1.88 50.0 17.79 2.11 55.0 14.75 2.34 60.0 12.30 2.57 65.0 10.32 2.79 70.0 8.69 3.00 75.0 7.36 3.19 80.0 6.27 3.37 85.0 5.36 3.54 90.0 4.60 3.69 95.0 3.96 3.83	-15.0	392.31	0.16
0.0 168.60 0.36 5.0 129.84 0.46 10.0 100.91 0.57 15.0 79.12 0.71 20.0 62.55 0.86 25.0 49.84 1.03 30.0 40.01 1.23 35.0 32.35 1.43 40.0 26.34 1.65 45.0 21.58 1.88 50.0 17.79 2.11 55.0 14.75 2.34 60.0 12.30 2.57 65.0 10.32 2.79 70.0 8.69 3.00 75.0 7.36 3.19 80.0 6.27 3.37 85.0 5.36 3.54 90.0 4.60 3.69 95.0 3.96 3.83	-10.0	292.91	0.21
5.0 129.84 0.46 10.0 100.91 0.57 15.0 79.12 0.71 20.0 62.55 0.86 25.0 49.84 1.03 30.0 40.01 1.23 35.0 32.35 1.43 40.0 26.34 1.65 45.0 21.58 1.88 50.0 17.79 2.11 55.0 14.75 2.34 60.0 12.30 2.57 65.0 10.32 2.79 70.0 8.69 3.00 75.0 7.36 3.19 80.0 6.27 3.37 85.0 5.36 3.54 90.0 4.60 3.69 95.0 3.96 3.83	-5.0	221.09	0.28
10.0 100.91 0.57 15.0 79.12 0.71 20.0 62.55 0.86 25.0 49.84 1.03 30.0 40.01 1.23 35.0 32.35 1.43 40.0 26.34 1.65 45.0 21.58 1.88 50.0 17.79 2.11 55.0 14.75 2.34 60.0 12.30 2.57 65.0 10.32 2.79 70.0 8.69 3.00 75.0 7.36 3.19 80.0 6.27 3.37 85.0 5.36 3.54 90.0 4.60 3.69 95.0 3.96 3.83	0.0	168.60	0.36
15.0 79.12 0.71 20.0 62.55 0.86 25.0 49.84 1.03 30.0 40.01 1.23 35.0 32.35 1.43 40.0 26.34 1.65 45.0 21.58 1.88 50.0 17.79 2.11 55.0 14.75 2.34 60.0 12.30 2.57 65.0 10.32 2.79 70.0 8.69 3.00 75.0 7.36 3.19 80.0 6.27 3.37 85.0 5.36 3.54 90.0 4.60 3.69 95.0 3.96 3.83	5.0	129.84	0.46
20.062.550.8625.049.841.0330.040.011.2335.032.351.4340.026.341.6545.021.581.8850.017.792.1155.014.752.3460.012.302.5765.010.322.7970.08.693.0075.07.363.1980.06.273.3785.05.363.5490.04.603.6995.03.963.83	10.0	100.91	0.57
25.0 49.84 1.03 30.0 40.01 1.23 35.0 32.35 1.43 40.0 26.34 1.65 45.0 21.58 1.88 50.0 17.79 2.11 55.0 14.75 2.34 60.0 12.30 2.57 65.0 10.32 2.79 70.0 8.69 3.00 75.0 7.36 3.19 80.0 6.27 3.37 85.0 5.36 3.54 90.0 4.60 3.69 95.0 3.96 3.83	15.0	79.12	0.71
30.040.011.2335.032.351.4340.026.341.6545.021.581.8850.017.792.1155.014.752.3460.012.302.5765.010.322.7970.08.693.0075.07.363.1980.06.273.3785.05.363.5490.04.603.6995.03.963.83	20.0	62.55	0.86
35.032.351.4340.026.341.6545.021.581.8850.017.792.1155.014.752.3460.012.302.5765.010.322.7970.08.693.0075.07.363.1980.06.273.3785.05.363.5490.04.603.6995.03.963.83	25.0	49.84	1.03
40.026.341.6545.021.581.8850.017.792.1155.014.752.3460.012.302.5765.010.322.7970.08.693.0075.07.363.1980.06.273.3785.05.363.5490.04.603.6995.03.963.83	30.0	40.01	1.23
45.021.581.8850.017.792.1155.014.752.3460.012.302.5765.010.322.7970.08.693.0075.07.363.1980.06.273.3785.05.363.5490.04.603.6995.03.963.83	35.0	32.35	1.43
50.017.792.1155.014.752.3460.012.302.5765.010.322.7970.08.693.0075.07.363.1980.06.273.3785.05.363.5490.04.603.6995.03.963.83	40.0	26.34	1.65
55.014.752.3460.012.302.5765.010.322.7970.08.693.0075.07.363.1980.06.273.3785.05.363.5490.04.603.6995.03.963.83	45.0	21.58	1.88
60.012.302.5765.010.322.7970.08.693.0075.07.363.1980.06.273.3785.05.363.5490.04.603.6995.03.963.83	50.0	17.79	2.11
65.010.322.7970.08.693.0075.07.363.1980.06.273.3785.05.363.5490.04.603.6995.03.963.83	55.0	14.75	2.34
70.08.693.0075.07.363.1980.06.273.3785.05.363.5490.04.603.6995.03.963.83	60.0	12.30	2.57
75.07.363.1980.06.273.3785.05.363.5490.04.603.6995.03.963.83	65.0	10.32	2.79
80.0 6.27 3.37 85.0 5.36 3.54 90.0 4.60 3.69 95.0 3.96 3.83	70.0	8.69	3.00
85.0 5.36 3.54 90.0 4.60 3.69 95.0 3.96 3.83	75.0	7.36	3.19
90.0 4.60 3.69 95.0 3.96 3.83	80.0	6.27	3.37
95.0 3.96 3.83	85.0	5.36	3.54
	90.0	4.60	3.69
	95.0	3.96	3.83
100.0 3.43 3.96	100.0	3.43	3.96
105.0 2.98 4.07	105.0	2.98	4.07
110.0 2.60 4.17	110.0	2.60	4.17
115.0 2.27 4.26	115.0	2.27	4.26
120.0 2.00 4.33	120.0	2.00	4.33

Heat exchanger temperature thermistor

Temperature (°C)	Resistance (kΩ)	Voltage (V)	
-30.0	95.57	0.24	
-25.0	68.89	0.32	
-20.0	50.31	0.43	
-15.0	37.19	0.57	
-10.0	27.81	0.73	
-5.0	21.02	0.92	
0.0	16.05	1.14	
5.0	12.38	1.39	
10.0	9.63	1.65	
15.0	7.56	1.93	
20.0	5.98	2.21	
25.0	4.77	2.49	
30.0	3.84	2.77	
35.0	3.11	3.02	
40.0	2.53	3.26	
45.0	2.08	3.48	
50.0	1.71	3.67	
55.0	1.42	3.85	
60.0	1.19	4.00	
65.0	1.00	4.13	
70.0	0.84	4.25	
75.0	0.71	4.35	
80.0	0.61 4.43		

Heat exchanger (Middle) temperature thermistor

Temperature (°C)	Resistance (kΩ)	Voltage (V)		
-30.0	95.58	0.24		
-25.0	68.90	0.32		
-20.0	50.31	0.43		
-15.0	37.19	0.57		
-10.0	27.81	0.73		
-5.0	21.02	0.92		
0.0	16.05	1.14		
5.0	12.38	1.39		
10.0	9.63	1.65		
15.0	7.56	1.93		
20.0	5.98	2.21		
25.0	4.77	2.49		
30.0	3.84	2.77		
35.0	3.11	3.02		
40.0	2.53	3.26		
45.0	2.08	3.48		
50.0	1.71	3.68		
55.0	1.42	3.85		
60.0	1.19	4.00		
65.0	1.00	4.13		
70.0	0.84 4.25			
75.0	0.71 4.35			
80.0	0.61 4.43			

Outdoor temperature thermistor

Temperature (°C)	Resistance (kΩ)	Voltage (V)
-30.0	224.33	0.73
-25.0	159.71	0.97
-20.0	115.24	1.25
-15.0	84.21	1.56
-10.0	62.28	1.90
-5.0	46.58	2.26
0.0	35.21	2.61
5.0	26.88	2.94
10.0	20.72	3.25
15.0	16.12	3.52
20.0	12.64	3.76
25.0	10.00	3.97
30.0	7.97	4.14
35.0	6.40	4.28
40.0	5.18	4.41
45.0	4.21	4.51
50.0	3.45	4.59
55.0	2.85	4.65

Compressor temperature thermistor

Temperature (°C)	Resistance (kΩ)	Voltage (V)
-30.0	1,013.11	0.06
-25.0	729.09	0.09
-20.0	531.56	0.12
-15.0	392.31	0.16
-10.0	292.91	0.21
-5.0	221.09	0.28
0.0	168.60	0.36
5.0	129.84	0.46
10.0	100.91	0.57
15.0	79.12	0.71
20.0	62.55	0.86
25.0	49.84	1.03
30.0	40.01	1.23
35.0	32.35	1.43
40.0	26.34	1.65
45.0	21.58	1.88
50.0	17.79	2.11
55.0	14.75	2.34
60.0	12.30	2.57
65.0	10.32	2.79
70.0	8.70	3.00
75.0	7.36	3.19
80.0	6.27	3.37
85.0	5.36	3.54
90.0	4.60	3.69
95.0	3.96	3.83
100.0	3.43	3.96
105.0	2.98	4.07
110.0	2.60	4.17
115.0	2.27	4.26
120.0	2.00	4.33



4. CONTROL AND FUNCTIONS

CONTENTS

4. CONTROL AND FUNCTIONS

4. Detation number control of commences	04.4
1. Rotation number control of compressor	
1-1. Cooling operation	
1-2. Heating operation	
1-3. Dry operation	
1-4. Rotation number of compressor at normal start-up	
1-5. Limitation of compressor rotation number by outdoor temperature	
2. Auto changeover operation	04-8
3. Fan control	04-10
3-1. Indoor fan control	04-10
3-2. Outdoor fan control	04-14
4. Louver control	04-17
4-1. Horizontal louver control	04-17
4-2. Vertical louver control	04-17
4-3. Swing operation	
5. Timer operation control	04-19
5-1. Wireless remote control	
5-2. Wired remote control	
6. Defrost operation control	
6-1. Defrost operation in heating operation stopped	
7. Various control	
7-1. Auto restart	
7-2. MANUAL AUTO operation	
7-2. MANOAL A010 operation	
7-4. 10 °C HEAT operation	
7-5. ECONOMY operation	
7-6. POWERFUL operation	
7-7. Fresh air control	
7-8. Compressor preheating	
7-9. External electrical heater control	
7-10. Electronic expansion valve control	
7-11. Prevention to restart for 3 minutes (3 minutes st)	
7-12. 4-way valve control	
7-13. Human sensor for energy saving	
7-14. Outdoor unit low noise operation	04-30
7-15. Base pan heater control	04-31
7-16. Unit status monitoring and the detected value indication	
8. Various protections	04-34
8-1. Discharge gas temperature over-rise prevention control	
8-2. Anti-freezing control (cooling and dry mode)	
8-3. Current release control	

CONTENTS (continued)

8-4. Compressor temperature protection	04-36
8-5. High pressure protection	04-36
8-6. Low outdoor temperature protection	04-36
8-7. High temperature and high pressure release control	04-37

1. Rotation number control of compressor

1-1. Cooling operation

A sensor (room temperature thermistor) built in the indoor unit body will usually perceive difference or variation between a set temperature and present room temperature, and controls the operation rotation number of the compressor.


- If the room temperature is 6.0°C higher than a set temperature, the operation rotation number of compressor will attain to maximum performance.
- If the room temperature is 1.0°C lower than a set temperature, the compressor will be stopped.
- When the room temperature is within the range of +6.0°C to -1.0°C of the setting temperature, the rotation number of compressor is controlled within the range shown in the table below. However, the maximum rotation number is limited in the range shown in the figure below based on the indoor fan mode and the outdoor temperature.

Rotation number range of compressor

Unit: rps

Model name	Minimum rotation number	Maximum rotation number
RSH09KHCBN	8	58
RSH12KHCBN	8	68
RSH14KHCBN	8	74

· Limit of maximum speed based on outdoor temperature

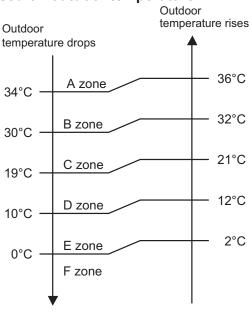

Unit: rps

VTROL AND

	Indoor unit fan mode						
Model name	temperature zone	HIGH	MED— HIGH	MED	MED— LOW	LOW	QUIET
	A zone	58	46	32	28	26	20
	B zone	58	46	32	28	26	20
RSH09KHCBN	C zone	58	46	32	28	26	20
KSHU9KHCDN	D zone	34	28	22	20	20	18
	E zone	34	28	22	20	20	18
	F zone	34	28	22	20	20	18
	A zone	68	50	34	30	28	22
	B zone	68	50	34	30	28	22
RSH12KHCBN	C zone	68	50	34	30	28	22
KONIZKICDIN	D zone	36	30	24	22	22	20
	E zone	36	30	24	22	22	20
	F zone	36	30	24	22	22	20
	A zone	74	54	36	32	30	22
RSH14KHCBN	B zone	74	54	36	32	30	22
	C zone	74	54	36	32	30	22
	D zone	34	30	26	24	24	20
	E zone	34	30	26	24	24	20
	F zone	34	30	26	24	24	20

1-1. Cooling operation

1-2. Heating operation


A sensor (room temperature thermistor) built in indoor unit body will usually perceive difference or variation between setting temperature and present room temperature, and controls operation rotation number of compressor.

- If the room temperature is 6.0°C lower than a set temperature, the operation rotation number of compressor will attain to maximum performance.
- If the room temperature is 1.0°C higher than a set temperature, the compressor will be stopped.
- When the room temperature is within the range of +1.0°C to -6.0°C of the setting temperature, the rotation number of compressor is controlled within the range shown below.
- Rotation number range of compressor

Unit: rps

Model name	Minimum rotation number	Maximum rotation number
RSH09KHCBN	8	130
RSH12KHCBN	8	140
RSH14KHCBN		

Limit of maximum speed based on outdoor temperature
 In heating operation, maximum rotation number is defined by outdoor temperature and fan mode.



Unit: rps

	Outdoor temperature zone	Indoor unit fan mode					
Model name		HIGH	MED— HIGH	MED	MED— LOW	LOW	QUIET
RSH09KHCBN	A zone	130	111	87	68	54	32
	B zone	130	111	87	68	54	36
	C zone	130	120	102	94	87	74
RSH12KHCBN	A zone	140	111	94	74	58	34
	B zone	140	111	94	74	58	39
	C zone	140	120	111	102	94	80
RSH14KHCBN	A zone	140	111	94	80	63	36
	B zone	140	111	94	80	63	46
	C zone	140	120	111	102	94	80

OL AND

1-3. Dry operation

The rotation number of compressor shall change according to the temperature, set temperature, and room temperature variation which the room temperature sensor of the indoor unit has detected as shown in the table below.


Zone is defined by set temperature and room temperature.

Rotation number range of compressor

Unit: rps


Model name	Outdoor temperature zone	Operating rotation number	
	X zone	16	
RSH09KHCBN	J zone	12	
	Y zone	0	
RSH12KHCBN	X zone	18	
RSH14KHCBN	J zone	14	
KON I4KHODN	Y zone	0	

Compressor control based on room temperature

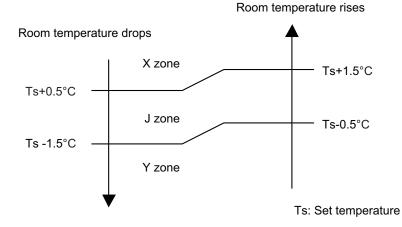

1-4. Rotation number of compressor at normal start-up

Rotation number of compressor soon after starting is controlled as below.

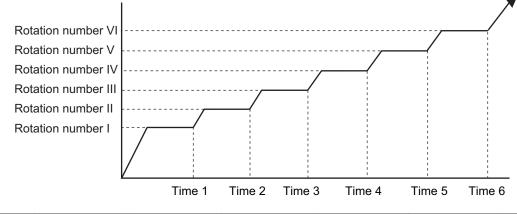


Rotation	I	II		IV	V	VI
number (rps)	35	52	64	71	89	97
Time (sec)	1	2	3	4	5	6
	60	140	170	200	350	410

1-5. Limitation of compressor rotation number by outdoor temperature


The minimum rotation number of compressor is limited by outdoor temperature as below.

Cooling/Dry mode



Model name	Outdoor temperature zone	Limitation of compressor rotation number	
	A zone	30	
	B zone	30	
ROH09KHCBN	C zone	18	
KOI IUSKI ICBIN	D zone	1	
	E zone	1	
	F zone	24	
	A zone	32	
	B zone	32	
ROH12KHCBN	C zone	20	
ROHIZKHEBN	D zone	1	
	E zone	1	
	F zone	32	
	A zone	26	
	B zone	26	
ROH14KHCBN	C zone	20	
ROTT4RHCBN	D zone	1	
	E zone	1	
	F zone	30	

• Heating mode



Unit: rps

Model name	Outdoor temperature zone	Limitation of compressor rotation number
	A zone	60
	B zone	39
ROH09KHCBN	C zone	20
ROH12KHCBN	D zone	14
	E zone	1
	F zone	1
	A zone	60
	B zone	31
ROH14KHCBN	C zone	20
KUN 14KNCBN	D zone	14
	E zone	1
	F zone	1

2. Auto changeover operation

When the air conditioner is set to AUTO mode by remote controller, operation starts in the optimum mode from among heating, cooling, dry and monitoring modes. During operation, the optimum mode is automatically switched in accordance with temperature changes. The temperature can be set between 18°C and 30°C in 1.0°C steps.

• When operation starts, indoor fan and outdoor fan are operated for around 1 minute. Room temperature and outdoor temperature are sensed, and the operation mode is selected in accordance with the table below.

Room temperature	Operation mode
Tr > Ts + 2°C	Cooling
Ts + 2°C ≥ Tr ≥ Ts - 2°C	Middle zone
Tr < Ts - 2°C	Heating

Tr: Room temperature

ROL AND

Ts: Setting temperature

NOTE: When the operation mode is middle zone, indoor unit operation mode is selected as below.

- Same operation mode is selected as outdoor unit. If outdoor unit is operating in cooling and heating mode, indoor unit will be operated by the same operation mode.
- Selected by outdoor temperature.
 If outdoor unit is operating in other than cooling and heating mode, indoor unit will be operated according to the outdoor temperature as below.


Outdoor temp.	Operation mode		
25°C or more	Cooling		
Less than 25°C	Heating		

- When the compressor was stopped for 6 consecutive minutes by temperature control function after the cooling or heating mode was selected as above, operation is switched to monitoring mode and the operation mode selection is done again.
- When the middle zone is selected on the predetermining of the operation mode, the operation mode before the changing to the monitoring mode is selected.

2. Auto changeover operation

NTROL AND NCTIONS

Operation flow chart

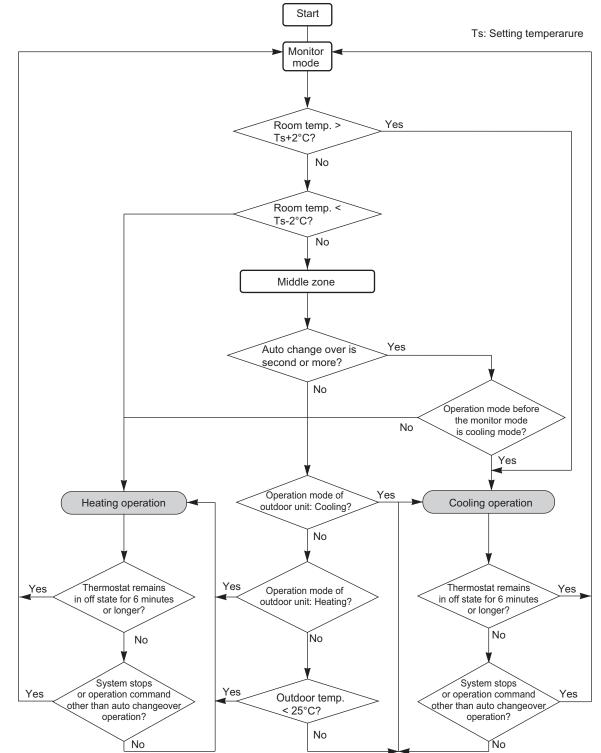

3. Fan control

Tr: Room temperature Ts: Setting temperature

3-1. Indoor fan control

Fan speed

TROL AND TTIONS Indoor fan speed is defined as below.

Operation	For mode		Speed (rpm)	
mode	Fan mode	RSH09KHCBN	RSH12KHCBN	RSH14KHCBN
	POWERFUL		1,380	1,430
	HIGH	1,240	1,240	1,280
Heating	MED—HIGH	1,120	1,120	1,190
	MED	1,000	1,000	1,100
	MED—LOW	940	940	1,020
	LOW	870	870	940
	QUIET	540	540	650
	Cool air prevention	650	650	650
	S-LOW	540	540	540
	POWERFUL	1,380	1,380	1,430
	HIGH	1,120	1,160	1,230
	MED—HIGH	1,060	1,080	1,170
	MED	1,000	1,000	1,110
Cooling/Fan	MED—LOW	940	940	1,030
	LOW	870	870	940
	QUIET	610	610	710
	Soft quiet	540* ¹	540* ¹	610* ¹
	S-LOW	540* ²	540* ²	540* ²
		X zone: 580	X zone: 580	X zone: 670
	Dry	J zone: 540	J zone: 540	J zone: 610

*1: Fan mode only

*2: Cooling mode only

Fan operation


Airflow can be switched in 7 steps such as AUTO, QUIET, LOW, MED—LOW, MED, MED—HIGH, HIGH while indoor unit fan only runs.

When fan mode is set at AUTO, it operates on MED fan speed.

Cooling operation

Switch the airflow AUTO, and indoor fan motor will run according to room temperature, as below. On the other hand, if switched in HIGH—QUIET, indoor motor will run at a constant airflow of COOL operation modes QUIET, LOW, MED, HIGH as shown in "Fan speed" above.

Airflow change over (Cooling: Auto)

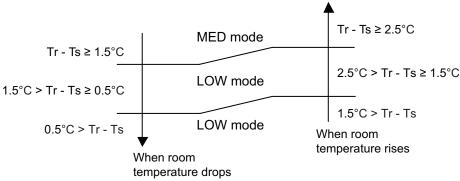

Dry operation


During dry operation, fan speed setting can not be changed as shown in "Fan speed" above.

Heating operation

Switch the airflow AUTO, and the indoor fan motor will run according to a room temperature, as below.

On the other hand, if switched in HIGH—QUIET, the indoor motor will run at a constant airflow of HEAT operation modes QUIET, LOW, MED, HIGH as shown in "Fan speed" above.


Airflow change over (Heating: Auto)

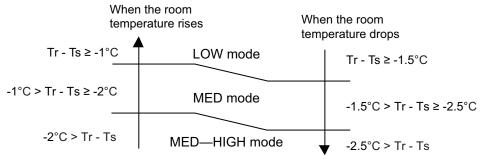


Cool air prevention control (heating mode)

The maximum value of the indoor fan speed is set as shown below, based on the detected temperature by the indoor heat exchanger sensor on heating mode.

Normal operation

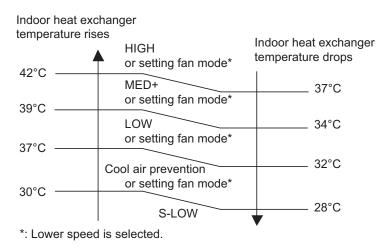


7 minutes later:

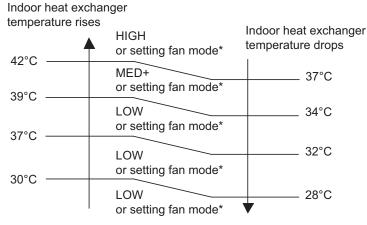


*: Lower speed is selected.

Powerful operation

OL AND

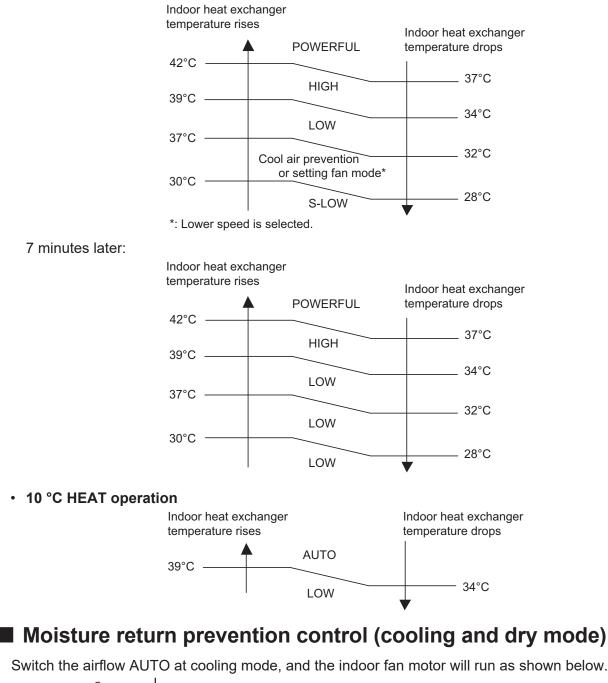

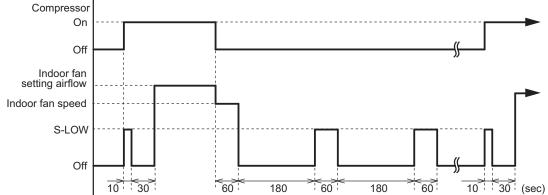

3-2. Outdoor fan control


This outdoor unit has a DC fan motor. (Control method is different between AC and DC motors.)

Fan speed

Model: ROH09KHCBN

Fan speed is defined by outdoor temperature and rotation number of compressor.

Outside air temperature zone selection



Unit: rpm

Ean atom	Cooling	Heating	Dry	Cooli	ng or dry at	low outdoor	temp.
Fan step	Y zone	Heating	Y zone	Z zone	F zone	G zone	H zone
S-HIGH2		1,100	—	—		—	
S-HIGH1	1,050	1,100		—			
HIGH	1,050	1,100					
10		1,100	—	—		—	
9	1,050	1,100	1,050	810	300	230	230
8	1,050	970	1,050	810	300	230	230
7	1,030	850	1,030	730	250	230	230
6	890	700	890	550	250	200	200
5	760	660	760	340	220	200	200
4	660	660	660	270	220	200	200
3	520	470	520	270	200	200	200
2	420	370	420	270	200	200	200
1	400	370	400	270	200	200	200


NOTE: After defrost control on the heating mode, the fan speed is kept higher regardless of the compressor frequency.

Fan speed after defrost control: 1,100 rpm

Model: ROH12KHCBN

Fan speed is defined by outdoor temperature and rotation number of compressor.

Outside air temperature zone selection



U	nit:	rpm
_		

Ean aton	Cooling	Heating	Dry	Cooli	ing or dry at	low outdoor	temp.
Fan step	Y zone	Heating	Y zone	Z zone	F zone	G zone	H zone
S-HIGH2		1,200	—	—	_		
S-HIGH1	1,180	1,200	—	—			
HIGH	1,180	1,200	—	—			
10		1,170	—	—			
9	1,180	1,170	1,180	550	280	220	220
8	1,080	930	1,080	550	280	220	220
7	900	840	900	500	280	220	220
6	900	740	900	400	240	200	200
5	780	740	780	280	210	200	200
4	570	710	570	280	210	200	200
3	550	410	550	280	210	200	200
2	430	380	430	280	210	200	200
1	400	380	400	280	210	200	200


NOTE: After defrost control on the heating mode, the fan speed is kept higher regardless of the compressor frequency.

Fan speed after defrost control: 1,200 rpm

Model: ROH14KHCBN

Fan speed is defined by outdoor temperature and rotation number of compressor.

Outside air temperature zone selection



U	nit:	rpm
_		

Ean aton	Cooling	Heating	Dry	Cooli	ng or dry at	low outdoor	temp.
Fan step	Y zone	Heating	Y zone	Z zone	F zone	G zone	H zone
S-HIGH2		1,200		_		_	
S-HIGH1	1,290	1,200	—	—	—	—	
HIGH	1,290	1,200					
10	—	1,200	—	—	—	—	
9	1,290	1,170	1,290	440	270	220	220
8	1,150	990	1,150	440	270	220	220
7	1,000	830	1,000	440	270	220	220
6	880	800	880	350	230	200	200
5	760	740	760	260	200	200	200
4	640	640	640	260	200	200	200
3	550	460	550	260	200	200	200
2	460	420	460	260	200	200	200
1	460	380	460	260	200	200	200

NOTE: After defrost control on the heating mode, the fan speed is kept higher regardless of the compressor frequency.


Fan speed after defrost control: 1,200 rpm

4. Louver control

DL AND

4-1. Horizontal louver control

Each time the button is pressed, the airflow direction range will change as below:




- Remote controller display is not changed.
- Up/down airflow direction is set automatically as shown, in accordance with the type of operation selected.

Cooling / Dry mode: Horizontal flow 1Heating mode: Downward flow 7

- During AUTO operation, for the first a few minutes after beginning operation, airflow will be horizontal 1; the air direction cannot be adjusted during this period.
 The airflow direction setting will temporarily become 1 when the temperature of the airflow is low at the start of the Heating mode.
- After beginning of AUTO/HEAT mode operated and automatic defrosting operation, the airflow will be horizontal 1. However, the airflow direction cannot be adjusted at beginning AUTO operation mode.

4-2. Vertical louver control

Each time the button is pressed, the airflow direction range will change as below:



Remote controller display is not changed.

4-3. Swing operation


- To select up/down airflow swing operation When the swing signal is received, the horizontal louver starts to swing.
 - Swinging range
 - Cooling mode/dry mode/fan mode (1 to 3): $1 \leftrightarrow 4$
 - Heating mode/fan mode (4 to 6): 3 ↔ 6
 - When the indoor fan is S-LOW or stop mode, the swing operation is interrupted and it stops at either upper end or bottom end.
- To select left/right airflow swing operation When the swing signal is received, the vertical louver starts to swing.
 - Swinging range

ITROL AND

- All mode: $1 \leftrightarrow 5$
- When the indoor fan is S-LOW or stop mode, the swing operation is interrupted and it stops at either left end or right end.
- To select up/down and left/right airflow swing operation When the swing signal is received, both of the vertical and the horizontal louvers start to swing.

Program timer

• The program timer allows the off timer and the on timer to be used in combination one time.



- · Operation will start from the timer setting (either off timer and on timer) whichever is closest to the clock current timer setting. The order of operations is indicated by the allow in the remote controller screen.
- Sleep timer operation cannot be combined with on timer operation.


5-1. Wireless remote control

5. Timer operation control


On/Off timer Program timer Sleep timer Weekly timer 0 0 0

On/Off timer

· Off timer: When the clock reaches the set timer, the air conditioner will be turned off.



• On timer: When the clock reaches the set timer, the air conditioner will be turned on.



Operation mode

Stop mode


ROL AND

Sleep timer

If the sleep timer is set, the room temperature is monitored and the operation is stopped automatically. If the operation mode or the set temperature is change after the sleep timer is set, the operation is continued according to the changed setting of the sleep timer from that time on.

· In the cooling operation mode


When the sleep timer is set, the setting temperature is increased 1°C. It increases the setting temperature another 1°C after 1 hour. After that, the setting temperature is not changed and the operation is stopped at the setting time.



Ts: Set temperature

• In the heating operation mode

When the sleep timer is set, the setting temperature is decreased 1°C. It decreases the setting temperature another 1°C every 30 minutes. Upon lowering 4°C, the setting temperature is not changed and the operation is stopped at the setting time.

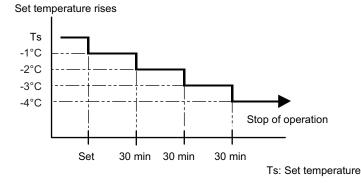


5-2. Wired remote control


On/Off timer	Program timer	Sleep timer	Weekly timer	Temperature Setback Timer
0	0	0	0	0

On/Off timer

• Off timer: When the clock reaches the set timer, the air conditioner will be turned off.




• On timer: When the clock reaches the set timer, the air conditioner will be turned on.



Program timer

ROL AND

• The program timer allows the off timer and the on timer to be used in combination one time.




- Operation will start from the timer setting (either off timer and on timer) whichever is closest to the clock current timer setting. The order of operations is indicated by the allow in the remote controller screen.
- Sleep timer operation cannot be combined with on timer operation.

Sleep timer

If the sleep timer is set, the room temperature is monitored and the operation is stopped automatically. If the operation mode or the set temperature is change after the sleep timer is set, the operation is continued according to the changed setting of the sleep timer from that time on.

· In the cooling operation mode


When the sleep timer is set, the setting temperature is increased 1°C. It increases the setting temperature another 1°C after 1 hour. After that, the setting temperature is not changed and the operation is stopped at the setting time.



Ts: Set temperature

In the heating operation mode

When the sleep timer is set, the setting temperature is decreased 1°C. It decreases the setting temperature another 1°C every 30 minutes. Upon lowering 4°C, the setting temperature is not changed and the operation is stopped at the setting time.

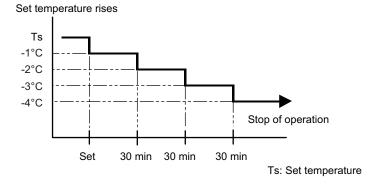


Weekly timer

On and off timer can be combined, and up to 4 reservations per day and 28 reservations per week. Before setting the program, set the week and time of the air conditioner at first. If the week and time are not set, the weekly timer will not operate correctly at the setting time.

Temperature Setback Timer

- The temperature setback timer only changes the set temperature for 7 days, it cannot be used to start or stop air conditioner operation.
- The temperature setback timer can be set to operate up to two times per day but only one temperature setting can be used.
- During COOLING/DRY mode, the air conditioner will operate at a minimum of 18°C even if the • SET BACK temperature is set to 17°C or lower.

Case of Temperature Setback Timer on the Cooling operation. (Setting temperature :22°C, SET BACK temperature :26°C)

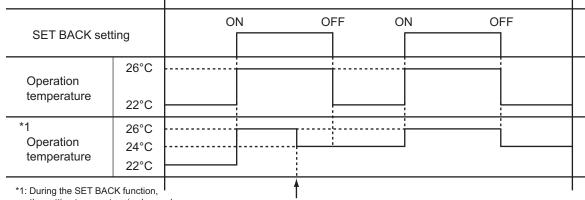

the setting temperature is changed.

Chenge the setting temperature: 22°C → 24°C

5. Timer operation control

6. Defrost operation control

Tn: Outdoor unit heat exchanger temperatureTom: Outdoor heat exchanger middle temperatureTa: Outdoor temperatureTn10: Temperature at 10 minutes after compressor startTnb: Temperature before 5 minutes

Triggering condition

The defrost operation starts when outdoor unit heat exchanger temperature sensor detects the temperature lower than the values shown below.

- 1st time defrosting after starting operation

Compressor integrating operation time	Less than 17 min.	17 to 57 min.	More than 57 min.
Condition	Does not operate	Tn ≤ -9°C and Tn-Ta ≥ 5 deg	Tn ≤ -5°C

– 2nd time and after

OL AND

Compressor integrating operation time	Less than 40 min.	More than 40 min.
		Tn-Tn10 < -5 deg (Tn ≤ -6°C) Tn-Tnb < -2 deg (Tn ≤ -6°C)*
Condition	Does not operate	Tn ≤ -17°C (Ta ≥ -10°C) Tn ≤ Ta-7°C or Tn ≤ -30°C (-25°C ≤ Ta < -10°C)
		$Tn \le Ta-7^{\circ}C \text{ or } Tom \le -38^{\circ}C (Ta < -25^{\circ}C)$

*: Detection continues in the following sequence (Tn \leq -6°C)

- 1. "Tn-Tnb < -2 deg" is detected.
- 2. "Tn-Tnb < 0 deg" is detected 5 minutes after step 1.
- 3. Besides the detection of step 2, "Tn-Tnb < -2 deg" is additionally detected or not.
- 4. Judges if step 3 detection continues or not.

- Integrating defrost (Constant monitoring)

Compressor integrating operation time	More than 240 min. (For long continuous operation)	More than 215 min. (For long continuous operation	Less than 10 min.* (For intermittent operation)
Condition	Tn ≤ -3°C	Tn ≤ -5°C	Count of the compressor off: 40 times

*: If the compressor continuous operation time is less than 10 minutes, the number of the compressor off is counted. If any defrost operated, the compressor off count is cleared.

Release condition

The defrost operation is released when either one of the conditions below is satisfied.

Outdoor unit heat exchanger temperature (after 1 minute or later since compressor start)	16°C or more
Compressor operation time	15 minutes

6-1. Defrost operation in heating operation stopped

If the outdoor unit is frosted when stopping the heating operation, it stops after performing the automatic defrosting operation.

In this time, if the indoor unit operation lamp flashes slowly (6 sec on/2 sec off), the outdoor unit allow the heat exchanger to defrost, and then stop.

Triggering condition

When all of the following conditions are satisfied in heating operation

- Compressor operation integrating time: 30 minutes or more
- Compressor continuous operation time: 10 minutes or more
- Outdoor unit heat exchanger temperature: -4°C or less

Release condition

The defrost operation is released when either one of the conditions below is satisfied.

Outdoor unit heat exchanger temperature (after 1 minute or later since compressor start)	16°C or more
Compressor operation time	15 minutes

7. Various control

7-1. Auto restart

When the power was interrupted by a power failure etc. during operation, the operation contents at that time are memorized and when the power is recovered, operation is automatically started with the memorized operation contents.

Operation contents memorized when the power is interrupted
Operation mode
Setting temperature
Fan mode setting
Timer mode and set time (set by wireless remote controller)
Airflow direction setting
Swing
ECONOMY operation
10 °C HEAT operation
Outdoor low noise operation
Remote control setting
WLAN indicator lamp setting

7-2. MANUAL AUTO operation

When the wireless remote controller is lost or battery power dissipated, this function will work without the remote controller.

When MANUAL AUTO button is pressed more than 3 seconds and less than 10 seconds, MANUAL AUTO operation starts as shown in the table below. To stop operation, press the MANUAL AUTO button for 3 seconds.

Operation mode	Auto changeover
Fan mode	AUTO
Timer mode	Continuous (no timer setting available)
Setting temperature	24°C
Horizontal louver setting	Standard
Vertical louver setting	According to memory position
SWING	Off
ECONOMY	Off
Human sensor	Off

7-3. Forced cooling operation

The outdoor unit may not operate depending on the room temperature.

When FORCED COOLING OPERATION button is pressed more than 10 seconds, forced cooling operation starts as shown in the table below.

Operation mode	Cooling
Fan mode	HIGH
Timer mode	Continuous (no timer setting available)
Setting temperature	24°C
Horizontal louver setting	Standard
Vertical louver setting	According to memory position
SWING	Off
ECONOMY	Off
Human sensor	Off

- During the forced cooling operation, it operates regardless of room temperature sensor.
- The operation indicator lamp and the timer indicator lamp blink simultaneously during the forced cooling operation.

They blink for 1 second ON and 1 second OFF on both the operation indicator lamp and the timer indicator lamp (same as test operation).

- By performing one of the following action, test operation will be canceled:
- Pressing the remote controller START/STOP button
- Pressing FORCED COOLING OPERATION button for 3 seconds
- · 60 minutes passed after starting forced cooling operation

7-4. 10 °C HEAT operation

ITROL AND CTIONS

10 °C HEAT operation performs as below setting when pressing 10 °C HEAT button.

Operation mode	Heating
Setting temperature	10°C
Fan mode	AUTO
LED display	Economy
Defrost operation	Operate as normal

7-5. ECONOMY operation

The ECONOMY operation starts by pressing ECONOMY button on the remote controller. The ECONOMY operation is almost the same operation as below settings.

Mode	Cooling/Dry	Heating
Target temperature	Setting temperature +1°C	Setting temperature -1°C

NOTE: When HEAT operation is selected on the remote controller during forced cooling operation, heating test run will begin in about 3 minutes.

7-6. POWERFUL operation

The POWERFUL operation starts by pressing POWERFUL button on the remote controller.

The indoor unit and outdoor unit operate at maximum power as shown in the table below.

Rotation number of compressor		Maximum
Fan mode		POWERFUL
Horizontal louver setting	Cooling	- 3
	Dry	
	Heating	7

Release condition:


Cooling/Dry

Room temperature ≤ Setting temperature -0.5°C or Operation time has passed 20 minutes. Heating

Room temperature \geq Setting temperature +0.5°C or Operation time has passed 20 minutes.

7-7. Fresh air control

The fan motor for Fresh Air is operated in synchronization with the indoor fan operation as below.




7-8. Compressor preheating


By preheating the compressor, warm airflow is quickly discharged when the operation is started.

Triggering condition

- 30 minutes after compressor stopped.
- Outdoor unit heat exchanger temperature (Tn)




When the jumper wire (JM2) is disconnected:



7-9. External electrical heater control

The external electrical heater is operated as below.

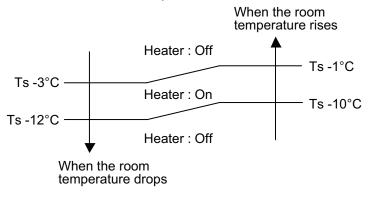

Ts: Setting temperature

NOTES:

- When the compressor stop, external electric heater is off.
- It operates only in heating mode and when the indoor fan operates. (However, S-LOW is excluded.)

7-10. Electronic expansion valve control

The most proper opening of the electronic expansion valve is calculated and controlled under the present operating condition based on the table below.

Operation mode	Pulse range	
Cooling/dry mode	Between 52 and 480 pulses	
Heating mode	Between 52 and 460 pulses	

NOTE: At the time of supplying the power to the outdoor unit, the initialization of the electronic expansion valve is operated (528 pulses are input to the closing direction).

7-11. Prevention to restart for 3 minutes (3 minutes st)

When the compressor fails to start for the number of times below, it does not enter operation status for 3 minutes.

Retry number	50
Retry set number	3

When the compressor fails to start in the retry set number above, the compressor is stopped.

7-12. 4-way valve control


- · If heating mode is selected at the compressor start, 4-way valve is energized for heating.
- When the air conditioner is switched between cooling and heating mode, compressor is stopped, and the 4-way valve is switched when the 140 seconds passes and the compressor is started.

7-13. Human sensor for energy saving

If no one enters the room for approximately 20 minutes, the set temperature is automatically controlled. (When someone comes back into the room, the human sensor detect this, and automatically revert to the original settings.)

Operation mode	Operation details (If there is no one in the room for a while)
Cool/Dry	The setting temperature is increased by maximum 2°C. (Maximum setting temperature: 30°C)
Heat	The setting temperature is decreased by maximum 4°C. (Minimum setting temperature: 16°C)
Auto	Energy saving function is performed automatically for the selected mode (cool/heat/dry).

Application range:

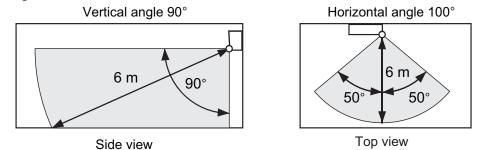

Energy saving function may not work when the room temperature is very different from the temperature defined in the temperature setting, such as when immediately after starting the operation.

 Details about detection with the human sensor: The human sensor detects whether there are people in the room by looking for movement by people in the room.

7-14. Outdoor unit low noise operation

The outdoor unit low noise operation functions by OUTDOOR UNIT LOW NOISE button on the remote controller.

This operation stops the PFC control, and changes the current value.

Models: ROH09KHCBN and ROH12KHCBN


Operation mode	Current	
Operation mode	Trigger condition	Release condition
Cooling/Dry mode	4.5 A	4.0 A
Heating mode	7.0 A	6.5 A

Model: ROH14KHCBN


Operation mode	Current	
Operation mode	Trigger condition	Release condition
Cooling/Dry mode	7.0 A	6.5 A
Heating mode	10.5 A	10.0 A


7-15. Base pan heater control

The base pan heater operates as follows, depending on the outdoor temperature and operating condition.

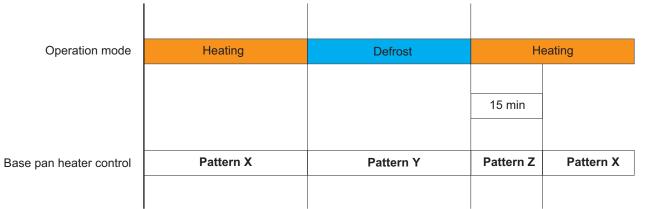


Control pattern

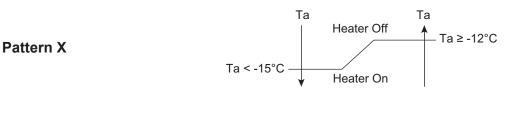







Ta: Outdoor temperature

7-16. Unit status monitoring and the detected value indication

The wired remote controller can monitor the indoor and outdoor units' status and display the detected result as a relevant ID.

For details of the display method, refer to the Chapter of "Display Sensor Values" in the *Installation Manual* of Wired Remote Controller (Touch Panel).

The status can be monitored and displayed on the wired remote controller by assigning an arbitrary ID. For available ID list, refer to the table below.

NOTE: Operating time for each part cannot be reset when the part is replaced. Take notes of the operating time before replacing to count the operating time of the replaced part.

	Available Sensor ID			
Sens	sor ID	Item	Unit	Remarks
00: Indo	or unit			
00	000	Suction temp.	01: °C or °F	
00	001	Room temp.	01: °C or °F	When the wired remote controller thermistor is enabled, temperature of the wired remote controller thermistor is displayed.
00	002	Wired remote controller detected temp.	01: °C or °F	
00	006	Heat exchanger middle temp.	01: °C or °F	
00	020	Fan rotation number	03: rpm	
00	054	Air cleaner status On/Off	08: On/Off	0: Off, 1: On
00	055	Limit switch 1 (For grille) On/Off	08: On/Off	0: Off, 1: On
00	080	Indoor unit total energized hours	11: h	
00	081	Total filtering hours	11: h	
00	082	Indoor unit fan total operation hours	11: h	
00	086	Plasma air clean unit energized hours count (for cleaning time notification)	11: h	
00	095	Presence or absence detected by human sensor	00: —	0: Absence, 1: Presence —: Human sensor error or No human sensor
00	140	Operation or Stop (External input)	00: —	0: Off, 1: On —: When the function setting 46 is not set NOTE: Available only for external input port of the indoor unit
00	142	Forced stop (External input)	00: —	0: Off, 1: On —: When the function setting 46 is not set NOTE: Available only for external input port of the indoor unit
00	143	Operation or Stop 2 (External input)	00: —	0: Off, 1: On —: When the function setting 46 is not set NOTE: Available only for external input port of the indoor unit
00	155	Operation or Stop On/Off (External output)	00: —	0: Off, 1: On NOTE: The value is output even if the function setting or rotary switch is not set.
00	156	Error On/Off (External output)	00: —	0: Off, 1: On NOTE: The value is output even if the function setting or rotary switch is not set.

	Available Sensor ID			
Sens	or ID	ltem	Unit	Remarks
00	157	Indoor unit fan interlocking On/Off (External output)	00: —	0: Off, 1: On NOTE: The value is output even if the function setting or rotary switch is not set.
00	158	Cooling thermostat On/Off (External output)	00: —	0: Off, 1: On NOTE: The value is output even if the function setting or rotary switch is not set.
00	159	Requested cooling strength On/Off (External output)	00: —	0: Off, 1: On NOTE: The value is output even if the function setting or rotary switch is not set.
00	160	External heater On/Off (External output)	00: —	0: Off, 1: On NOTE: The value is output even if the function setting or rotary switch is not set.
00	161	Heating operation status (External output)	00: —	0: Off, 1: On NOTE: The value is output even if the function setting or rotary switch is not set.
00	162	External output command by remote controller (External output)	00: —	0: Off, 1: On NOTE: The value is output even if the function setting or rotary switch is not set.
	loor unit			
01	000	Outdoor temp.	01: °C or °F	
01	001	Discharge temp.	01: °C or °F	
01	003	Heat exchanger middle temp.	01: °C or °F	
01	004	Heat exchanger outlet temp.	01: °C or °F	
01	007	Compressor temp.	01: °C or °F	
01	050	Fan 1 rotation number	03: rpm	
01 01	055 060	Compressor rotation number Expansion valve (Upstream during heating)	04: rps 05: pls	
01	080	4-way valve output status	07: Cooling/ Heating	0: Cooling, 1: Heating
01	089	Base pan heater output On/Off	08: On/Off	0: Off, 1: On
01	100	Operating current	09: A	
01	110	Outdoor unit total power-on hours	11: h	
01	111	Compressor total heating operation hours	11: h	
01	112	Compressor total cooling operation hours	11: h	
01	113	Compressor total operation hours	11: h	
01	114	Outdoor unit fan 1 total operation hours	11: h	

CONTROL AND FUNCTIONS

8. Various protections

8-1. Discharge gas temperature over-rise prevention control

The discharge gas temperature sensor (discharge thermistor: outdoor unit side) detects the discharge gas temperature.

- When the discharge temperature becomes higher than the trigger condition, the rotation number of compressor is decreased as the table below, and it continues to decrease until the discharge temperature becomes lower than the trigger condition.
- When the discharge temperature becomes lower than the release condition, control of compressor rotation number is released.
- When the discharge temperature becomes higher than the compressor protection temperature, the compressor is stopped and the indoor unit indicator lamp starts blinking.

Trigger condition	104°C
Rotation number of compressor	-20 rps/120 seconds
Release condition	101°C
Compressor protection temperature	110°C

8-2. Anti-freezing control (cooling and dry mode)

The rotation number of compressor is decrease in cooling and dry mode when the indoor unit heat exchanger temperature sensor detects the temperature lower than the trigger condition. When the indoor unit heat exchanger temperature reaches release condition, the anti-freezing control is stopped.

Trigger condition		4°C
	Outdoor temp. $\geq 10^{\circ}C^{*1}$ Outdoor temp. $\geq 12^{\circ}C^{*2}$	7°C
Release condition	Outdoor temp. < 10°C* ¹ Outdoor temp. < 12°C* ²	13°C

*1: During the outdoor temperature dropping

*2: During the outdoor temperature rising

8-3. Current release control

The rotation number of compressor is controlled so that the outdoor unit input current does not exceeds current limit value set according to the outdoor temperature.

The rotation number of compressor returns according to the operation mode, when the current becomes lower than the release value.

Model: ROH09KHCBN

The rotation number of compressor is controlled so that the outdoor unit input current does not exceeds current limit value set according to the outdoor temperature.

The rotation number of compressor returns according to the operation mode, when the current becomes lower than the release value.

Operation mode	Outdoor temp. (Ta)	Trigger condition	Release condition
	50°C ≤ Ta	4.5 A	4.0 A
	46°C ≤ Ta < 50°C	4.5 A	4.0 A
Cooling	40°C ≤ Ta < 46°C	5.5 A	5.0 A
Cooling	12°C ≤ Ta < 40°C	5.5 A	5.0 A
	2°C ≤ Ta < 12°C	5.5 A	5.0 A
	Ta < 2°C	5.5 A	5.0 A
	17°C ≤ Ta	7.0 A	6.5 A
Heating	12°C ≤ Ta < 17°C	9.0 A	8.5 A
	5°C ≤ Ta < 12°C	9.0 A	8.5 A
	Ta < 5°C	9.0 A	8.0 A

Model: ROH12KHCBN

The rotation number of compressor is controlled so that the outdoor unit input current does not exceeds current limit value set according to the outdoor temperature.

The rotation number of compressor returns according to the operation mode, when the current becomes lower than the release value.

Operation mode	Outdoor temp. (Ta)	Trigger condition	Release condition
	50°C ≤ Ta	4.5 A	4.0 A
	46°C ≤ Ta < 50°C	4.5 A	4.0 A
Cooling	40°C ≤ Ta < 46°C	6.0 A	5.5 A
Cooling	12°C ≤ Ta < 40°C	6.5 A	6.0 A
	2°C ≤ Ta < 12°C	6.5 A	6.0 A
	Ta < 2°C	6.5 A	6.0 A
	17°C ≤ Ta	7.0 A	6.5 A
Heating	12°C ≤ Ta < 17°C	9.0 A	8.5 A
	5°C ≤ Ta < 12°C	12.0 A	11.5 A
	Ta < 5°C	12.0 A	11.5 A

I Model: ROH14KHCBN

The rotation number of compressor is controlled so that the outdoor unit input current does not exceeds current limit value set according to the outdoor temperature.

The rotation number of compressor returns according to the operation mode, when the current becomes lower than the release value.

Operation mode	Outdoor temp. (Ta)	Trigger condition	Release condition
	50°C ≤ Ta	7.0 A	6.5 A
	46°C ≤ Ta < 50°C	7.0 A	6.5 A
Cooling	40°C ≤ Ta < 46°C	8.0 A	7.5 A
Cooling -	12°C ≤ Ta < 40°C	8.0 A	7.5 A
	2°C ≤ Ta < 12°C	8.0 A	7.5 A
	Ta < 2°C	8.0 A	7.5 A
	17°C ≤ Ta	10.5 A	10.0 A
Lleating	12°C ≤ Ta < 17°C	13.0 A	12.5 A
Heating —	5°C ≤ Ta < 12°C	15.0 A	14.5 A
	Ta < 5°C	15.0 A	14.5 A

8-4. Compressor temperature protection

When the compressor temperature sensor detects higher than the trigger condition below, the compressor is stopped. When the compressor temperature sensor detects the release condition, the protection is released.

Trigger condition	108°C	
Release condition	80°C	
Release condition	(3 minutes after compressor stop)	

8-5. High pressure protection

Trigger condition	Pressure switch: Off (Open: Higher than 4.2 MPa)	
	Compressor stop	
Release condition	Pressure switch: On (Close: Lower than 3.2 MPa)	
	(3 minutes after compressor stop)	
	Compressor restart	

8-6. Low outdoor temperature protection


When the outdoor temperature sensor detects lower than the trigger condition below, the compressor is stopped.

Operation mode	Cooling/Dry
Trigger condition	-15°C
Release condition	-10°C

8-7. High temperature and high pressure release control


The compressor is controlled as follows.

Cooling mode

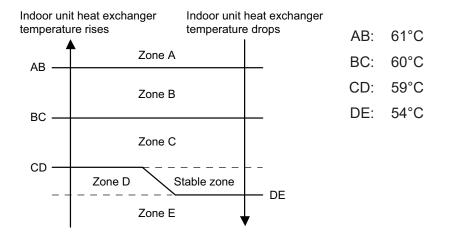

Zone	Operation			
Zone A	Compressor is stopped.			
Zone B	The compressor frequency is decreased.	-30 rps/30 sec.		
Zone C		-5 rps/60 sec.		
Zone D	The protection is released and the operation is returned to normal mode.			
Zone E				

Heating mode

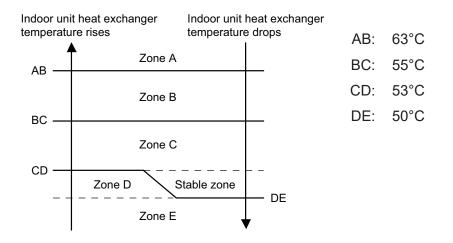

Zone	Operation			
Zone A	Compressor is stopped.			
Zone B	The compressor frequency is decreased.	-25 rps/120 sec.		
Zone C	The compressor frequency is decreased.	-3 rps/60 sec.		
Zone D	The protection is released and the operation is returned to normal mode.			
Zone E				

CONTROL AND FUNCTIONS CONTROL AND FUNCTIONS



5. FILED WORKING

2023.11.10 SR_CH05_AS129EJ_01

CONTENTS

5. FILED WORKING

1. Function settings	05-1
1-1. Function settings by using remote controller	05-1
1-2. Custom code setting for wireless remote controller	05-7
2. External input and output	05-8
2-1. External input	05-9
2-2. External output	05-12
2-3. Setting of external input and output	05-14
2-4. Details of control input function	05-15
2-5. Details of control output function	05-19

1. Function settings

To adjust the functions of this product according to the installation environment, various types of function settings are available.

NOTE: Incorrect settings can cause a product malfunction.

1-1. Function settings by using remote controller

Some function settings can be changed on the remote controller. After confirming the setting procedure and the content of each function setting, select appropriate functions for your installation environment.

Setting procedure by using wireless remote controller

The function number and the associated setting value are displayed on the LCD of the remote controller. Follow the instructions written in the local setup procedure supplied with the remote controller, and select appropriate setting according to the installation environment.

Before connecting the power supply of the indoor unit, reconfirm following items:

- Cover for the electrical enclosure on the outdoor unit is in place.
- There is no wiring mistake.
- · Piping air tightness test and vacuuming have been performed firmly.
- All the necessary wiring work for outdoor unit has been finished.

After reconfirming the items listed above, connect the power supply of the indoor unit.

NOTES:

- Settings will not be changed if invalid numbers or setting values are selected.
- When optional wired remote controller is used, refer to the installation manual enclosed with the remote controller.

Entering function setting mode:

While pressing the FAN SPEED button and TEMP./SELECT (\land) button simultaneously, press the RESET button to enter the function setting mode.

Selecting the function number and setting value:

- 1. Press MODE button.
- Press the TEMP./SELECT (∧) (∨) buttons to select the function number. (Press MODE button to switch between the left and right digits.)
- 3. Press the FAN SPEED button to proceed to value setting. (Press FAN SPEED button again to return to the function number selection.)
- 4. Press the TEMP./SELECT (∧) (∨) buttons to select the setting value. (Press MODE button to switch between the left and right digits.)
- 5. Press the POWERFUL button once. Please confirm the beeping sound.
- 6. Press the START/STOP button once to fix the Function setting. Please confirm the beeping sound.
- 7. Press the RESET button to cancel the function setting mode.
- 8. After completing the function setting, be sure to disconnect the power supply and then reconnect it.

After disconnecting the power supply, wait 30 seconds or more before reconnecting it. The function setting will not become active unless the power supply is disconnected and then reconnected.

Setting value



Contents of function setting

Each function setting listed in this section is adjustable in accordance with the installation environment.

NOTE: Setting will not be changed if invalid numbers or setting values are selected.

• Function setting list

	Function no.	Functions		
1)	11	Filter sign		
2)	30/31	Room temperature control for indoor unit sensor		
3)	35/36	Room temperature control for wired remote controller sensor		
4)	40	Auto restart		
5)	42	Room temperature sensor switching		
6)	44	Remote controller custom code		
7)	46	External input control		
8)	48	Room temperature sensor switching (Aux.)		
9)	49	Indoor unit fan control for energy saving for cooling		
10)	60	Switching functions for external output terminal		

1) Filter sign

Select appropriate intervals for displaying the filter sign on the indoor unit according to the estimated amount of dust in the air of the room.

If the indication is not required, select "No indication" (03).

Function number	Setting value	Setting description	Factory setting
	00	Standard (400 hours)	
11	01	Long interval (1,000 hours)	
	02	Short interval (200 hours)	
	03	No indication	•

ELD

2) Room temperature control for indoor unit sensor

Depending on the installed environment, correction of the room temperature sensor may be required. Select the appropriate control setting according to the installed environment. The temperature of the room temperature sensor is corrected as follows:

Corrected temp. = Temp. of the room temp. sensor - Correction temp. value

Example of correction:

When the temperature of the room temp. sensor is 26° C and the setting value is "03" (-1.0°C), corrected temp. will be 27° C (26° C - [-1.0°C]).

The temperature correction values show the difference from the Standard setting "00" (manufacturer's recommended value).

Functior	n number	Setting value	Setting de	escription	Factory setting
		00	Standard	l setting	♦
		01	No correct	ion 0.0°C	
		02	-0.5°C		
		03	-1.0°C		
		04	-1.5°C		
		05	-2.0°C	More cooling	
		06	-2.5°C	Less heating	
		07	-3.0°C		
30	31	08	-3.5°C		
(For cooling)	(For heating)	09	-4.0°C		
		10	+0.5°C		
		11	+1.0°C		
		12	+1.5°C		
		13	+2.0°C	Less cooling	
		14	+2.5°C	More heating	
		15	+3.0°C		
		16	+3.5°C		
		17	+4.0°C		

3) Room temperature control for wired remote controller sensor

Depending on the installed environment, correction of the wire remote temperature sensor may be required. Select the appropriate control setting according to the installed environment.

To change this setting, set Function 42 to Both "01".

Ensure that the Thermo Sensor icon is displayed on the remote controller screen.

Functior	n number	Setting value	Setting des	cription	Factory setting
		00	Standard	setting	♦
		01	No correction	on 0.0°C	
		02	-0.5°C		
		03	-1.0°C		
		04	-1.5°C		
		05	-2.0°C	More cooling	
		06	-2.5°C	Less heating	
		07	-3.0°C		
35	36	08	-3.5°C		
(For cooling)	(For heating)	09	-4.0°C		
		10	+0.5°C		
		11	+1.0°C		
		12	+1.5°C		
		13	+2.0°C	Less cooling	
		14	+2.5°C	More heating	
		15	+3.0°C	1	
		16	+3.5°C	1	
		17	+4.0°C	1	

4) Auto restart

Enables or disables automatic restart after a power interruption.

Function number	Setting value	Setting description	Factory setting
40	00	Enable	•
40	01	Disable	

NOTE: Auto restart is an emergency function such as for power outage etc. Do not attempt to use this function in normal operation. Be sure to operate the unit by remote controller or external device.

5) Room temperature sensor switching

(Only for wired remote controller)

When using the wired remote controller temperature sensor, change the setting to "Both" (01).

Function number	Setting value	Setting description	Factory setting
42	00	Indoor unit	•
42	01	Both	

00: Sensor on the indoor unit is active.

01: Sensors on both indoor unit and wired remote controller are active.

NOTE: Remote controller sensor must be turned on by using the remote controller.

6) Remote controller custom code

(Only for wireless remote controller)

The indoor unit custom code can be changed. Select the appropriate custom code.

Function number	Setting value	Setting description	Factory setting
	00	A	•
44	01	В	
44	02	С	
	03	D	

7) External input control

"Operation/Stop" mode or "Forced stop" mode can be selected.

Function number	Setting value	Setting description	Factory setting
	00	Operation/Stop mode 1	•
	00	(Remote controller enabled)	•
46	01	(Setting prohibited)	
40	02	Forced stop mode	
	02	Operation/Stop mode 2	
	03	(Remote controller disabled)	

8) Room temperature sensor switching (Aux.)

To use the temperature sensor on the wired remote controller only, change the setting to "Wired remote controller" (01).

This function will only work if the function setting 42 is set at "Both" (01).

When the setting value is set to "Both" (00), more suitable control of the room temperature is possible by setting function setting 30 and 31 too.

Function number	Setting value	Setting description	Factory setting
48	00	Both	•
40	01	Wired remote controller	

9) Indoor unit fan control for energy saving for cooling

Enables or disables the power-saving function by controlling the indoor unit fan rotation when the outdoor unit is stopped during cooling operation.

Function number	Setting value	Setting description	Factory setting
	00	Disable	
49	01	Enable	
	02	Remote controller	•

00: When the outdoor unit is stopped, the indoor unit fan operates continuously following the setting on the remote controller.

01: When the outdoor unit is stopped, the indoor unit fan operates intermittently at a very low speed.

02: Enable or disable this function by remote controller setting.

NOTE: Set to "00" or "01" when connecting a remote controller that cannot set the Fan control for energy saving function or connecting a network converter. To confirm if the remote controller has this setting, refer to the operating manual of each remote controller.

10) Switching functions for external output terminal

Functions of the external output terminal can be switched. For details, refer to "External input and output".

Function number	Setting value	Setting description	Factory setting
	00	Operation status	•
	01—08	(Setting prohibited)	
60	09	Error status	
	10	Indoor unit fan operation status	
	11	(Setting prohibited)	

1-2. Custom code setting for wireless remote controller

To interconnect the air conditioner and the wireless remote controller, assignment of the custom code for the wireless remote controller is required.

NOTE: Air conditioner cannot receive a signal if the air conditioner has not been set for the custom code.

When 2 or more air conditioners are installed in a room, and the remote controller is operating an air conditioner other than the one you wish to set, change the custom code of the remote controller to operate only the air conditioner you wish to set. (4 selections possible.)

Confirm the setting of the remote controller custom code and the function setting. If these do not match, the remote controller cannot be used to operate for the air conditioner.

- 1. Press the START/STOP button until only the clock is displayed on the remote controller display.
- 2. Press the MODE button for at least 5 seconds to display the current custom code. (Initially set to $\frac{1}{2}$.)
- Press the TEMP./SELECT (∧) (∨) buttons to change the custom code between A→b→c→c. Match the code on the display to the air conditioner custom code. (Initially set to A.)
- 4. Press the MODE button again to return to the clock display. The custom code will be changed.


NOTES:

- If no button is pressed within 30 seconds after the custom code is displayed, the system returns to the original clock indicator. In this case, start again from step 1.
- The air conditioner custom code is set to 🛱 prior to shipment. To change the custom code, contact your retailer.
- If you do not know the assigned code for the air conditioner, try each of the custom code (→ □ → □ → □ → □) until you find the code which operates the air conditioner.



2. External input and output

DNG

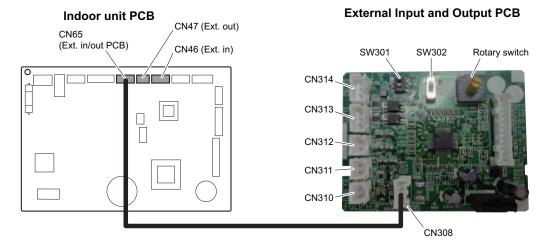

Connectir	ng point	Input/Output	Function	Input select	Input signal
	CN46	Input	Operation/Stop	Dry contact	Edge
	01140	linput	Forced stop	Diy contact	Luge
Indoor unit			Operation/Stop		
	CN47	Output	Error status		
		Output	Indoor unit fan		
			operation status		
	CN313		Operation/Stop		Edge/Pulse
	CN314	Input	Forced stop	Dry contact/Apply voltage	Luge/1 uise
External Input	CN313		Forced thermostat		Edge
and Output PCB	CIND ID		off		Luge
(UTY-XCSXZ3)	CN310		Operation/Stop		
,	CN311		Error status		
	CN312		Indoor unit fan		
	GNUTZ		operation status		

NOTE: For details of the switching function, refer to "Setting of external input and output" on page 05-14.


2-1. External input

With using external input function, some functions on this product can be controlled from an external device.

- "Operation/Stop" mode or "Forced stop" mode can be selected with function setting of indoor unit.
- A twisted pair cable should be used. Maximum length of cable is 150 m.
- Use an external input and output cable with appropriate external dimension, depending on the number of cables to be installed.
- The wire connection should be separate from the power cable line.

Indoor unit

Indoor unit functions such as Operation/Stop can be done by using indoor unit connectors.

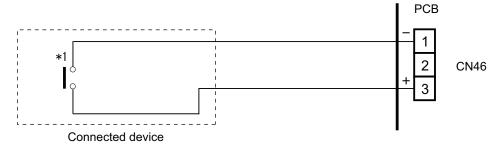

*1: The switch can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.

External Input and Output PCB


The indoor unit Operation/Stop can be set by using the input connector on the PCB.

Input select

Use either one of these types of connectors according to the application. (Both types of connectors cannot be used simultaneously.)

- Dry contact


In case of internal power supply, set the slide switch of SW301 to "NON VOL" side.

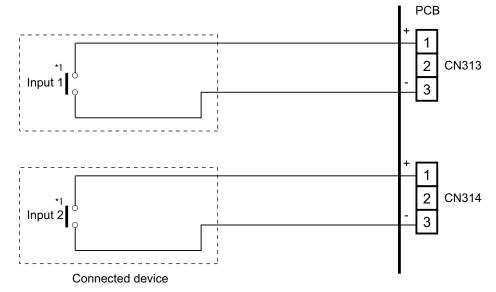

*1: The switches can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.

- Apply voltage

In case of external power supply, set the slide switch of SW301 to "VOL" side.

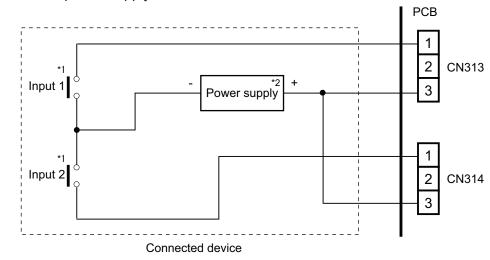


*1: The switches can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA. *2: Make the power supply DC 12 V to 24 V, 10 mA or more.



Indoor unit


Input signal type is only "Edge".



• External Input and Output PCB

The input signal type can be selected.

Signal type (edge or pulse) can be switched by the DIP switch 2 (SW302) on the External Input and Output PCB.



NOTE: The input signal supports the following switch type:

- Edge: Alternate type switch
- Pulse: Momentary type switch

2-2. External output


Use an external output cable with appropriate external dimension, depending on the number of cables to be installed.

Indoor unit

- A twisted pair cable should be used. Maximum length of cable is 25 m.
- Output voltage: High DC 12 V ±2 V, Low 0 V.
- Permissible current: 50 mA
- For details, refer to "Setting of external input and output" on page 05-14.


· When indicator, etc. are connected directly

Example: Function setting number 60 is set to "00"

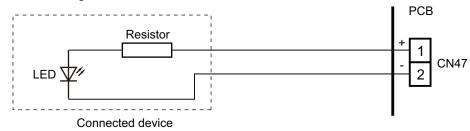


· When connecting with a device equipped with a power supply

Example: Function setting number 60 is set to "00"




External Input and Output PCB

- A twisted pair cable should be used. Maximum length of cable is 25 m.
- Output voltage: High DC 12 V ±2 V, Low 0 V.
- Permissible current: 50 mA
- For details, refer to "Setting of external input and output" on page 05-14.
- When indicator or other components are connected directly: Example: Rotary SW on External Input and Output PCB is set to "1".

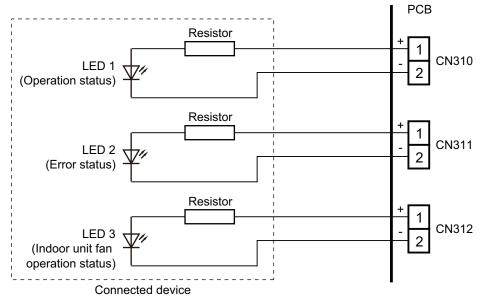

 When connecting with a device equipped with a power supply: Example: Rotary SW on External Input and Output PCB is set to "1".

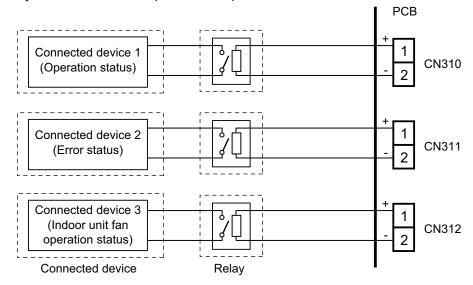

2-3. Setting of external input and output

• Indoor unit

Input					
Connection point	Function setting number 46	Function			
	00	Operation/Stop mode 1 (R.C. enabled)			
CN46	01	(Setting prohibited)			
CIN40	02	Forced stop mode			
	03	Operation/Stop mode 2 (R.C. disabled)			

Output					
Connection point	Function setting number 60	Function			
	00	Operation/Stop			
	01 to 08	(Setting prohibited)			
CN47	09	Error status			
	10	Indoor unit fan operation status			
	11	(Setting prohibited)			

External Input and Output PCB

Switch	Switch setting Input		Output			
Rotary switch	SW302	CN313	CN314	CN310	CN311	CN312
	Edge	Operation/Stop	Not available			Indoor unit fan
1	Pulse	Operation	Stop	Operation/Stop	Error status	operation status
2		Forced thermostat off	Not available	Error status	Indoor unit fan operation status	Not available
3 to 9, A			(Setting prohibited)	
В	Edge*	Forced thermostat off	Not available	Operation/Stop	Indoor unit fan operation status	Not available
С		Forced thermostat off	Not available	Operation/Stop	Error status	Not available
D		Forced thermostat off	Not available	Operation/Stop	Indoor unit fan operation status	Error status

NOTES:

- When the rotary switch is selected to "1", the operation of the connector input of the indoor unit and the External Input and Output PCB input are the same. The operation content depends on the setting of function setting number 46.
- *: The external input other than "Operation/Stop" is available only when the SW302 is set to "Edge".

2-4. Details of control input function

Operation/Stop mode 1

• In the case of "Edge" input

Function		Input and It PCB	External input		Input signal	Command
setting	Rotary switch	SW302			input signal	Command
	_		Input of indoor unit	CN46	$Off \rightarrow On$	Operation
46-00				01140	$On \rightarrow Off$	Stop
40.00	1	Edge	External Input and	CN313	$Off \rightarrow On$	Operation
	I	Luge	Output PCB	ONOTO	$On \rightarrow Off$	Stop
	CN313 On Off					
	Indooi	r unit operation	On Off			
Remote controllerOn						

• In the case of "Pulse" input

UNG

Function	External Outpu		– External input		Input signal	Command
setting	Rotary switch	SW302			input signal	
46-00	1	Pulse	External Input and	CN313	Pulse	Operation
			Output PCB	CN314		Stop
	CN313	On	П	Г	חו	
		Off				
	CN314	On	П	П		1
		Off				
Indoor	r unit operation	On		Г		1
		Off				
	Remote cor	ntroller		to	'n	

NOTES:

• The last command has priority.


Remote controller

• The indoor units within the same remote controller group operates in the same mode.

Forced stop

• In the case of "Edge" input

Function		Input and It PCB	Extornal in	out	Input signal	Command
setting	Rotary switch	SW302	External input		input signal	Command
			Input of indoor unit CN46		$Off\toOn$	Forced stop (R.C. disabled)
46-02	_	_		CIN40	$On\toOff$	Normal (R.C. enabled)
40-02		External Input and Output PCB CN313	CN313	$Off\toOn$	Forced stop (R.C. disabled)	
	1 Edge		$On\toOff$	Normal (R.C. enabled)		

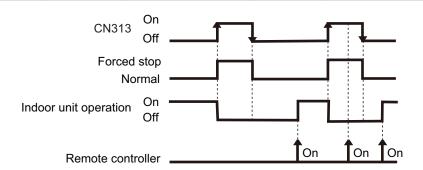

In the case of "Pulse" input

Function	External Input and Output PCB		Futurnal in nut		Input signal	Command
setting	Rotary switch	SW302	External input		input signal	Command
46-02	1	Pulse	External Input and	CN313	Pulse	Forced stop (R.C. disabled)
40-02	I	r uise	Output PCB	CN314	r uise	Normal (R.C. enabled)
In	CN	I313 Off I314 Off Off Off Off Normal On Off Off				
	Remote o	controller		On	On	On

NOTES:

- When the forced stop is triggered, indoor unit stops and Operation/Stop operation by the remote controller is restricted.
- When forced stop function is used with forming a remote controller group, connect the same equipment to each indoor unit within the group.

Operation/Stop mode 2

• In the case of "Edge" input

Function	External Input and Output PCB		External input		Input signal	Command
setting	Rotary switch	SW302	External inj	Sut	input signal	Command
		·	Input of indoor unit	CN46	$Off \rightarrow On$	Operation (R.C. enabled)
46-03	46.02			CIN40	$On \rightarrow Off$	Stop (R.C. disabled)
40-03	1	Edge	External Input and	CN313	$Off \rightarrow On$	Operation (R.C. enabled)
	I	Luge	Output PCB	CNOTO	$On \rightarrow Off$	Stop (R.C. disabled)
		On CN313 Off				_
	Indoor unit o	On operation Off				_

On

Off

On

In the case of "Pulse" input

Remote contoller

Function		Input and It PCB	External input		Input signal	Command
setting	Rotary switch	SW302		put	input signal	Command
46-03	1	Pulse	External Input and	CN313	Pulse	Operation (R.C. enabled)
			Output PCB	CN314		Stop (R.C. disabled)
	CN31:	On Off ———				
	CN314	On 4 Off		<u>Л</u>		<u> </u>
Indoo	r unit operatio	On Off				
	Remote con	troller		Or	n Off	On

NOTE: When "Operation/Stop" mode 2 function is used with forming a remote controller group, connect the same equipment to each indoor unit within the group.

KING

Forced thermostat off

I


External Input and Output PCB	External inp	out	Input signal	Command	
Rotary switch					
2, B, C, D	External Input and	CN313	$Off \rightarrow On$	Thermostat off	
2, 0, 0, 0	Output PCB	CN313	$On \rightarrow Off$	Normal operation	
Comp	CN313 On Off Oressor On Off Room temp. Set temp.				

2-5. Details of control output function

Operation status

Function setting	External Input and Output PCB Rotary switch	External out	put	Output signal	Status
60-00	1. 2	Output of indoor unit	CN47	$Off \rightarrow On$	Operation
00-00	1, 2			$On \rightarrow Off$	Stop
	1, B, C, D	External Input and	CN310	$Off \rightarrow On$	Operation
	Г, D, C, D	Output PCB	CNSTU	$On \rightarrow Off$	Stop


The output is low when the unit is stopped.

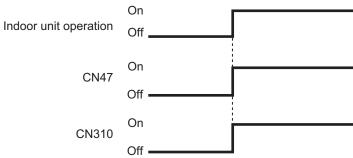

Error status

Function setting	External Input and Output PCB	External out	put	Output signal	Status
ootting	Rotary switch				
60.00	60-09 —	Output of indoor unit	CN47	$Off \rightarrow On$	Error
00-09				$On \rightarrow Off$	Normal
	2	External Input and	CN310	$Off \rightarrow On$	Error
	2	Output PCB	CINGTO	$On \rightarrow Off$	Normal
	- 1, C External Input and Output PCB CN3	CN211	$Off \rightarrow On$	Error	
_		Output PCB	CINSTI	$On \rightarrow Off$	Normal
	D	External Input and	CN312	$Off \rightarrow On$	Error
_	D	Output PCB	GINGTZ	$On \rightarrow Off$	Normal

The output is on when an error is generated for the indoor unit.

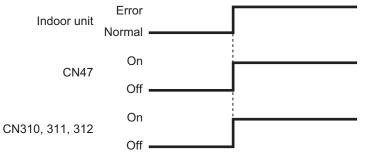

FIELD WORKING

Indoor unit fan operation status

Function setting	External Input and Output PCB Rotary switch	External output		Output signal	Status
60-10	С	Output of indoor unit	CN47	$Off \rightarrow On$	Fan run
00.10	ů ů		$On \rightarrow Off$	Fan stop	
	2, B, D	External Input and	CN311	$Off \rightarrow On$	Fan run
	2, 0, 0	Output PCB	Output PCB	$On \rightarrow Off$	Fan stop
	1	External Input and	CN312	$Off \rightarrow On$	Fan run
_	Ι	Output PCB	CINJIZ	$On \rightarrow Off$	Fan stop

Output signal	Condition
On The indoor unit fan is operating.	
Off	The fan is stopped or during cold air prevention. During thermostat off when in dry mode operation.

